Anexa nr.3

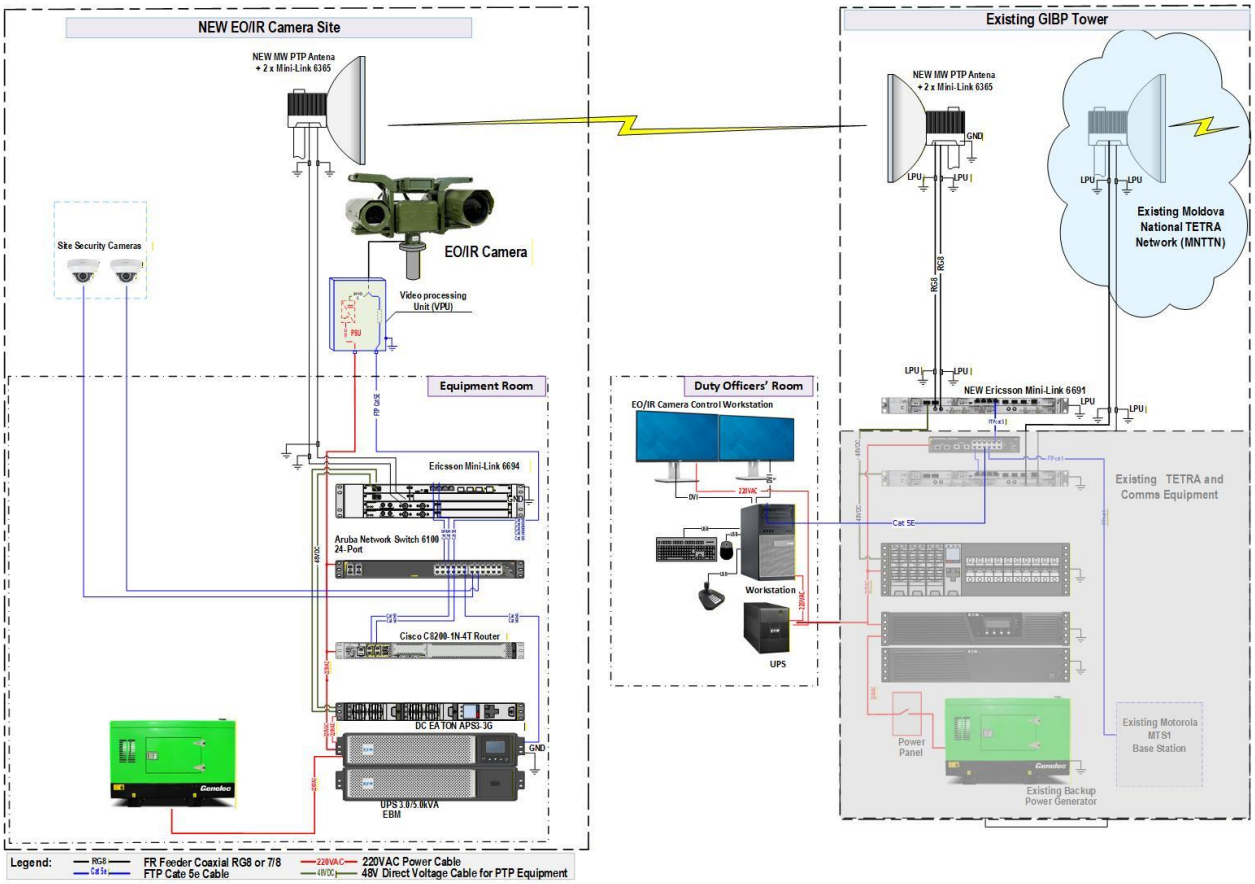
NEW EO/IR Camera Site
NEW MW PTP Antena + 2 x Mini-Link 6365
EO/IR Camera
Site Security Cameras
Video processing Unit (VPU)
Equipment Room
Ericsson Mini-Link 6694
Aruba Network Switch 6100 24-Port
Cisco C8200-1N-4T Router
DC EATON APS3-3G
UPS 3.0/5.0kVA EBM
Duty Officers' Room
EO/IR Camera Control Workstation
Workstation
UPS
Existing GIBP Tower
NEW MW PTP Antena + 2 x Mini-Link 6365
Existing Moldova National TETRA Network (MNTTN)
NEW Ericsson Mini-Link 6691
Existing TETRA and Comms Equipment
Power Panel
Existing Backup Power Generator
Existing Motorola MTS1 Base Station
Legend:
FR Feeder Coaxial RG8 or 7/8
FTP Cate 5e Cable
220VAC Power Cable
48V Direct Voltage Cable for PTP Equipment