



Котел (проектируемый) водогрейный, напольный, конденсационный TRIGON XXL SE1100. Q=1073kW, со встроенной газовой горелкой




- 11/2023-AGI

The diagram illustrates a gas supply system for a boiler house. It features a horizontal line representing the gas supply line, with six numbered points (2, 3, 4, 5, 6) indicating specific locations. The distance between each point is marked as 6000. The line starts at point 2 and ends at point 6. The diagram is labeled "Sistem de alimentare cu gaze pentru cazanul de incalzire" and "Proiect de executie".

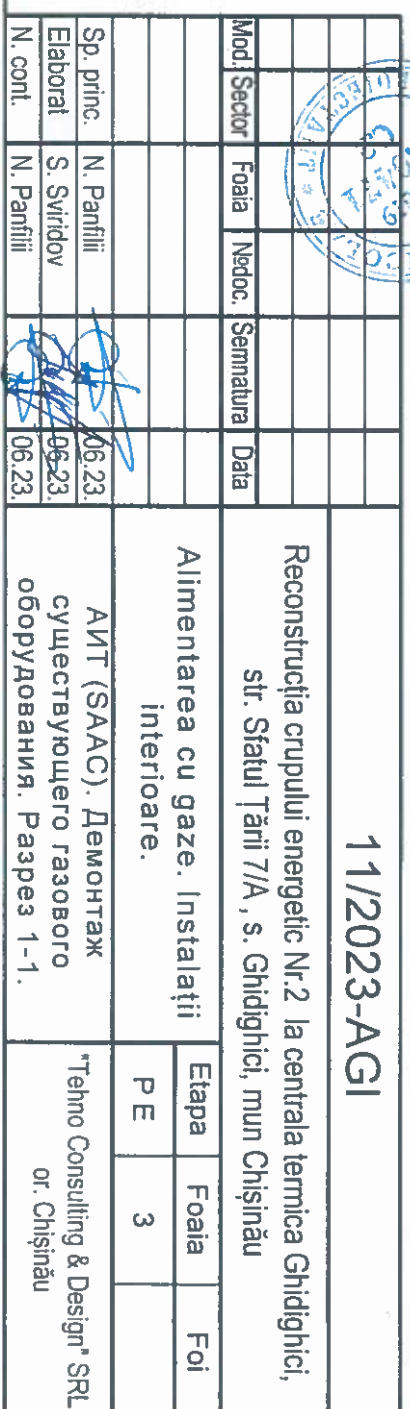

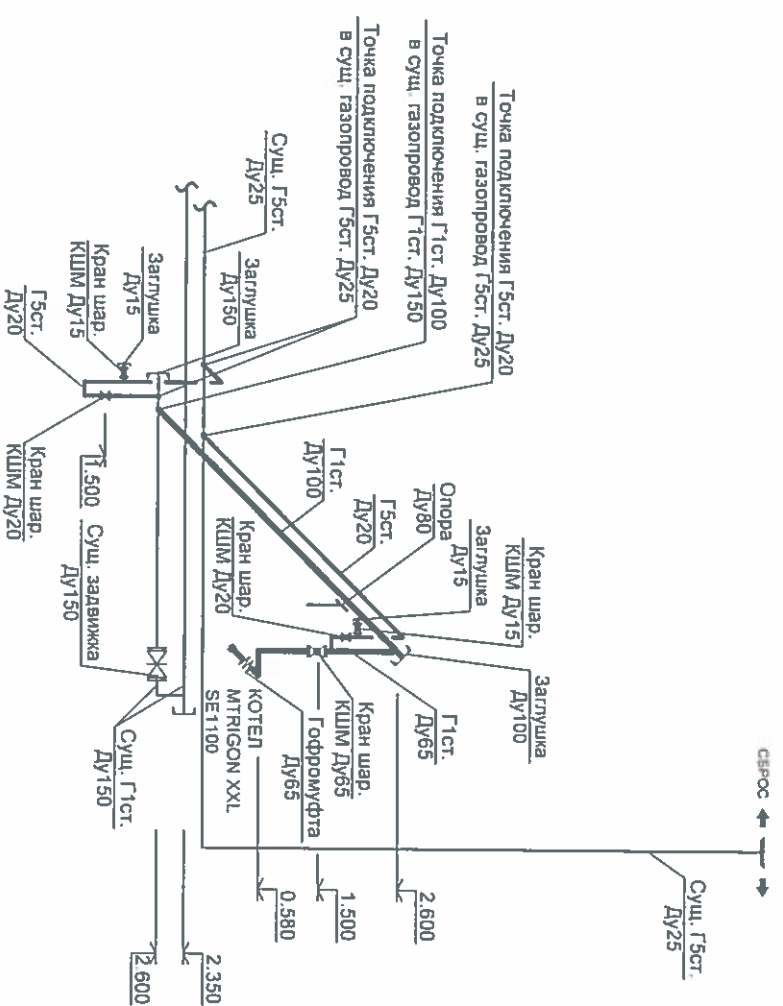[illegible]

Регистрационный номер	при приемке в эксплуатацию
Измеряемая среда	природный газ по ГОСТ 5542-87, осушенный, одорированный
Линия замера	счетчик газа ротационный G 250, Ду100
Измеряемый расход	Q= 1,0 - 100,0 м³/ч, диапазон 1:100
Электронный корректор	midі ELСOR (относительная погрешность <0,5%)
Датчик давления	Рабс.= 0,08-0,52 МПа (точность измерения <0,25%)
Датчик температуры	Рt 1000; t= -25 +60 °С (точность измерения <0,1%)

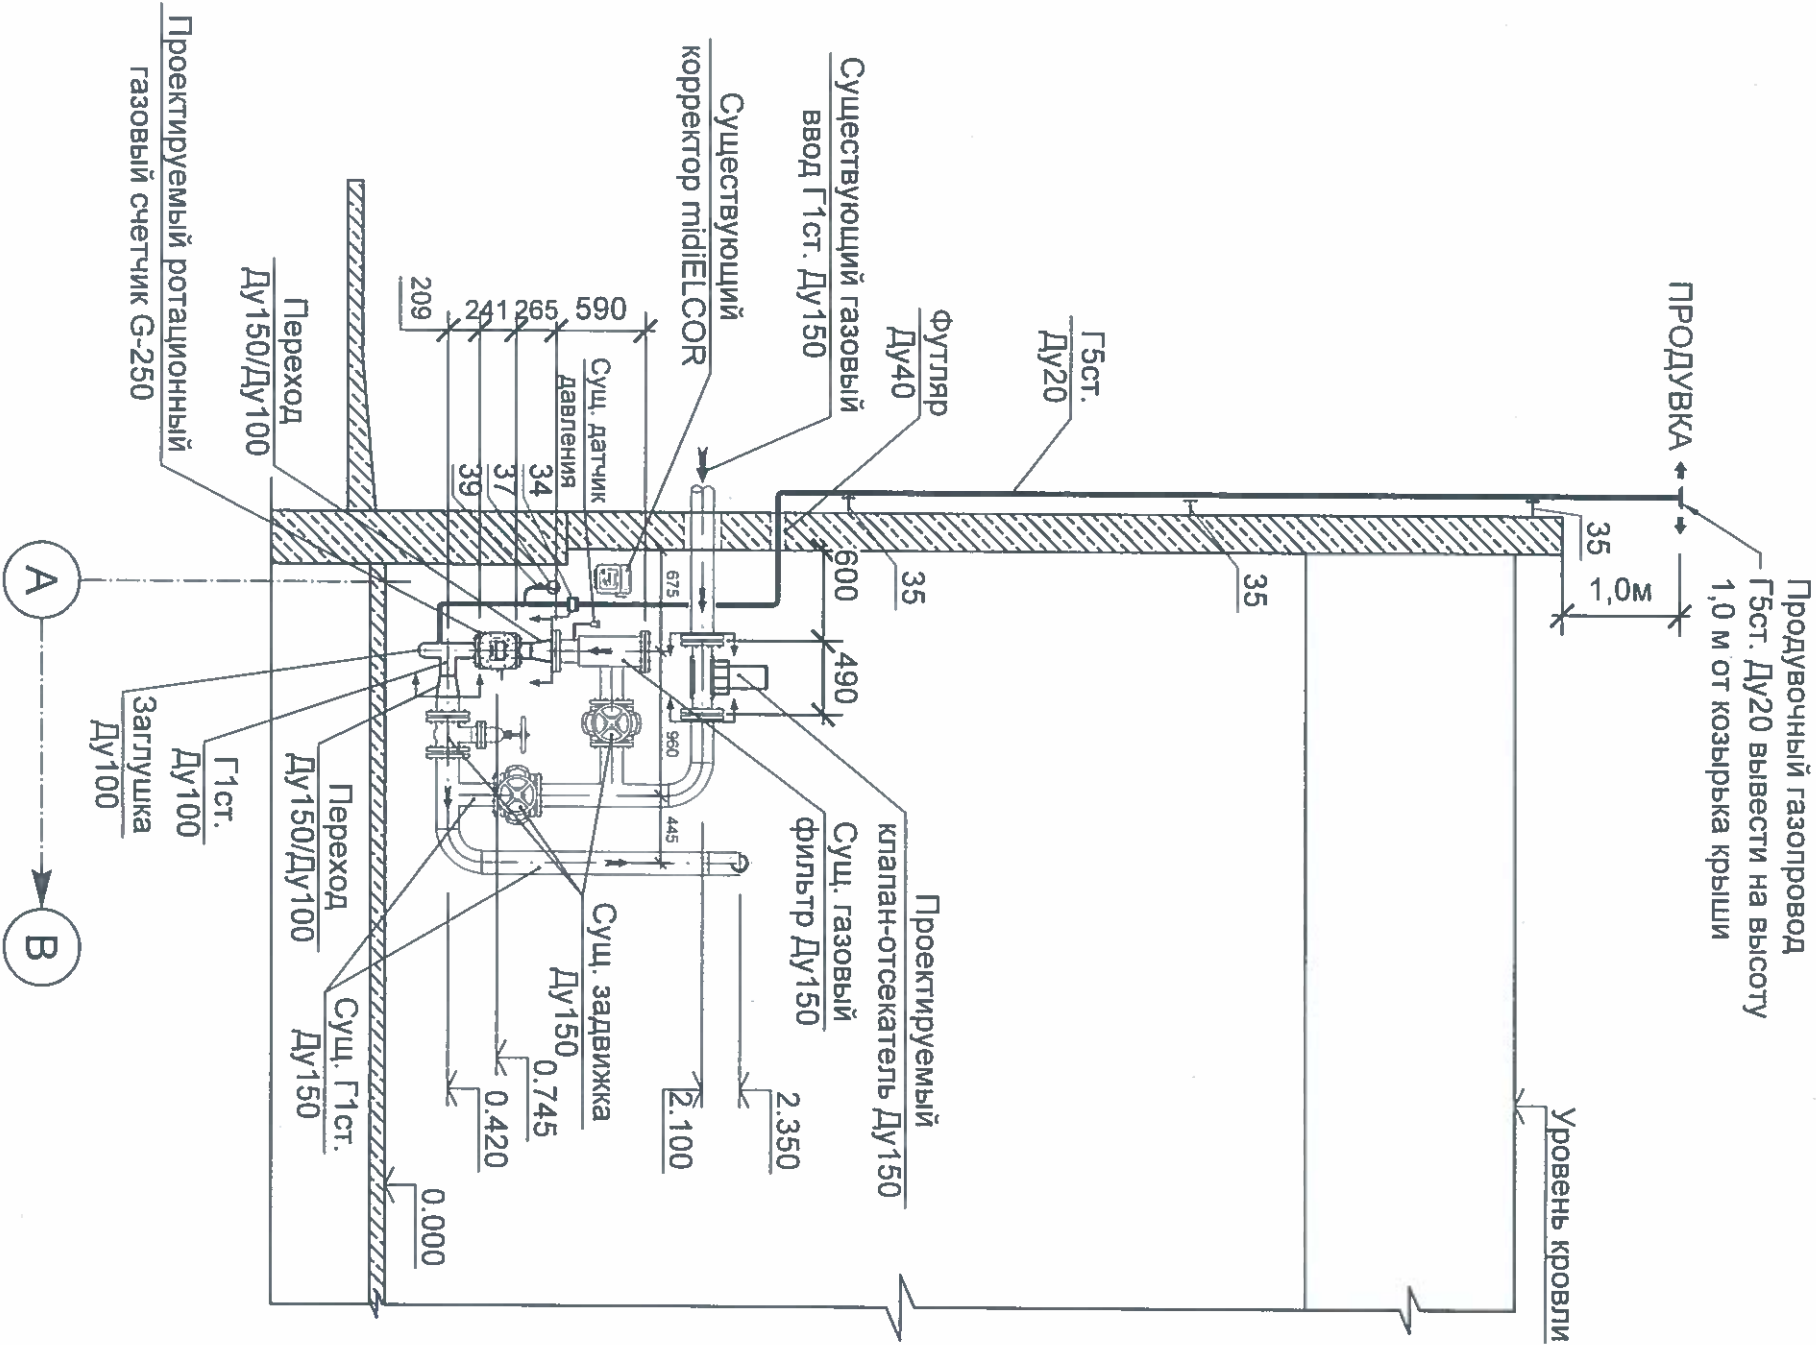

- ПРИМЕЧАНИЯ:
1. Существующий счетчик РГK-600 - демонтировать.
 2. Корректор midіELСOR в комплекте с датчиком давления и температуры - существующие.

Условное обозначение
- Граница проектирования.

				11/2023-AGI			
Reconstrucția cuprului energetic Nr.2 la centrala termică Ghidighici, str. Statul Țării 7/A, s. Ghidighici, mun Chișinău							
Alimentarea cu gaze. Instalații interioare.				Etapa	Foaia	Foi	
				Р Е	6		
Sp. princ. Elaborat	N. Pantilii S. Sviridov	06.23.06.23.		АИТ (SAAC). Узел учета расхода газа. Разрез 3-3.			
N. cont.	N. Pantilii	06.23.06.23.		"Techno Consulting & Design" SRL or. Chișinău			