



MARK VIEW

ANKARA
SERAMİK
İOS 35-500-UHL1
MADE IN TURKEY

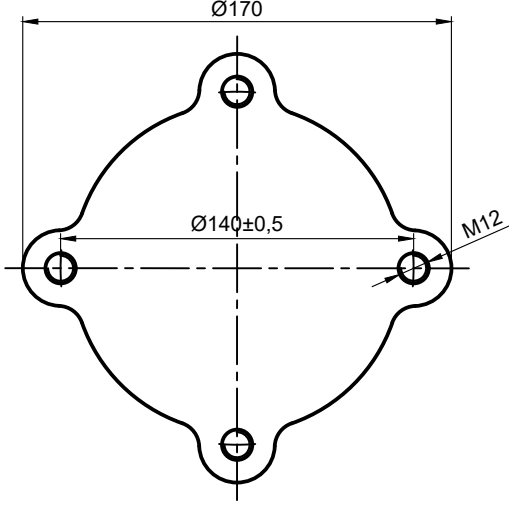

'X' Bakışı
View 'X'

Markalama
Mark

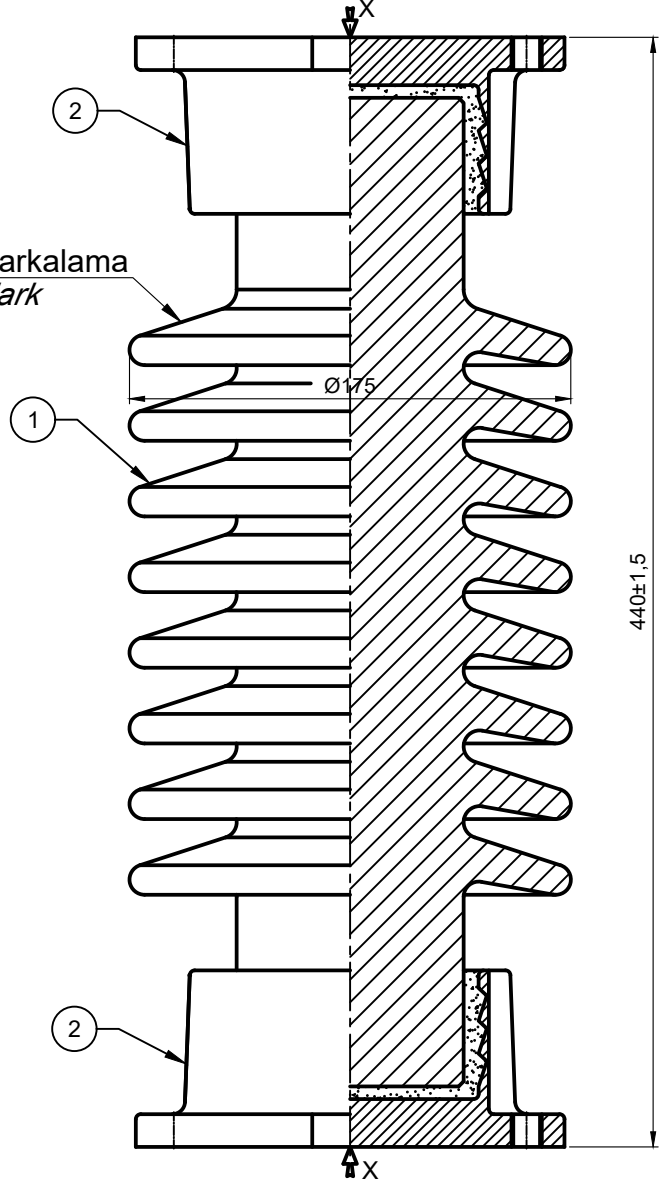

Sırsız Yüzey (Unglazed Surface)

ELEKTRİKSEL PERFORMANS ELECTRICAL PERFORMANCE

Anma Gerilimi (Rated Voltage)	35 kV
Yaşta Şebeke Frek. Dayanım Gerilimi (Power Freq. Withstand Voltage, Wet)	95 kV
Yıldırım Darbe Dayanım Gerilimi (Lightning Impulse Withstand Voltage)	190 kV

MEKANİKSEL PERFORMANS MECHANICAL PERFORMANCE

Eğilmede Minimum Kırılma Yüğü (Min. Bending Failing Load)	5 kN
--	------

DIELEKTRİK PARÇALAR (DIELECTRIC PARTS)

Malzeme (Material) IEC 60672-3	Porselen (Porcelain)
Kaçak Mesafesi (Creepage Distance)	(Z-Z) min. 750 mm
Sır Rengi (Glaze Color)	Kahverengi (Brown)
Tolerans (General Tolerance)	-
Ağırlık (Weight)	~ 19 kg

2	380000-945	Ø170-4xM12 H.M. Metal Kep (Metal Cap)	1	GGG-40 (EN-GJS-400-15) EN ISO 1461 HOT DIP. GALV. (90-100mic.)
1	9-714080-000	Seramik Gövde (Ceramic Body)	1	Porselen (Porcelain)
Poz. (Pos.)	Ürün No (Product No)	Bileşen Parçaları (Components Parts)	Adet (Pcs.)	Malzeme (Material)

ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED

THIS DRAWING IS NOT TO BE COPIED OR THE INFORMATION HEREIN DIVULGED TO ANY THIRD PARTY OR USED FOR THE MAKING OF APPARATUS WITHOUT THE WRITTEN PERMISSION OF ANKARA SERAMİK A.Ş.



PORSELEN SAN. ve TİC. A.Ş.
PORCELAIN INDUSTRY OF TURKEY
1.ORGANİZE SAN.BÖL.OSMANLI CAD.
NO:15 SİNCAN/ANKARA/TURKEY
TEL: (0312) 267 37 77 FAX: (0312) 267 27 77
info@ankaseramik.com

Yayın Tarihi
(Release Date)
Onay
(Approved By)
Kontrol
(Checked)
Çizen
(Drawn By)

10.01.2022

İ.ŞAHİN

Ö.ÇİTAK

E.TONBULOĞLU

Malzeme
(Material)

Std. No.

Rev. No

Ürün no / Müşteri
(Product No / Customer)

Porselen (Porcelain)-C 110

GOST 25073-81

9-714080-000

Adet
(Piece)

Ölçek
(Scale)

IOS 35-500 UHL1
HARİCİ MESNET İZOLATÖRÜ
OUTDOOR POST INSULATOR