



Beijing ZhongDaHuaYuan Certification Center

(B22 Fochengmenwai Street, Western District, Beijing, 100833 P.R.China)

Quality Management System Certification Certificate

No. 02013Q20582R0S

ZHEJIANG TANHO ELECTRIC EQUIPMENT CO., LTD.

System scope assessed

Address(zip): No.999-1001, Lishi Road, Shihou Village, Liushi Town, Yueqing, Wenzhou City; Changhong Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, P.R.China (325604)

Production or service: Design and production of cable power fittings series product (Al-Cu-Al series, cold-press terminal (insulator fitting), high-low electrical series (HV drop out fuse cutout, HV disconnecting switch, composite insulator, metal oxide arrester, vacuum circuit breaker, distribution boards, fault indicators, cable accessories), electrical tool (if refer to the manufacturing license, we operate run with the license)

System is in conformity with GB/T 19001-2008/ISO 9001:2008

Issued date:2013.3.12 Expiration date:2016.3.11

The certification registration scope doesn't include those product / service scopes which fail to be covered by the relevant effective administration permission and qualification permission regulated by the state.

LIUJIANGYI, Director of ZDHY



MANAGEMENT SYSTEM
CNAS C020-Q





Beijing ZhongDaHuaYuan Certification Center

(B22 Fuchengmenwai Street, Western District, Beijing, 100833 P.R.China)

Environmental Management System Certification Certificate

No. 02013E20200508

ZHEJIANG TANHO ELECTRIC EQUIPMENT CO., LTD.

System scope assessed

The environmental management activities of design and production of cable power fittings series products (Al-Cu-Al series cold-press terminal, insulator fitting), high-voltage electrical series (HV drop-out fuse cutout, HV disconnecting switch, composite insulator, metal-oxide arrester, vacuum circuit breaker, fault indicators, cable accessories), electrical tool (refer to the manufacturing license, consistent with the license) of Zhejiang Tanho Electric Equipment Co., Ltd.. It is situated in Changqiang Village, Liushi Town, Yueqing City, Wenzhou City, Zhejiang Province, P.R.China 325604

System is in conformity with
GB/T 24001-2004/ISO 14001:2004

Issued date: 2013.3.12 Expiration date: 2016.3.11


The certification registration scope doesn't include those products/service scopes which fail to be covered by the relevant effective administration permission and qualification permission regulated by the state.

LIUJIANGYI, Director of ZDHY



MANAGEMENT SYSTEM
CNAS C020-E



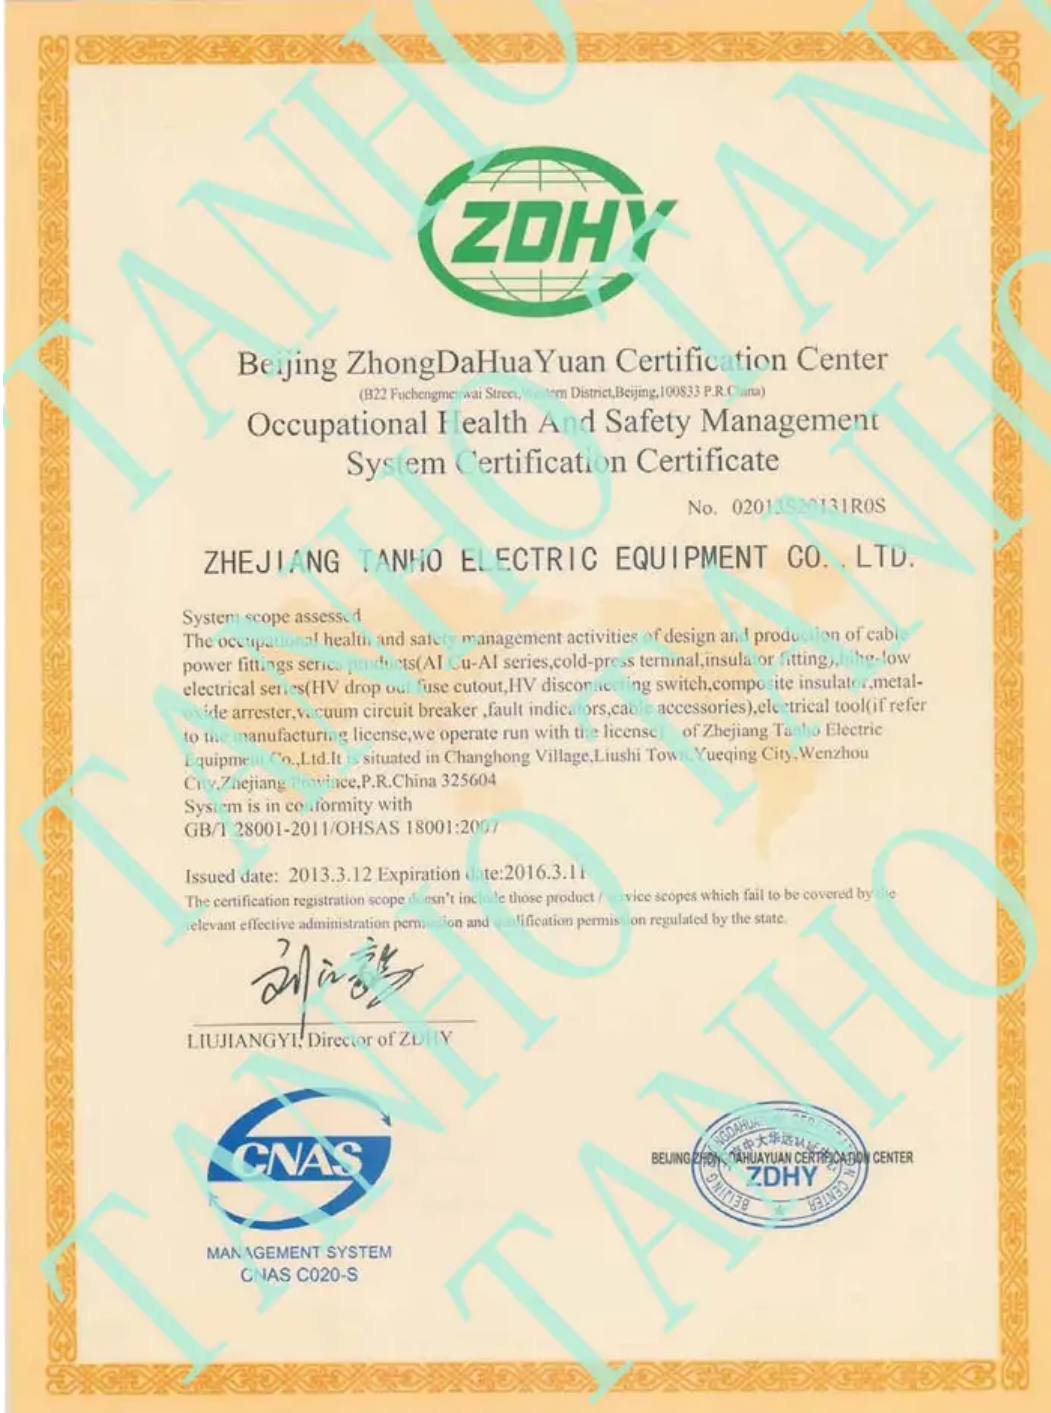



VERIFICATION OF LVD CONFORMITY

Registration No.
012077-037/CN

Applicant : ZHEJIANG TANHO ELECTRICAL EQUIPMENT CO., LTD.
NO.82,NORTH YUEDU RD,CHANGHONG INDUSTRIAL ZONE, LIUSHI TOWN,
YUEQING CITY, ZHEJIANG, CHINA

Is authorized to
provide the product
mentioned below with
the mark as illustrated



Manufacturer : ZHEJIANG TANHO ELECTRICAL EQUIPMENT CO., LTD.
NO.82,NORTH YUEDU RD,CHANGHONG INDUSTRIAL ZONE, LIUSHI TOWN,
YUEQING CITY, ZHEJIANG, CHINA

Product Description : INSULATING ANCHOR CLAMP
Model No. : PA, PAL, PALT, PALA, EA, PAG, NES, THA, THB, THKP, THKO, NXJ

Test Standard : EN 61284:1997

Test Report Number : UTS(12)-827-07-LVD

Conclusion of assessment:

We hereby confirm that the technical construction file and manufacturing, inspection and testing processes for above mentioned equipment comply with the essential safety requirements of:

Low Voltage Directive 2006/95/EC

Note: This certificate is only valid for the equipment and configuration described, in conjunction with the test data detailed above.

Name: Jason. Ma
Position: General Manager

Third Party Authority
Stamp:

Signature: *Jason. Ma*

Date: Jul. 30, 2012



Shanghai yousende products inspection technology Co., Ltd.
Room 812-813, JiaoNeng International Mansion, No.79, Aoba Road, Pudong District, Shanghai China
Tel:+86 2151099699 Fax:+86 2160456901 E-mail: utsce@apragaz.com.cn
<http://www.utsce.com>



VERIFICATION OF LVD CONFORMITY

Registration No.
012076-037/CN

Applicant : ZHEJIANG TANHO ELECTRICAL EQUIPMENT CO., LTD.
NO.82,NORTH YUEDU RD,CHANGHONG INDUSTRIAL ZONE, LIUSHI TOWN,
YUEQING CITY, ZHEJIANG, CHINA

Is authorized to
provide the product
mentioned below with
the mark as illustrated



Manufacturer : ZHEJIANG TANHO ELECTRICAL EQUIPMENT CO., LTD.
NO.82,NORTH YUEDU RD,CHANGHONG INDUSTRIAL ZONE, LIUSHI TOWN,
YUEQING CITY, ZHEJIANG, CHINA

Product Description : INSULATING PIERCING CONNECTOR
Model No. : TH,JJC,BC,AP,PC,SL, P, TTD, NTD,IPC,JBC,JBD,FT,JJCF,THF,JCH

Test Standard : EN 61284:1997

Test Report Number : UTS(12)-826-07-LVD

Conclusion of assessment:

We hereby confirm that the technical construction file and manufacturing, inspection and testing processes for above mentioned equipment comply with the essential safety requirements of:

Low Voltage Directive 2006/95/EC

Note: This certificate is only valid for the equipment and configuration described, in conjunction with the test data detailed above.

Name: Jason. Ma
Position: General Manager

Signature: *Jason. Ma*

Third Party Authority
Stamp:

Date: Jul. 30, 2012



Shanghai yousende products inspection technology Co., Ltd.
Room 812-813, JiaoNeng International Mansion, No.79, Aona Road, Pudong District, Shanghai China
Tel:+86 2151099699 Fax:+86 2160456901 E-mail: utsce@apragaz.com.cn
http://www.utsce.com