


LICENCE

No. 20497 replaces No.20458

Issued to:
Applicant:
R-Tech
Rue de Mons, 3
4000 LIEGE
Belgium

Licensee:
Schreder S.A.
Rue de Lusambo, 67
1190 BRUXELLES
Belgium

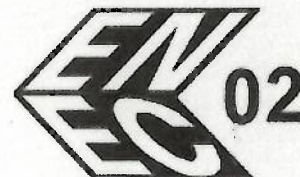

Product : road, square, street, flood lighting
Trade name(s) : SCHREDER
Type(s)/model(s) : VOLTANA 1, VOLTANA 2, VOLTANA 3, VOLTANA 4,
VOLTANA 5

The product and any acceptable variation thereto is specified in the annex to this licence and the documents therein referred to.


SGS CEBEC hereby declares that the above-mentioned product has been certified on the basis of:

- a type test according to the standard specified in annex
- an inspection of the production location
- a certification agreement with the number 1173

SGS CEBEC hereby grants the right to use the CEBEC certification mark

The ENEC/CEBEC certification mark may be applied to the product as specified in this licence for the duration of the ENEC/CEBEC certification agreement and under the conditions of the ENEC/CEBEC certification agreement.

This licence is issued on: 09/10/2017


Ir. C. Lana,
Certification Manager

© Only integral publication of this certificate, including the annex, is allowed
This certificate is only valid combined with the publication on the following web address: www.sgs.com/ee



SGS Belgium NV-Division SGS CEBEC
Business Riverside Park
Bld Internationalelaan 55 Build. D
B-1070 Brussels
Tel.+32(0)2 556 00 20 Fax.+32(0)2 556 00 36

This certificate is issued by the company under its General Conditions for Certification Services accessible at http://www.sgs.com/terms_and_conditions.htm. Attention is drawn to the limitations of liability defined therein and in the Test Report herein mentioned which findings are reflected in this Certificate. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SPECIFICATION OF THE CERTIFIED PRODUCT

Product data

Product	:	road, square, street, flood lighting
Trade name(s)	:	SCHREDER
Type(s)/Model(s)	:	VOLTANA 1, VOLTANA 2, VOLTANA 3, VOLTANA 4, VOLTANA 5
description	:	Street lighting
rated voltage (Un)	:	120-240 V
rated frequency	:	50-60 Hz
rated secondary current (In SEC)	:	350, 500, 700, 1000 mA (LED)
class	:	class I
degree of protection	:	IP66
additional information	:	IK08

Product data - type VOLTANA 1

lamp(s)	:	8 LED's
rated ambient temperature (ta)	:	max. 55°C

Product data - type VOLTANA 2

lamp(s)	:	16 LED's
rated ambient temperature (ta)	:	max. 55°C

Product data - type VOLTANA 3

lamp(s)	:	24 LED's
rated ambient temperature (ta)	:	max. 55°C

Product data - type VOLTANA 4

lamp(s)	:	32 LED's
rated ambient temperature (ta)	:	max. 55°C

Product data - type VOLTANA 5

lamp(s)	:	64 LED's
rated ambient temperature (ta)	:	max. 55°C

TESTS

Test requirements

EN 60598-1:2015
EN 60598-2-3:2003 + A1:2011

Test results

The test results are laid down in certification file 618719/12.

Remarks

This certificate is based on test report No P1540-44-lb.


Conclusion

The examination proved that all test requirements were met.

Checked by, project leader : Christian Maes - 09/10/2017

Department Manager, :
Product Certification :

Certification Manager :

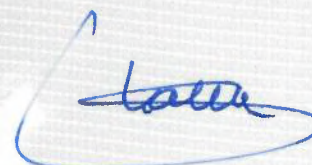 2017-10-09

FACTORY LOCATION(S)

Schröder do Brasil Iluminação Ltda.
Rua Iracema Lucas, 415
Distrito Industrial Vinhedo
13280-000 SAO PAULO
Brazil

Schreder TOV
Vul. Mykulynetska 46B
46000 TERNOPIL
Ukraine

Schreder (China) Lighting Industrial Co., Ltd
No.40 Xinye 2 Street, Tianjin Economic Technological Development Zone West Zone,
300462 Tianjin City, P.R.China
China

Socelec S.A.
Av. de Roanne, 66
Poligono Industrial "EL HENARES"
19180 MARCHAMALO (GUADALAJARA)
Spain

Schröder Iluminação S.A.
Rua da Fraternidade Operária, nº 3
2795-491 CARNAXIDE, OEIRAS
Portugal

Comatelec S.A.
Z.I.
18400 SAINT FLORENT S/CHER
France

Tungsram-Schröder Világítási Berendezések Zrt
Tópart 2
2084 PILISSZENTIVAN
Hungary

RTECH-PHOTOMETRY LABORATORY

Testreport : Measurement of luminous intensity distribution related to the standard
NBN-EN 13032-1; CIE 121-1996; IES LM-79-08 and procedures PT-P-01 and PT-P-02
rue de Mons, 3 B-4000 LIEGE - Tel : 04/224.71.40 - Fax : 04/224.25.90
Measurement for Schröder group.


LED

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102	
Source							
Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162		
Master		Reflector				No 5162	
Gaggione Led assembly Road lighting Assembled 0.0°							
Protector Refractor Lens							
Protector Glass Extra Clear Flat Smooth Lens Gaggione 5162 MS1002							
Laboratory observation							
VOLTANA 2 with 16 LG 3535 G4-L Used flux for efficiency matrix calculation = 2825 lm - CCT = 4057 K - CRI = 72.89 (see sphere test report 2016/374 on appendix).							
Purpose DOC				Sample date 13/06/2014		Sample # 34R142	
Observation							
DOC VOLTANA 2 with lenses 5162 MS1002							
Flux coefficient multiplicator (only for efficiency matrix): From 350 to 500 mA : 1,386 From 350 to 700 mA : 1,869 From 350 to 1000 mA : 2,535 From 350 to 1200mA : 2,944 From 350 to 1400mA : 3.322							
Fixture powered @350/500/700mA with 1 driver LG INNOTEK LLP 40W PISE A040D (dali) Fixture powered @1000mA with 1 driver LG INNOTEK LLP 55W 1A PISE A055A Fixture powered @1200/1400mA with DC powersupply Delta Electronica							
Asked by LME		Measured by FCE		Approved by LME		Appendix 1	
						226-TEST NBN EN ISO/IEC 17025 : 2005	
38909							

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No 5162
Matrices	389091 Φ 0-90° = 2334lm - 90-180° = 0lm					Absolute measurement
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002					
Observation	Matrix in total flux @350 mA Light losses due to thermal stabilisation : 0.6 % Electrical measurement on LED (#1) : Voltage = 44.35 V Current = 0.350 A Power = 15.58 W Electrical measurement on driver (#1) : Voltage = 230.00 V Current = 0.097 A Power = 19.60 W PF = 0.872 Total luminaire power = 19.60 W : Lm/Watt = 119.09 lm/W Driver #1 : See observations for driver details -					


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	2063	71	S				
90	962	20	D	750	25.0°	15/07/2016	
270	750	0	G				

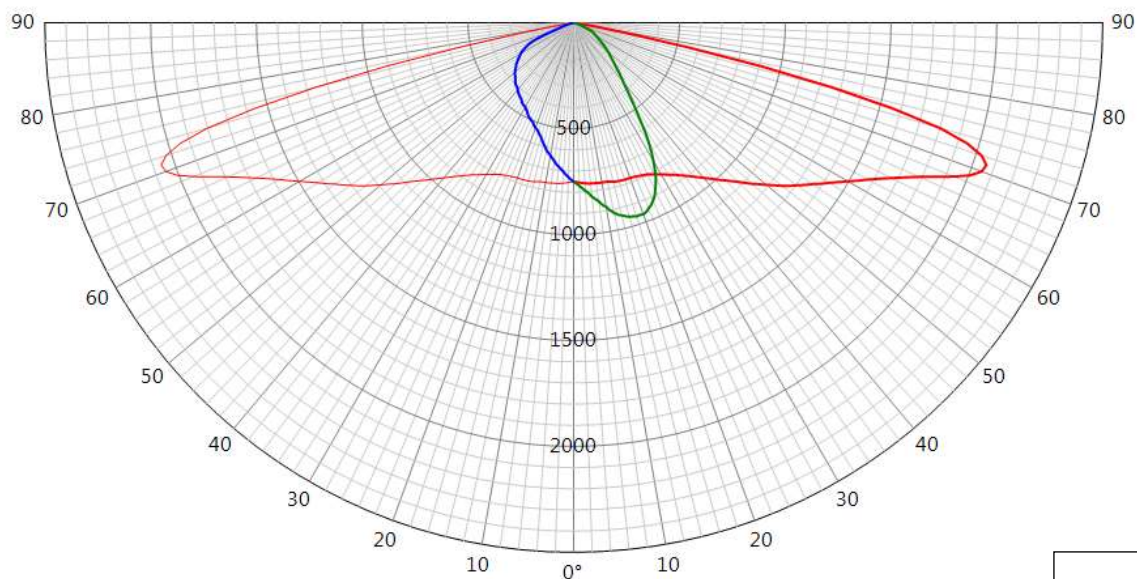**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No 5162
Matrices	389092 η 0-90° = 82.5% - 90-180° = 0.0%					Relative measurement
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002					
Observation	Matrix in efficiency @350 mA Light losses due to thermal stabilisation : 0.6 % Electrical measurement on LED (#1) : Voltage = 44.35 V Current = 0.350 A Power = 15.58 W Electrical measurement on driver (#1) : Voltage = 230.00 V Current = 0.097 A Power = 19.60 W PF = 0.872 Total luminaire power = 19.60 W Driver #1 : See observations for driver details -					


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	729	71	S				
90	340	20	D	265	25.0°	15/07/2016	
270	265	0	G				

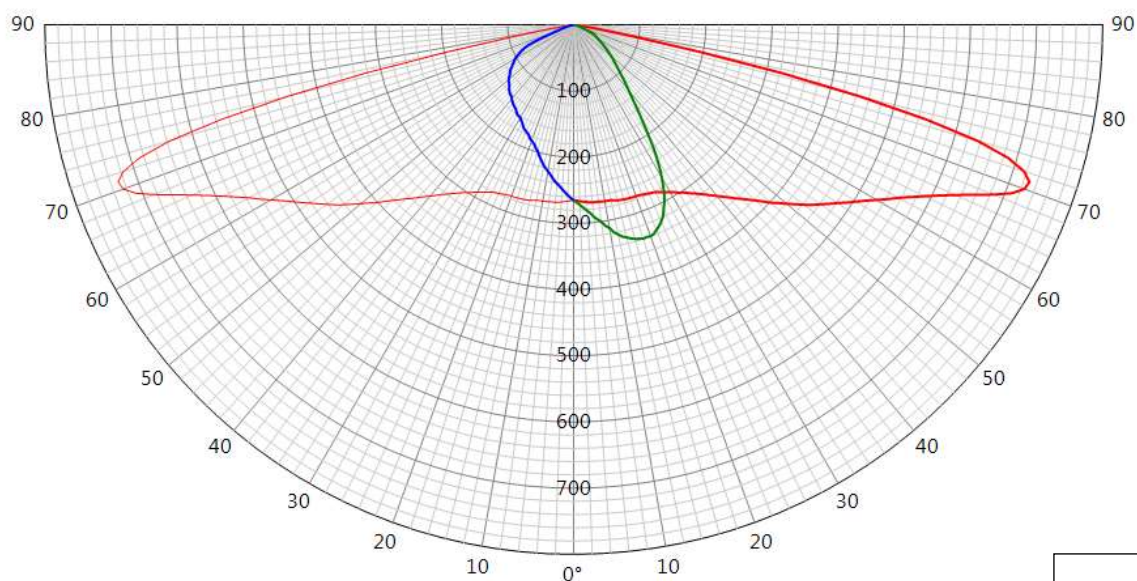**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No 5162
Matrices	389093 Φ 0-90° = 3235lm - 90-180° = 0lm					Absolute measurement
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002					
Observation	Matrix in total flux @500 mA Light losses due to thermal stabilisation : 0.9 % Electrical measurement on LED (#1) : Voltage = 44.89 V Current = 0.500 A Power = 22.44 W Electrical measurement on driver (#1) : Voltage = 230.00 V Current = 0.126 A Power = 26.90 W PF = 0.928 Total luminaire power = 26.90 W : Lm/Watt = 120.27 lm/W Driver #1 : See observations for driver details -					


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	2859	71	S				
90	1333	20	D	1039	25.0°	15/07/2016	
270	1039	0	G				

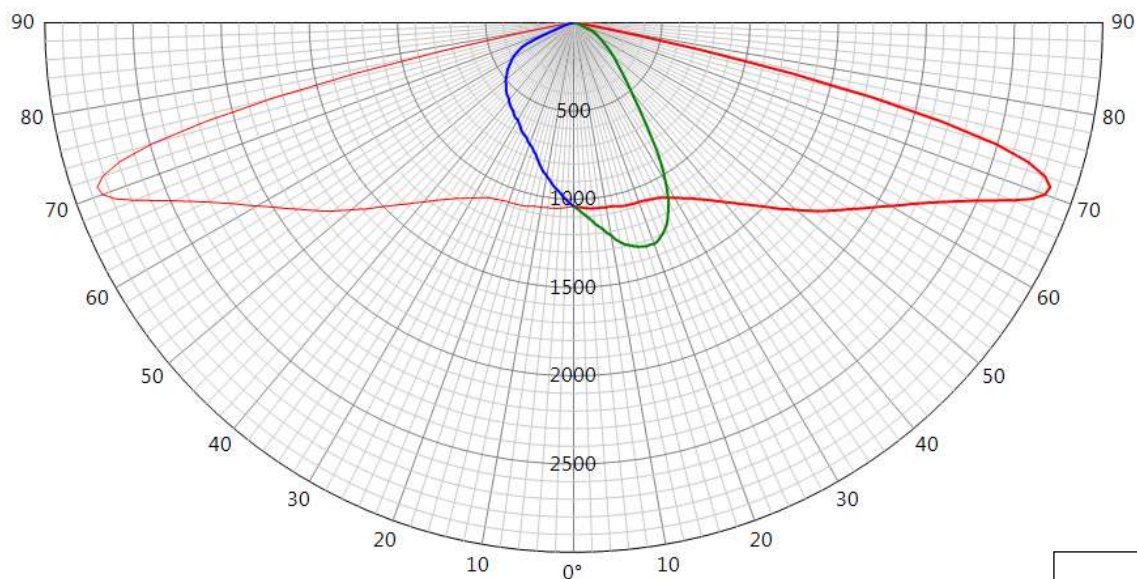**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102	
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162	
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No	5162
Matrices	389094 Φ 0-90° = 4363lm - 90-180° = 0lm					Absolute measurement	
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002						
Observation	Matrix in total flux @700 mA Light losses due to thermal stabilisation : 1.4 % Electrical measurement on LED (#1) : Voltage = 45.68 V Current = 0.700 A Power = 31.98 W Electrical measurement on driver (#1) : Voltage = 230.00 V Current = 0.168 A Power = 37.30 W PF = 0.961 Total luminaire power = 37.30 W : Lm/Watt = 116.96 lm/W Driver #1 : See observations for driver details -						


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	3855	71	S				
90	1797	20	D	1401	25.0°	15/07/2016	
270	1401	0	G				

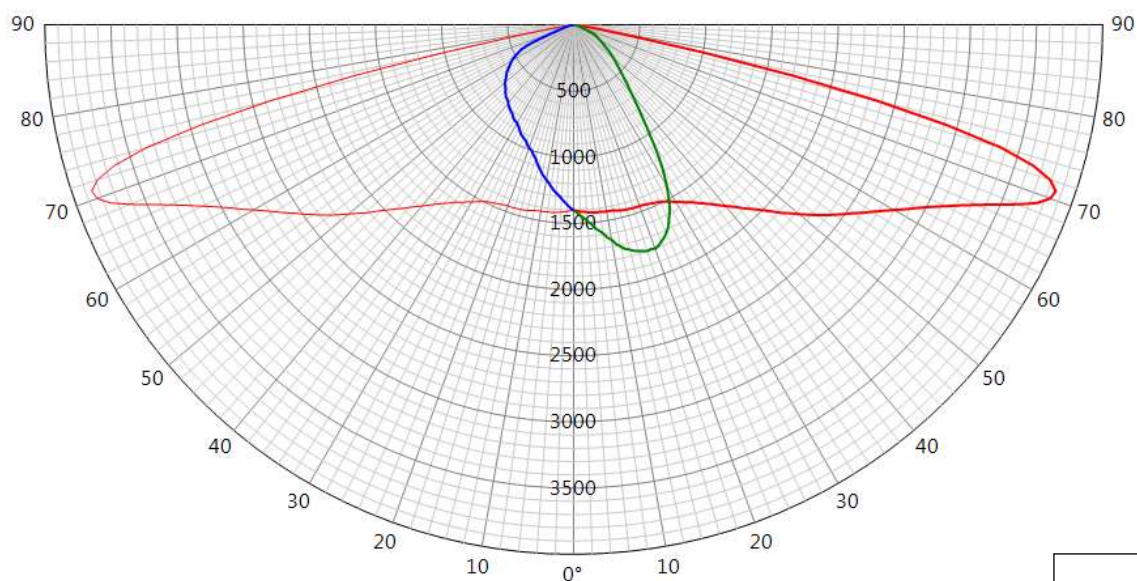**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No 5162
Matrices	389095 Φ 0-90° = 5917lm - 90-180° = 0lm					Absolute measurement
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002					
Observation	Matrix in total flux @1000 mA Light losses due to thermal stabilisation : 2 % Electrical measurement on LED (#1): Voltage = 46.37 V Current = 1.000 A Power = 46.51 W Electrical measurement on driver (#1): Voltage = 230.00 V Current = 0.241 A Power = 53.40 W PF = 0.962 Total luminaire power = 53.40 W : Lm/Watt = 110.81 lm/W Driver #1 : See observations for driver details -					


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	5229	71	S				
90	2438	20	D	1900	25.0°	20/07/2016	
270	1900	0	G				

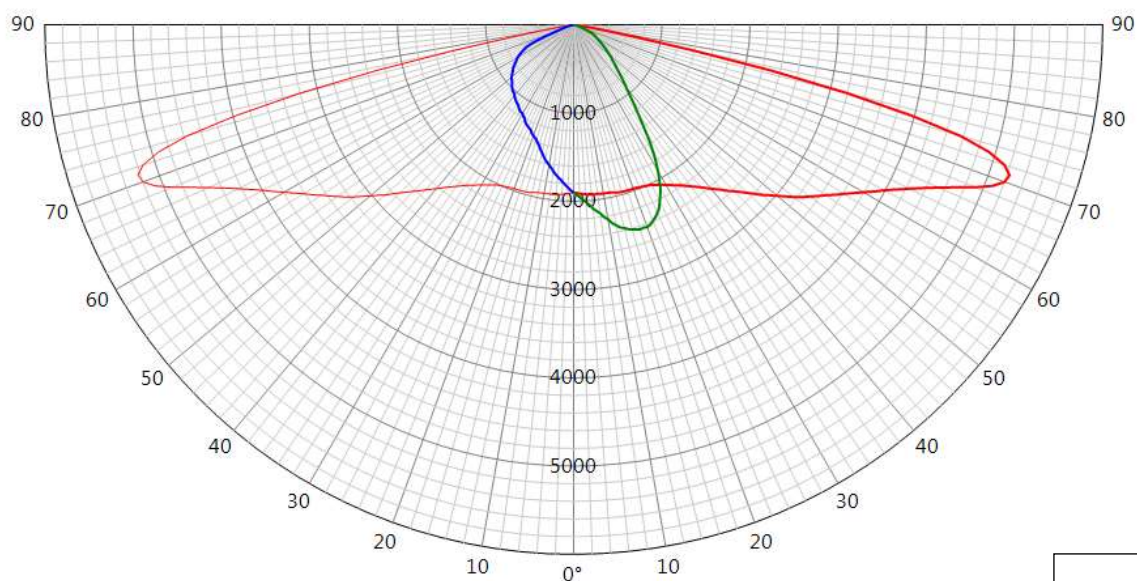**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102	
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162	
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No	5162
Matrices	389096 Φ 0-90° = 6872lm - 90-180° = 0lm					Absolute measurement	
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002						
Observation	Matrix in total flux @1200 mA Light losses due to thermal stabilisation : 3.4 % Electrical measurement on LED (#1) : Voltage = 47.43 V Current = 1.200 A Power = 56.95 W Driver #1 : See observations for driver details -						


Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	6072	71	S				
90	2831	20	D	2207	25.0°	20/07/2016	
270	2207	0	G				

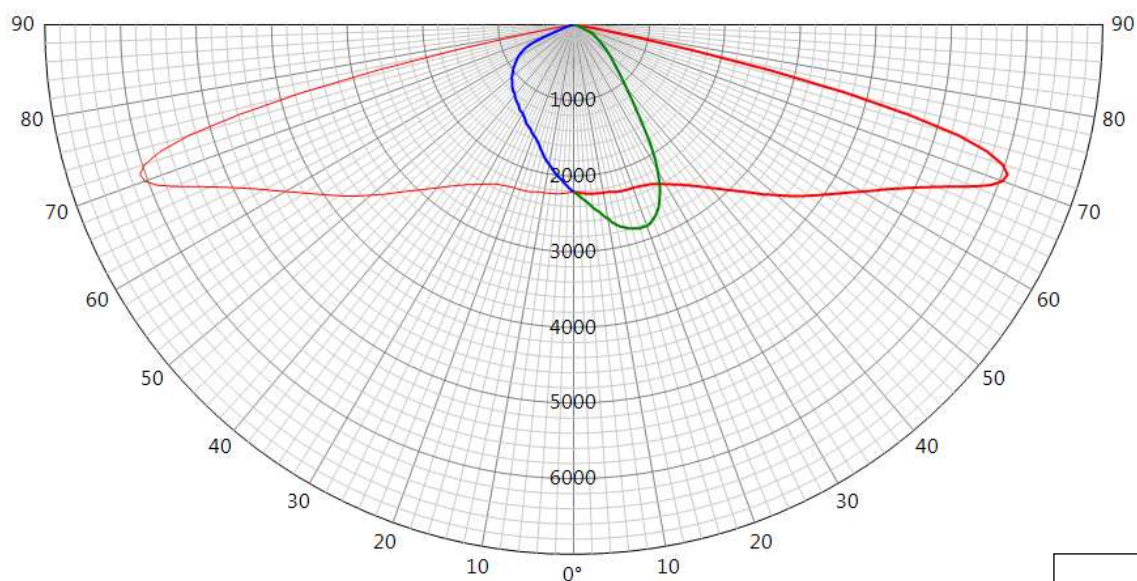**38909**

LUMINOUS INTENSITY DIAGRAM

Origin Tungsram-Schröder Plc. Hungary		Production Tungsram-Schröder Plc. Hungary		Luminaire VOLTANA 2		Request # FD36102	
Source	Type LED	BIN Unknown	Trademark LG Innotek	Reference 3535 G4L	# LEDs 16	Reflector 5162	
Reflector	Gaggione Led assembly Road lighting Assembled 0.0°					No	5162
Matrices	389097 Φ 0-90° = 7754lm - 90-180° = 0lm					Absolute measurement	
Protector Refractor Lens	Protector Glass Extra Clear Flat Smooth - VOLTANA 2 Lens 16 x Gaggione 5162 MS1002						
Observation	Matrix in total flux @1400 mA Light losses due to thermal stabilisation : 4.5 % Electrical measurement on LED (#1) : Voltage = 48.09 V Current = 1.400 A Power = 67.34 W Driver #1 : See observations for driver details -						

Plane	I Peak	Peak position	Index	I zero	Laboratory ambient t°	Measurement date	
10 - 170	6852	71	S				
90	3195	20	D	2490	25.0°	20/07/2016	
270	2490	0	G				

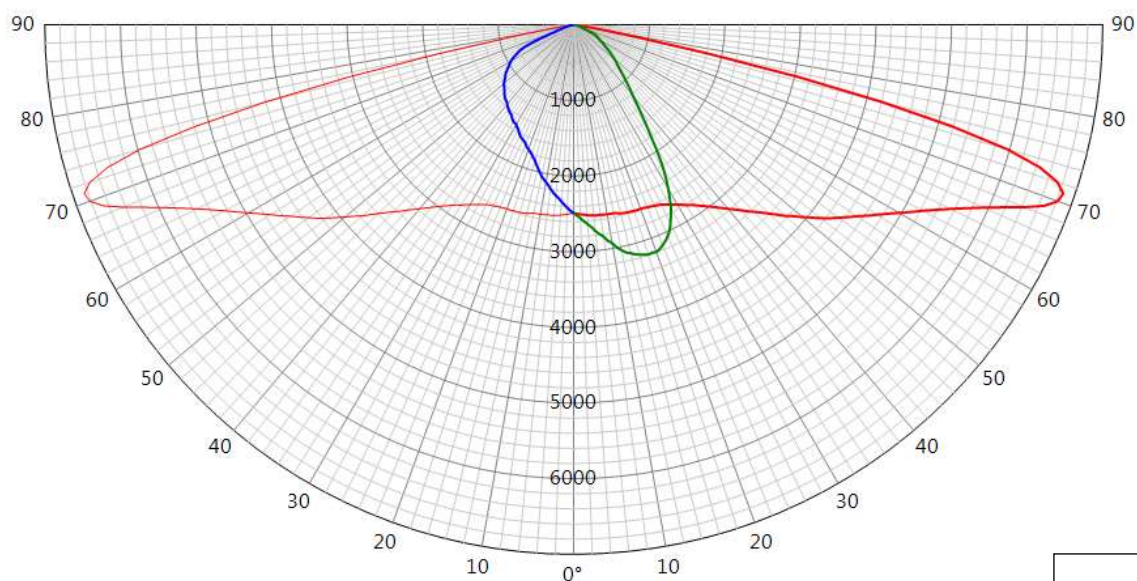**38909**

Measurement fulfil Standards:

- NBN-EN 13032-1
- NBN-EN 17025:2005
- CIE 121-1996
- LM79-08

Measurement quantities measured:

- Light distribution in relative or absolute photometry
- Led alone cold lumen package
- Led CCT and CRI
- Power consumption of the fitting
- Lm/watt

Electrical measurment, If not specified:

- Primary values are AC with 50Hz frequency
- Secondary values on SSL are DC

CCT, CRI and chromaticity coordinates: are Measured on sphere.
if specified Main test report refer to sphere extra test report.

Light distribution : are measured on gonio.

Number of hours operated prior to measurement: If no other specified, 0 hours (no aging)

Stabilization time: If no other specified, a minimal stabilization time of 1 hour is applied.

Total operating time of the product including stabilization:

45 minutes have to be added by measurement.

Minimal operating time is 105 minutes

Luminous intensity distribution: available on electronic file with

.mat format (internal schreder format)

.ldt format (European standard)

.IES format (American standard)

Statement of uncertainties (K=2 95% of confidence level):

Intensity measurement: +/- 3%

Angle: +/- 0.5°

Flux: +/- 2.5%

Electrical DC

Power: +/- 0.25%

Voltage: +/- 0.1%

Current: +/- 0.2%

Electrical AC

Power: +/- 0.1%

38909

Voltage: +/- 0.1%
Current: +/- 0.4%
Temperature: +/- 1.5%
CCT: +/- 5%
CRI: +/- 2%
x/y: +/- 2%

Measuring instruments in use:

Gonio

Type C with Moving mirror

Manufacturer: LMT Lichtmesstechnik GmbH Berlin, Helmholtzstrasse 9 10587 Berlin, Germany

Type: GO-DS 2000

Calibration: traceable to PTB (Physikalisch-Technische Bundesanstalt D-Braunschweig)

Photometric test distance : By default 10 meter, on request 30 meter.

Sphere n°1

4p geometry

Manufacturer: LMT Lichtmesstechnik GmbH, Helmholtzstrasse 9 10587 Berlin, Germany

Type: UL2000 + U1000 V-Lambda photometer

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

Sphere n°2

4p geometry

Manufacturer: Instrument Systems GmbH, Neumarkter Str. 83, 81673 Muenchen, Germany

Type: ISP2000 + Spectroradiometer CAS120 and CAS140

Calibration: traceable to NIST

Colorimetric portable spectroradiometer

Manufacturer: JETI Technische Instrumente GmbH, Tatzendpromenade 2 07745 Jena

Type: SPECBOS 1201

Calibration: traceable to NIST

Multimeters

Manufacturer: Agilent

Type: 34401A

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

Wattmeters

Manufacturer: Yokogawa

Type: WT210

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

Thermometers

Voltcraft K101 (Sphere IS2000)

LMT U1000 (Sphere LMT)

Gossen digem f96x48 CK/EK (gonio)

Calibration: traceable to PTB (Physikalisch-Technische Bundesanstalt)

38909

VOLTANA 2

5162

Optic	5162
Protector	Flat glass
Source	16 LG Innotek 3535 G4L
Matrix	389092



Characteristics

518	240	109	4.6	IP 66	IK 08	I EU, II EU	0.019
Length (mm)	Width (mm)	Height (mm)	Weight (kg)	Tightness level*	Impact resistance*	Electrical class*	CxS (m²)

* According to IEC-EN60598 and IEC-EN62262

Features

Entry Level cost-effective luminaire family

- Cost-effective and efficient lighting solution for a fast return on investment
- LensoFlex@2 photometric engine with photometry adapted to various applications
- 5 sizes for flexibility
- Designed to incorporate Owllet control and sensor solutions
- ThermiX@: withstands high temperatures (Ta 50°C)
- Mounting : side entry (42-60 mm) with inclination steps -10° to +5°
- Surge protection 10kV (optional)

Types of application

- Square and park
- Bridge
- Park
- Roundabout
- Car park
- Road and highway
- Residential road
- Bike path
- Urban road

Information for 1000 lm matrix

Efficacy (%)	82.5	G Class (EN 13201-2)	G3	Aperture 90-270°	X - X
DLOR (%)	82.5	G* (EN 13201 2015)	G*3	I 70-80-90-95 (cd)	725 - 55 - X - X
ULOR (%)	0.0	Imax (cd)	729		
UWLR (%)	0.0	Aperture 0-180°	64 - 64		

Photometrical characteristics

LED count	Colour code	Colour name	CCT	CRI	Current (mA)	Luminaire power (W)	Source flux (lm)	Luminaire output flux (lm)	Luminaire efficacy (lm/W)	Peak (cd)	BUG Rating	Voltage (V)
						Ambient temp = 25°						
16	NW	Neutral White	4000	70	350	19	2864	2362	124	2088	B1 U0 G1	230
16	NW	Neutral White	4000	70	500	27	3981	3284	122	2902	B1 U0 G1	230
16	NW	Neutral White	4000	70	700	38	5356	4418	116	3904	B1 U0 G1	230
16	NW	Neutral White	4000	70	1000	57	7246	5977	105	5282	B2 U0 G1	230
16	WW	Warm White	3000	80	350	19	2512	2072	109	1831	B1 U0 G1	230
16	WW	Warm White	3000	80	500	27	3492	2880	107	2545	B1 U0 G1	230
16	WW	Warm White	3000	80	700	38	4697	3875	102	3424	B1 U0 G1	230
16	WW	Warm White	3000	80	1000	57	6355	5242	92	4632	B2 U0 G1	230

Tolerance on flux +- 7% - Tolerance on power +- 5%

Summary

CONCEPT

Family of 6 road LED luminaires

Recommended installation height: between 4.00 and 12.00m

For optimal heat dissipation, the driver and LED engine are in separate compartments and juxtaposed in a horizontal section

HOUSING & FINISH

- Housing in high-pressure, die-cast aluminium, polyester powder coated
- Colour: RAL 7038

INSTALLATION

- Luminaire can be fixed by side-entry with a clamp, suitable for 42-60mm diameter
- Built-in inclination steps: -10°, -5°, 0°, 5°
- Post-top adapter diameter 48-60mm or 76mm, tightened with 2 stainless steel screws
- Direct access to the driver compartment with screws for easy maintenance on-site

OPTICAL UNIT

- Protected against lens degradation by 5mm thick extra-clear hardened glass
- Flatbed PCB with acrylic lens overlay principle
- Various photometric distributions: from narrow road to motorway, medium and large area
- CRI > 70
- ULOR: 0%

LED lumen depreciation

- Lifetime residual flux @ T_q=25°C @ 100.000 hrs: 350mA & 500mA: 90%; 700mA: 80%; 1A: 70%

ELECTRICAL

- Class I or Class II
- Input voltage: 120-277V - 50-60Hz
- Power factor > 90% at full load
- Surge protection: 4kV minimum (10kV + 10kA optional)
- Thermal protection on LED PCBA (see Thermix concept)

STANDARDS & CERTIFICATIONS


- CE
- ENEC
- LM79-80
- ROHS
- Certified for 3G vibration
- All measurements in ISO17025 accredited laboratory


OPTIONS

- Other RAL or AKZO colours
- Back Light control system
- OWLET remote management
- Custom dimming profile


VOLTANA 2 - 5162 - 16 LG Innotek 3535 G4L - Flat glass - 389092

- Photocell

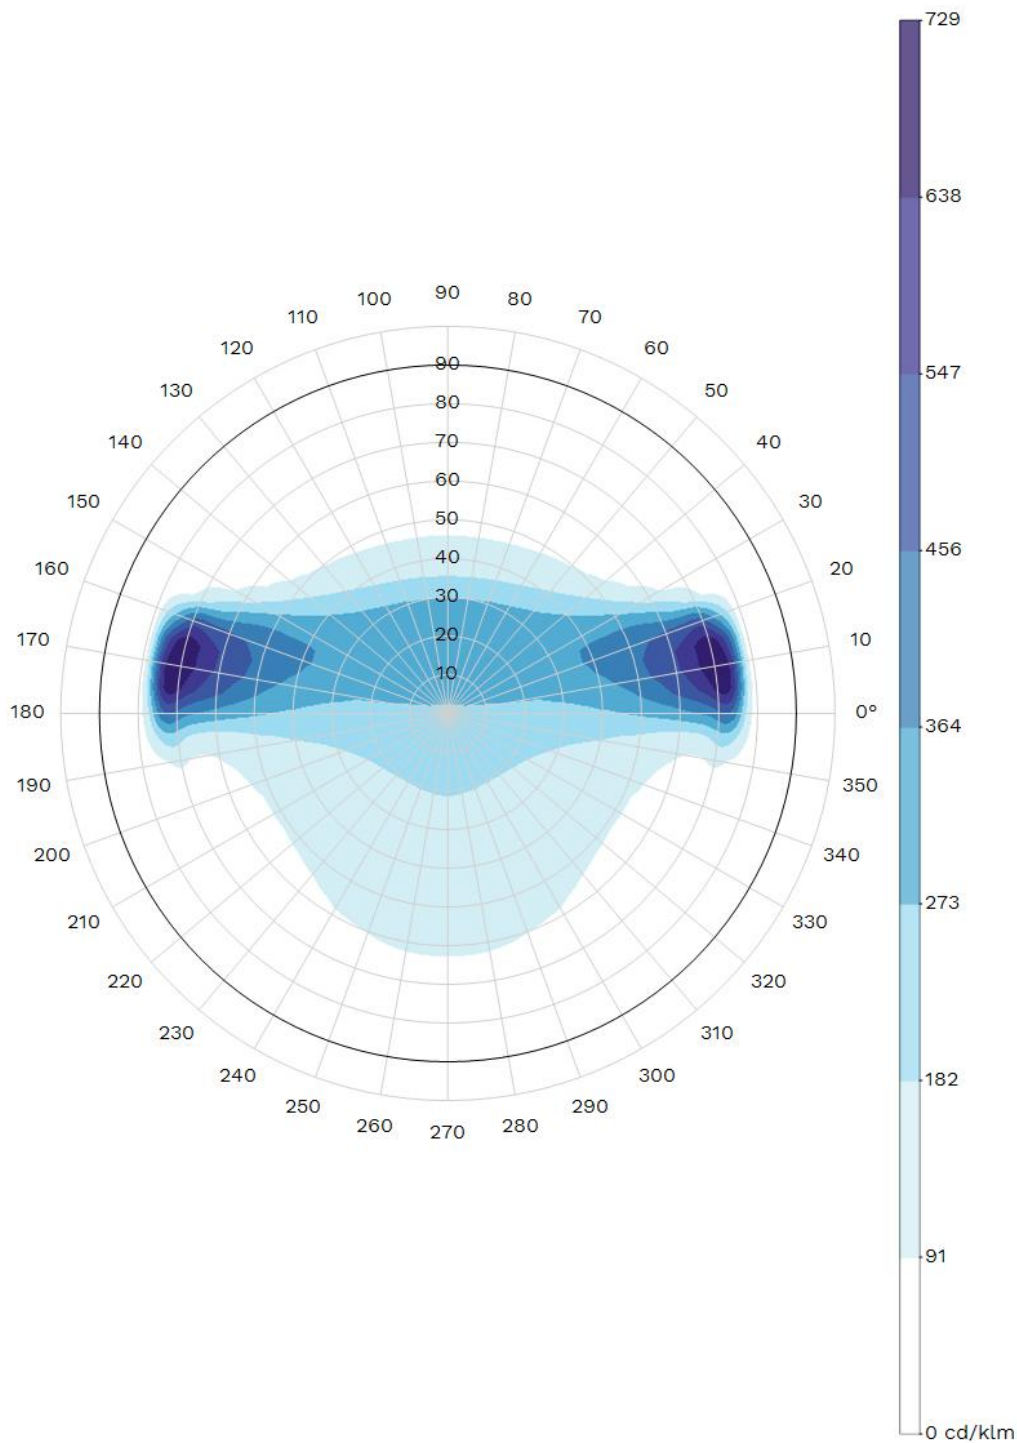


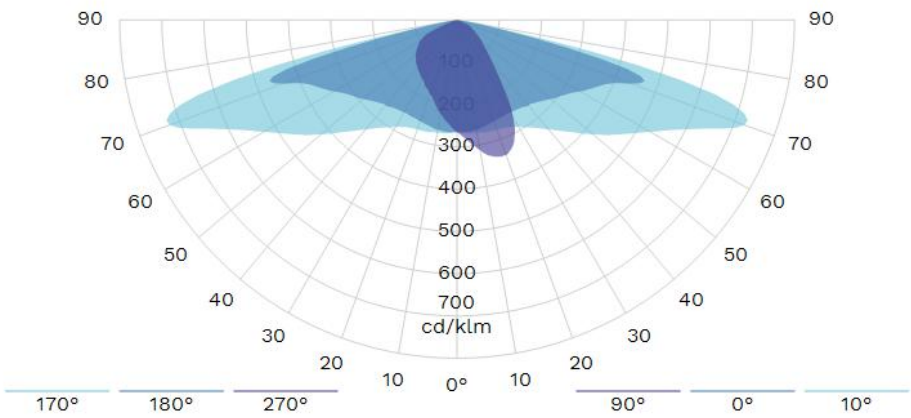


Isolux

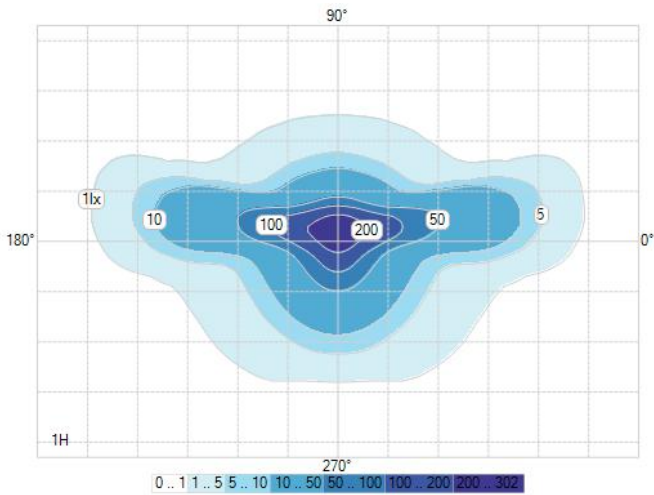

K-Curve

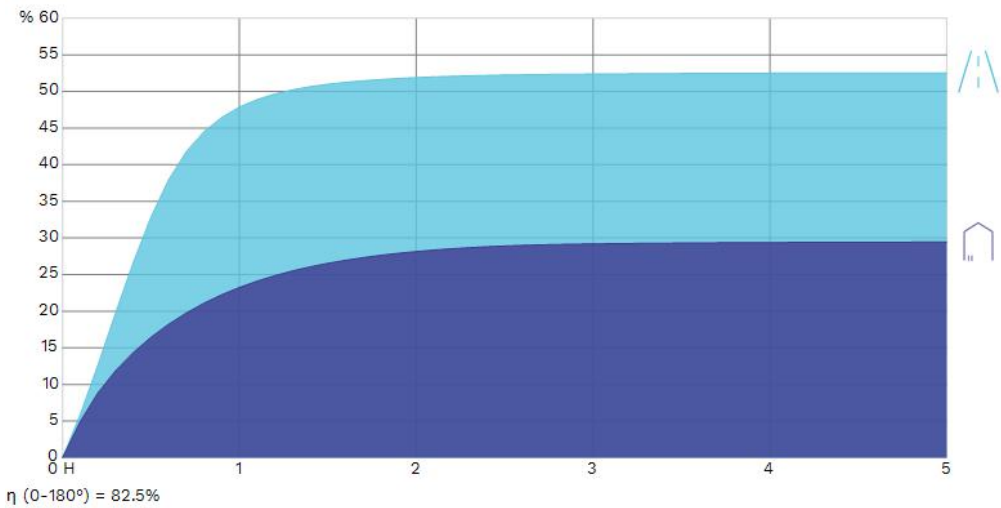


IES Roadway Classification / Nema Classification

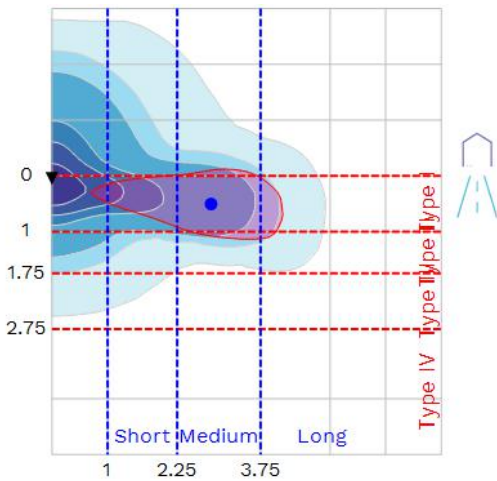


II - Medium

Luminaire classification system (LCS)

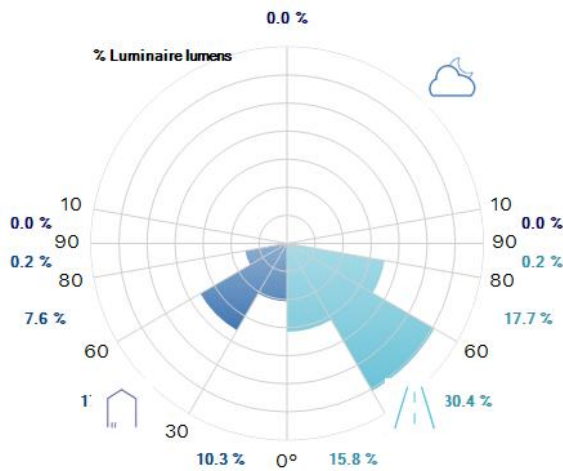

Intensity diagram in max Cone and in CPlane

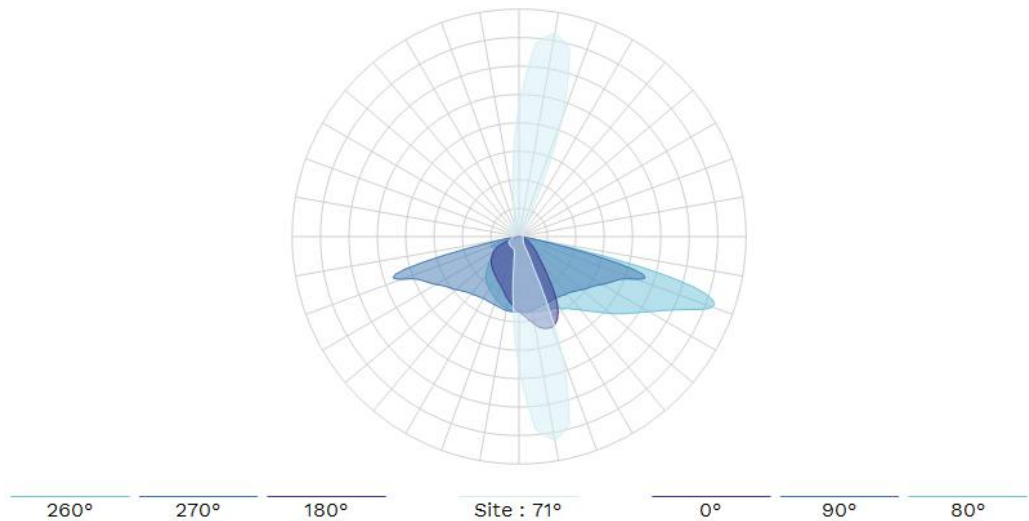

Copyright © 2018 Schröder SA. All rights reserved. Specifications are of an indicative nature and subject to change without notice.

<http://www.schreder.com>



Test Report issued under the responsibility of:



TEST REPORT
IEC 60598-2-3
Luminaires
Part 2: Particular requirements
Section 3: Luminaires for road and street lighting

Report Number.: P1540-44-IIb

Date of issue: 2017-10-09

Total number of pages: 49+2

Name of Testing Laboratory: SGS BELGIUM division SGS CEBEC
preparing the Report.....:

Applicant's name.....: R-TECH

Address: Rue de Mons, 3,B-4000 LIEGE

Test specification:

Standard: IEC 60598-2-3:2002 (Third Edition) + A1:2011 used in conjunction with IEC 60598-1:2014 (Eighth Edition)

Test procedure: CB Scheme

Non-standard test method.....: N/A

Test Report Form No.....: IEC60598_2_3J

Test Report Form(s) Originator.....: Intertek Semko AB

Master TRF.....: 2014-09

Copyright © 2014 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.

This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.


Test item description	Street lighting
Trade Mark	SCHREDER
Manufacturer	SCHREDER
Model/Type reference.....	VOLTANA 1, VOLTANA 2, VOLTANA 3, VOLTANA 4 & VOLTANA 5.
Ratings	120-240 V, 50-60 Hz, Cl. II , IP66, LED, IK08 Version with 64, 32, 24, 16, 8 led's Led: 350-500-700-1000 mA

Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
☐	CB Testing Laboratory:	
Testing location/ address.....:		
☐	Associated CB Testing Laboratory:	
Testing location/ address.....:		
Tested by (name, function, signature).....:		
Approved by (name, function, signature)....:		
☐	Testing procedure: TMP/CTF Stage 1:	
Testing location/ address.....:		
Tested by (name, function, signature).....:		
Approved by (name, function, signature)....:		
☐	Testing procedure: WMT/CTF Stage 2:	
Testing location/ address.....:		R-TECH, Rue de Mons, 3,B-4000 LIEGE
Tested by (name + signature)		Marc Abry 
Witnessed by (name, function, signature) .:		Christian Maes 
Approved by (name, function, signature)....:		Laurent Maghe 
☒	Testing procedure: SMT/CTF Stage 3 or 4:	R-Tech
Testing location/ address.....:		
Tested by (name, function, signature).....:		
Witnessed by (name, function, signature) .:		
Approved by (name, function, signature)....:		
Supervised by (name, function, signature) :		

List of Attachments (including a total number of pages in each attachment): Report integrated ledmodule EU deviations Pictures Instructions	
Summary of testing: full test	
Tests performed (name of test and test clause): IEC 60598-2-3:2002 (Third Edition) + A1:2011 used in conjunction with IEC 60598-1:2014 (Eighth Edition)	Testing location: R-tech sa Rue de Mons, 3 B-4000 LIEGE Belgium.
Summary of compliance with National Differences: Europe List of countries addressed ☒ The product fulfils the requirements of IEC 60598-2-3: 2002 (third Edition) + A1:2011 used in conjunction with IEC 60598-1: 2014 (Eighth Edition). EN 60598-2-3: 2003 + A1:2011 used in conjunction with EN 60598-1:2015	

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

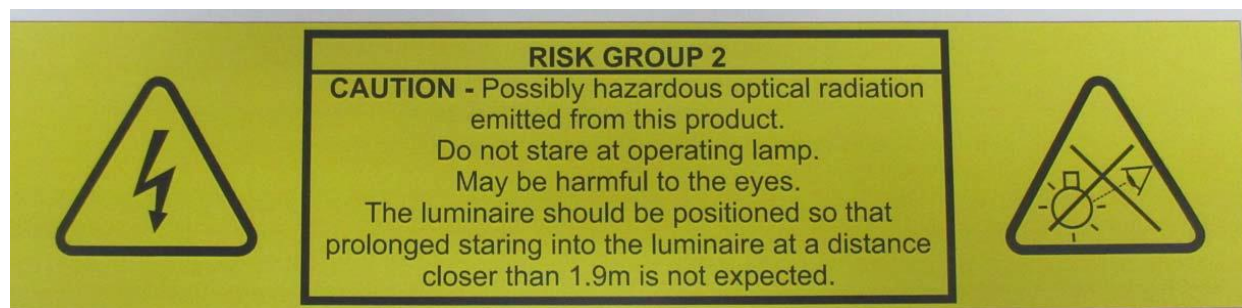

Test item particulars:	
Classification of installation and use:	
Supply Connection	
.....:	
Possible test case verdicts:	
- test case does not apply to the test object.....: N/A	
- test object does meet the requirement.....: P (Pass)	
- test object does not meet the requirement.....: F (Fail)	
Testing:	
Date of receipt of test item: September 2017	
Date (s) of performance of tests: September 2017	
General remarks:	
"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Throughout this report a ☐ comma / ☐ point is used as the decimal separator. Drivers Meanwell PLM-12(E)-350 has been added based on report P1540-44-II.	
Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60598-2:	
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided:	☒ Yes ☐ Not applicable
When differences exist; they shall be identified in the General product information section.	
Name and address of factory (ies)	
Comatelec S.A. Z.I. F-18400 SAINT FLORENT S/CHER France	Socelec S.A. Av. de Roanne, 66 Poligono Industrial "EL HENARES" 19180 MARCHAMALO (GUADALAJARA), Spain
Schröder Iluminação S.A. Apartado, 132 2790-076 CARNAXIDE, Portugal	Schröder do Brasil Iluminação Ltda. Rua Iracema Lucas, 415 Distrito Industrial Vinhedo 13280-000 SAO PAULO, Brazil
Schreder TOV Vul. Mykulynetska 46B 46000 TERNOPIL, Ukraine	Schreder (China) Lighting Industrial Co., Ltd No.40 Xinye 2 Street, Tianjin Economic Technological Development Zone West Zone, 300462 Tianjin City, P.R.China, China
Tungsram-Schröder Világítási Berendezések Zrt Tópart 2 2084 PILISSZENTIVAN, Hungary	

General product information:

Ta following drivers in use :

	Current (mA)	Ta Philips (°C)	Ta LG (°C)
Vol1	350	/*	55
	500	/*	55
	700	/*	55
	1000	/*	45
Vol2	350	40	55
	500	40	55
	700	40	55
	1000	/*	50
Vol3	350	55	55
	500	55	55
	700	55	55
	1000	35	45
Vol4	350	55	55
	500	50	55
	700	50	55
	1000	40	35
Vol5	350	50	55
	500	50	55
	700	50	45
	1000	40	35
* no Philips drivers available			

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

3.2 (0)	GENERAL TEST REQUIREMENTS		P
3.2 (0.1)	Information for luminaire design considered	Standard Yes ☒ No ☐	—
3.2 (0.3)	More sections applicable	Yes ☐ No ☒	—

3.4 (2)	CLASSIFICATION		P
3.4 (2.2)	Type of protection	Class II	—
3.4 (2.3)	Degree of protection.....	IP 66 (without external cable)	—
3.4 (2.4)	Luminaire suitable for direct mounting on normally flammable surfaces	Yes ☒ No ☐	—
3.4 (2.5)	Luminaire for normal use	Yes ☒ No ☐	—
	Luminaire for rough service	Yes ☐ No ☒	—
3.4 (-)	Modes of installation of road or street lighting		—
	a) on a pipe	Yes ☒ No ☐	—
	b) on a mast arm	Yes ☒ No ☐	—
	c) on a post top	Yes ☒ No ☐	—
	d) on span or suspension wires	Yes ☐ No ☒	—
	e) on a wall	Yes ☐ No ☒	—

3.5 (3)	MARKING		
3.5 (3.2)	Mandatory markings		P
	Position of the marking		P
	Format of symbols/text		P
3.5 (3.3)	Additional information		P
	Language of instructions		P
3.5 (3.3.1)	Combination luminaires		N/A
3.5 (3.3.2)	Nominal frequency in Hz	50-60 Hz	P
3.5 (3.3.3)	Operating temperature		N/A
3.5 (3.3.4)	Symbol or warning notice		N/A
3.5 (3.3.5)	Wiring diagram		N/A
3.5 (3.3.6)	Special conditions		N/A
3.5 (3.3.7)	Metal halide lamp luminaire – warning		N/A
3.5 (3.3.8)	Limitation for semi-luminaires		N/A
3.5 (3.3.9)	Power factor and supply current	0.91	P

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.5 (3.3.10)	Suitability for use indoors		N/A
3.5 (3.3.11)	Luminaires with remote control		N/A
3.5 (3.3.12)	Clip-mounted luminaire – warning		N/A
3.5 (3.3.13)	Specifications of protective shields		N/A
3.5 (3.3.14)	Symbol for nature of supply		N/A
3.5 (3.3.15)	Rated current of socket outlet		N/A
3.5 (3.3.16)	Rough service luminaire		N/A
3.5 (3.3.17)	Mounting instruction for type Y, type Z and some type X attachments		P
3.5 (3.3.18)	Non-ordinary luminaires with PVC cable		N/A
3.5 (3.3.19)	Protective conductor current in instruction if applicable		N/A
3.5 (3.3.20)	Provided with information if not intended to be mounted within arm's reach		N/A
3.5 (3.3.21)	Non-replaceable and non-user replaceable light sources information provided		P
	Cautionary symbol		P
3.5 (3.3.22)	Controllable luminaires, classification of insulation provided		N/A
3.5 (3.4)	Test with water		P
	Test with hexane		P
	Legible after test		P
	Label attached		P
3.5 (-)	Additional information in instruction leaflet		
	a) Design attitude	See attached Installation Notice	P
	b) Weight	See attached Installation Notice	P
	c) Overall dimensions	See attached Installation Notice	P
	d) Maximum projected area if applicable	See attached Installation Notice	P
	e) Cross-sectional area of wires if applicable		N/A
	f) Suitability for indoors use		N/A
	g) Dimensions of the compartment		N/A
	h) Torque setting to be applied to bolts or screws	See attached Installation Notice	P
	i) Maximum mounting height	>6 m	P

3.6 (4)	CONSTRUCTION		
3.6 (4.2)	Components replaceable without difficulty		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.6 (4.3)	Wireways smooth and free from sharp edges		P
3.6 (4.4)	Lampholders		
3.6 (4.4.1)	Integral lampholder		N/A
3.6 (4.4.2)	Wiring connection		N/A
3.6 (4.4.3)	Lampholder for end-to-end mounting		N/A
3.6 (4.4.4)	Positioning		N/A
	- pressure test (N)		—
	After test the lampholder comply with relevant standard sheets and show no damage		N/A
	After test on single-capped lampholder the lampholder have not moved from its position and show no permanent deformation		N/A
	- bending test (N)		—
	After test the lampholder have not moved from its position and show no permanent deformation		N/A
3.6 (4.4.5)	Peak pulse voltage		N/A
3.6 (4.4.6)	Centre contact		N/A
3.6 (4.4.7)	Parts in rough service luminaires resistant to tracking		N/A
3.6 (4.4.8)	Lamp connectors		N/A
3.6 (4.4.9)	Caps and bases correctly used		N/A
3.6 (4.4.10)	Light source for lampholder or connection according IEC 60061 not connected another way		N/A
3.6 (4.5)	Starter holders		
	Starter holder in luminaires other than class II		N/A
	Starter holder class II construction		N/A
3.6 (4.6)	Terminal blocks		
	Tails	Provided with internal connector	N/A
	Unsecured blocks	Fixed	N/A
3.6 (4.7)	Terminals and supply connections		
3.6 (4.7.1)	Contact to metal parts		P
3.6 (4.7.2)	Test 8 mm live conductor		P
	Test 8 mm earth conductor		P
3.6 (4.7.3)	Terminals for supply conductors		P
3.6 (4.7.3.1)	Welded method and material		
	- stranded or solid conductor		N/A
	- spot welding		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- welding between wires		N/A
	- Type Z attachment		N/A
	- mechanical test according to 15.8.2		N/A
	- electrical test according to 15.9		N/A
	- heat test according to 15.9.2.3 and 15.9.2.4		N/A
3.6 (4.7.4)	Terminals other than supply connection		N/A
3.6 (4.7.5)	Heat-resistant wiring/sleeves		N/A
3.6 (4.7.6)	Multi-pole plug		N/A
	- test at 30 N		N/A
3.6 (4.8)	Switches		
	- adequate rating		N/A
	- adequate fixing		N/A
	- polarized supply		N/A
	- compliance with IEC 61058-1 for electronic switches		N/A
3.6 (4.9)	Insulating lining and sleeves		
3.6 (4.9.1)	Retainment		N/A
	Method of fixing :		—
3.6 (4.9.2)	Insulated linings and sleeves:		
	Resistant to a temperature > 20 °C to the wire temperature or		N/A
	a) & c) Insulation resistance and electric strength		N/A
	b) Ageing test. Temperature (°C) :		N/A
3.6 (4.10)	Double or reinforced insulation		
3.6 (4.10.1)	No contact, mounting surface – accessible metal parts – wiring of basic insulation		N/A
	Safe installation fixed luminaires		N/A
	Capacitors and switches		N/A
	Interference suppression capacitors according to IEC 60384-14		N/A
3.6 (4.10.2)	Assembly gaps:		
	- not coincidental		N/A
	- no straight access with test probe		N/A
3.6 (4.10.3)	Retainment of insulation:		
	- fixed		N/A
	- unable to be replaced; luminaire inoperative		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- sleeves retained in position		N/A
	- lining in lampholder		N/A
3.6 (4.11)	Electrical connections and current-carrying parts		
3.6 (4.11.1)	Contact pressure		P
3.6 (4.11.2)	Screws:		
	- self-tapping screws		N/A
	- thread-cutting screws		N/A
3.6 (4.11.3)	Screw locking:		
	- spring washer		P
	- rivets		N/A
3.6 (4.11.4)	Material of current-carrying parts		P
3.6 (4.11.5)	No contact to wood or mounting surface		P
3.6 (4.11.6)	Electro-mechanical contact systems		N/A
3.6 (4.12)	Screws and connections (mechanical) and glands		
3.6 (4.12.1)	Screws not made of soft metal		P
	Screws of insulating material		N/A
	Torque test: torque (Nm); part..... : 2Nm (case)		P
	Torque test: torque (Nm); part..... : 1.2Nm (drivers)		N/A
	Torque test: torque (Nm); part..... : 1.2Nm (glass)		N/A
3.6 (4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
3.6 (4.12.4)	Locked connections:		
	- fixed arms; torque (Nm) :		P
	- lampholder; torque (Nm) :		N/A
	- push-button switches; torque 0,8 Nm :		N/A
3.6 (4.12.5)	Screwed glands; force (Nm)..... :		P
3.6 (4.13)	Mechanical strength		
3.6 (4.13.1)	Impact tests:		P
	- fragile parts; energy (Nm) : 0,5 Nm		P
	- other parts; energy (Nm) : 0,7 Nm		P
	1) live parts		P
	2) linings		P
	3) protection		P
	4) covers		P
3.6 (4.13.3)	Straight test finger		P
3.6 (4.13.4)	Rough service luminaires		

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- IP54 or higher		N/A
	a) fixed		N/A
	b) hand-held		N/A
	c) delivered with a stand		N/A
	d) for temporary installations and suitable for mounting on a stand		N/A
3.6 (4.13.6)	Tumbling barrel		N/A
3.6 (4.14)	Suspensions, fixings and means of adjusting		
3.6 (4.14.1)	Mechanical load:		
	A) four times the weight		N/A
	B) torque 2,5 Nm		P
	C) bracket arm; bending moment (Nm)..... :		N/A
	D) load track-mounted luminaires		N/A
	E) clip-mounted luminaires, glass-shelve. Thickness (mm)		N/A
	Metal rod. diameter (mm)		N/A
	Fixed luminaire or independent control gear without fixing devices		N/A
3.6 (4.14.2)	Load to flexible cables		N/A
	Mass (kg)		—
	Stress in conductors (N/mm ²)		N/A
	Mass (kg) of semi-luminaire		—
	Bending moment (Nm) of semi-luminaire		N/A
3.6 (4.14.3)	Adjusting devices:		
	- flexing test; number of cycles..... :		N/A
	- strands broken		N/A
	- electric strength test afterwards		N/A
3.6 (4.14.4)	Telescopic tubes: cords not fixed to tube; no strain on conductors		N/A
3.6 (4.14.5)	Guide pulleys		N/A
3.6 (4.14.6)	Strain on socket-outlets		N/A
3.6 (4.15)	Flammable materials		
	- glow-wire test 650°C	See Test Table 3.15 (13.3.2)	N/A
	- spacing ≥30 mm		N/A
	- screen withstanding test of 13.3.1		N/A
	- screen dimensions		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- no fiercely burning material		P
	- thermal protection		N/A
	- electronic circuits exempted		N/A
3.6 (4.15.2)	Luminaires made of thermoplastic material with lamp control gear		
	a) construction		P
	b) temperature sensing control	110	P
	c) surface temperature		N/A
3.6 (4.16)	Luminaires for mounting on normally flammable surfaces		
	No lamp control gear : (compliance with Section 12)		N/A
3.6 (4.16.1)	Lamp control gear spacing:		
	- spacing 35 mm		N/A
	- spacing 10 mm		N/A
3.6 (4.16.2)	Thermal protection:		
	- in lamp control gear		N/A
	- external		N/A
	- fixed position		N/A
	- temperature marked lamp control gear		P
3.6 (4.16.3)	Design to satisfy the test of 12.6	(see clause 12.6)	P
3.6 (4.17)	Drain holes		
	Clearance at least 5 mm		N/A
3.6 (4.18)	Resistance to corrosion		
3.6 (4.18.1)	- rust-resistance		P
3.6 (4.18.2)	- season cracking in copper		P
3.6 (4.18.3)	- corrosion of aluminium		P
3.6 (4.19)	Igniters compatible with ballast		N/A
3.6 (4.20)	Rough service vibration		N/A
3.6 (4.21)	Protective shield		
3.6 (4.21.1)	Shield fitted if tungsten halogen lamps or metal halide lamps		N/A
	Shield of glass if tungsten halogen lamps		N/A
3.6 (4.21.2)	Particles from a shattering lamp not impair safety		N/A
3.6 (4.21.3)	No direct path		N/A
3.6 (4.21.4)	Impact test on shield		N/A
	Glow-wire test on lamp compartment..... : See Test Table 3.15 (13.3.2)		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.6 (4.22)	Attachments to lamps not cause overheating or damage		N/A
3.6 (4.23)	Semi-luminaires comply Class II		N/A
3.6 (4.24)	Photobiological hazards		
3.6 (4.24.1)	No excessive UV radiation if tungsten halogen lamps and metal halide lamps (Annex P)		P
3.6 (4.24.2)	Retinal blue light hazard		
	Luminaires with E_{thr} :		
	a) Fixed luminaires		P
	- distance x m, borderline between RG1 and RG2 ... :	RG1@400mm	P
	- marking and instruction according 3.2.23		P
	b) Portable and handheld luminaires		
	- marking according 3.2.23 if RG1 exceeded at 200 mm according to IEC/TR 62778		N/A
	Portable luminaires for children IEC 60598-2-10 and Mains socket outlet nightlights IEC 60598-2-12 not exceed RG1 at 200 mm according to IEC/62778		N/A
3.6 (4.25)	Mechanical hazard		
	No sharp point or edges		P
3.6 (4.26)	Short-circuit protection		
3.6 (4.26.1)	Adequate means of uninsulated accessible SELV parts		N/A
3.6 (4.26.2)	Short-circuit test with test chain according 4.26.3		N/A
	Test chain not melt through		N/A
	Test sample not exceed values of Table 12.1 and 12.2		N/A
3.6 (4.27)	Terminal blocks with integrated screwless earthing contacts		
	Test according Annex V		N/A
	Pull test of terminal fixing (20 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Pull test of mechanical connection (50 N)		N/A
	After test, resistance < 0,05 Ω		N/A
	Voltage drop test, resistance < 0,05 Ω		N/A
3.6 (4.28)	Fixing of thermal sensing control		
	Not plug-in or easily replaceable type		N/A
	Reliably kept in position		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	No adhesive fixing if UV radiations from a lamp can degrade the fixing		N/A
	Not outside the luminaire enclosure		N/A
	Test of adhesive fixing:		N/A
	Max. temperature on adhesive material (°C) :		—
	100 cycles between t min and t max		N/A
	Temperature sensing control still in position		N/A
3.6 (4.29)	Luminaires with non-replaceable light source		
	Not possible to replace light source		N/A
	Live part not accessible after parts have been opened by hand or tools		N/A
3.6 (4.30)	Luminaires with non-user replaceable light source		
	If protective cover provide protection against electric shock and marked with “caution, electric shock risk” symbol:		P
	Minimum two fixing means		P
3.6 (4.31)	Insulation between circuits		
	Circuits insulated from LV supply fulfil requirements according 4.31.1 – 4.31.3	SELV/IEC 61347-2-13	P
	Controllable luminaires requiring same level of insulation for all components, the insulation between control terminals and LV supply fulfil requirements according 4.31.1 – 4.31.3		N/A
3.6 (4.31.1)	SELV circuits		P
	Used SELV source		P
	Voltage ≤ ELV		P
	Insulating of SELV circuits from LV supply	Double/reinforced	P
	Insulating of SELV circuits from other non SELV circuits		N/A
	Insulating of SELV circuits from FELV		N/A
	Insulating of SELV circuits from other SELV circuits		N/A
	SELV circuits insulated from accessible parts according Table X.1		P
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Plugs and socket-outlets does not have protective conductor contact		N/A
3.6 (4.31.2)	FELV circuits		

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	Used FELV source		N/A
	Voltage $\leq$ ELV		N/A
	Insulating of FELV circuits from LV supply		N/A
	FELV circuits insulated from accessible parts according Table X.1		N/A
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Socket-outlets does not have protective conductor contact		N/A
3.6 (4.31.3)	Other circuits		
	Other circuits insulated from accessible parts according Table X.1		N/A
	Class II construction with equipotential bonding for protection against indirect contacts with live parts:		
	- conductive parts are connected together		N/A
	- test according 7.2.3 of above		N/A
	- conductive part not cause an electric shock in case of an insulation fault		N/A
	- equipotential bonding in master/slave applications		N/A
	- master luminaire provided with terminal for accessible conductive parts of slave luminaires		N/A
	- slave luminaire constructed as class I		N/A
3.6 (4.32)	Overvoltage protective devices		
	Comply with IEC 61643-11	CB	P
	External to controlgear and connected to earth:		
	- only in fixed luminaires		P
	- only connected to protective earth		P
3.6.1 (-)	At least IP X3 or X5 respectively. IP	IP66	P
	Column-integrated luminaires:		
	- parts below 2,5 m. IP		N/A
	- parts above 2,5 m. IP		N/A
3.6.2 (-)	Suspension on span wires		N/A
3.6.3 (-)	Means for attaching the luminaire or external parts to its support appropriate to the weight		P
3.6.3.1 (-)	Static load test		
	- drag coefficient.....	1.225Kg/m ³	P

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- loaded area (m ²).....:	0.34m ²	P
	- used load (N).....:	675.7N	P
	- measured deformation (cm/m)	1.2cm/m	P
	- no rotation		P
3.6.4 (-)	Adjustable lampholders		N/A
3.6.5 (-)	Luminaires installed above 5 m, glass covers shall be:		
	a) glass that fractures into small pieces (test according to 3.6.5.1), or	Safety Glass	P
	b) glass having a high impact shock resistance (test according to 3.6.5.2), or		P
	c) protected by any means to retain glass fragments		N/A
	For tunnel luminaires 3.6.5.1 apply		N/A
	Method of protection declared by the manufacturer		N/A
3.6.5.1 (-)	Protection by the use of glass that fractures into small pieces		P
	- number of particles is more than 40.....:	52	P
3.6.5.2 (-)	Protection by the use of high impact resistant glass		P
3.6.5.2.1 (-)	Glass covers have high mechanical strength		P
	Test according IEC 62262 with test apparatus according IEC 60068-2-75 with impact energy of 5J on preconditioned sample	IK08	P
3.6.5.2.2 (-)	Glass covers not break into large pieces		P
	- test according 3.6.5.1, number of particles is more than 20	48	P
3.6.6 (-)	Connection compartment of column-integrated luminaire		
	- provides adequate space		N/A
	- means for attachment		N/A
	- means for attachment of metal corrosion-resistant		N/A
3.6.7 (-)	Compliance with ISO standard or other		N/A
3.6.8 (-)	Doors of column-integrated luminaires:		
	- corrosion-resistant		N/A
	- opening only possible for an authorized person		N/A
	- impact test 5 Nm		N/A
	- sample show no damage		N/A
3.6.9 (-)	Column-integrated luminaire:		
	- dimension of the cable entry slot (mm)		N/A
	- cable path from the slot to the connection compartment (mm)		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- cable path free from obstruction that might cause abrasion of the cable		N/A

3.7 (11)	CREEPAGE DISTANCES AND CLEARANCES		P
3.7 (11.2)	Creepage distances and clearances..... :	See Table 3.7 (11.2)	P
	Working voltage (V)..... :	250 V	—
	Rated pulse voltage (kV)..... :	/	—
	Voltage form..... :	Sinusoidal ☒ Non-sinusoidal ☐	—
	PTI..... :	< 600 ☐ ≥ 600 ☒	—
	Impulse withstand category (Normal category II) (Category III Annex U)	Category II ☐ Category III ☐	—

3.8 (7)	PROVISION FOR EARTHING		
3.8 (7.2.1 + 7.2.3)	Accessible metal parts		N/A
	Metal parts in contact with supporting surface		N/A
	Resistance < 0,5 Ω..... :		N/A
	Self-tapping screws used		N/A
	Thread-forming screws		N/A
	Thread-forming screw used in a groove		N/A
	Earth makes contact first		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
	Protective earthing of the luminaire not via built-in control gear		N/A
3.8 (7.2.2 + 7.2.3)	Earth continuity in joints, etc.		N/A
3.8 (7.2.4)	Locking of clamping means		N/A
	Compliance with 4.7.3		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
3.8 (7.2.5)	Earth terminal integral part of connector socket		N/A
3.8 (7.2.6)	Earth terminal adjacent to mains terminals		N/A
3.8 (7.2.7)	Electrolytic corrosion of the earth terminal		N/A
3.8 (7.2.8)	Material of earth terminal		N/A
	Contact surface bare metal		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.8 (7.2.10)	Class II luminaire for looping-in		N/A
	Double or reinforced insulation to functional earth		N/A
3.8 (7.2.11)	Earthing core coloured green-yellow		N/A
	Length of earth conductor		N/A
3.8.1 (-)	Attachment prevented from rotation		N/A
3.9 (14)	SCREW TERMINALS		P
	Separately approved; component list..... :	(see Annex 1)	P
	Part of the luminaire :	(see Annex 3)	N/A
3.9 (15)	SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS		P
	Separately approved; component list..... :	(see Annex 1)	P
	Part of the luminaire :	(see Annex 4)	N/A
3.10 (5)	EXTERNAL AND INTERNAL WIRING		
3.10 (5.2)	Supply connection and external wiring		P
3.10 (5.2.1)	Means of connection :	Internal connector	P
	Outdoor luminaire has not PVC insulated external wiring if not class III or SELV ≤ 25 V a.c./60 V d.c. or protected from outdoor environment		N/A
3.10 (5.2.2)	Type of cable :	H07RN-F (if provided)	P
	Nominal cross-sectional area (mm ²) :	1,5 mm ²	P
	Cables equal to IEC 60227 or IEC 60245		P
3.10 (5.2.3)	Type of attachment, X, Y or Z		N/A
3.10 (5.2.5)	Type Z not connected to screws		N/A
3.10 (5.2.6)	Cable entries:		
	- suitable for introduction		P
	- adequate degree of protection		P
3.10 (5.2.7)	Cable entries through rigid material have rounded edges		P
3.10 (5.2.8)	Insulating bushings:		
	- suitably fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A
	- tubes or guards made of insulating material		N/A
3.10 (5.2.9)	Locking of screwed bushings		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.10 (5.2.10)	Cord anchorage:		
	- covering protected from abrasion		P
	- clear how to be effective		P
	- no mechanical or thermal stress		P
	- no tying of cables into knots etc.		P
	- insulating material or lining		P
3.10 (5.2.10.1)	Cord anchorage for type X attachment:		
	a) at least one part fixed		N/A
	b) types of cable		N/A
	c) no damaging of the cable		N/A
	d) whole cable can be mounted		N/A
	e) no touching of clamping screws		N/A
	f) metal screw not directly on cable		N/A
	g) replacement without special tool		N/A
	Glands not used as anchorage		N/A
	Labyrinth type anchorages		N/A
3.10 (5.2.10.2)	Adequate cord anchorage for type Y and type Z attachment		N/A
3.10 (5.2.10.3)	Tests:		
	- impossible to push cable; unsafe		P
	- pull test: 25 times; pull (N) : 60		P
	- torque test: torque (Nm) : 0.25Nm		P
	- displacement ≤ 2 mm		P
	- no movement of conductors		P
	- no damage of cable or cord		P
	- function independent of electrical connection		N/A
3.10 (5.2.11)	External wiring passing into luminaire		N/A
3.10 (5.2.12)	Looping-in terminals		N/A
3.10 (5.2.13)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		N/A
3.10 (5.2.14)	Mains plug same protection		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	Class III luminaire plug		N/A
	No unsafe compatibility		N/A
3.10 (5.2.16)	Appliance inlets (IEC 60320)		P
	Installation couplers (IEC 61535)		N/A
	Other appliance inlet or connector according relevant IEC standard		N/A
3.10 (5.2.17)	No standardized interconnecting cables properly assembled		N/A
3.10 (5.2.18)	Used plug in accordance with		
	- IEC 60083		N/A
	- other standard		N/A
3.10 (5.3)	Internal wiring		
3.10 (5.3.1)	Internal wiring of suitable size and type		P
	Through wiring		
	- not delivered/ mounting instruction		N/A
	- factory assembled		N/A
	- socket outlet loaded (A) :		N/A
	- temperatures : (see Annex 2)		N/A
	Green-yellow for earth only		N/A
3.10 (5.3.1.1)	Internal wiring connected directly to fixed wiring		
	Cross-sectional area (mm ²)..... :		P
	Insulation thickness		P
	Extra insulation added where necessary		N/A
3.10 (5.3.1.2)	Internal wiring connected to fixed wiring via internal current-limiting device		
	Adequate cross-sectional area and insulation thickness		N/A
3.10 (5.3.1.3)	Double or reinforced insulation for class II		N/A
3.10 (5.3.1.4)	Conductors without insulation		N/A
3.10 (5.3.1.5)	SELV current-carrying parts		P
3.10 (5.3.1.6)	Insulation thickness other than PVC or rubber		P
3.10 (5.3.2)	Sharp edges etc.		P

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	No moving parts of switches etc.		N/A
	Joints, raising/lowering devices		N/A
	Telescopic tubes etc.		N/A
	No twisting over 360°		N/A
3.10 (5.3.3)	Insulating bushings:		
	- suitable fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A
	- cables with protective sheath		N/A
3.10 (5.3.4)	Joints and junctions effectively insulated		N/A
3.10 (5.3.5)	Strain on internal wiring		P
3.10 (5.3.6)	Wire carriers		N/A
3.10 (5.3.7)	Wire ends not tinned		P
	Wire ends tinned: no cold flow		N/A
3.10.1 (-)	Cord anchorage if applicable		P
	- pull test: 25 times; pull (N)	60 N	P
	- torque test: torque (Nm)	0.25 Nm	P

3.11 (8)	PROTECTION AGAINST ELECTRIC SHOCK		
3.11 (8.2.1)	Live parts not accessible		P
	Basic insulated parts not used on the outer surface without appropriate protection		P
	Basic insulated parts not accessible with standard test finger on portable, settable and adjustable luminaires		P
	Basic insulated parts not accessible with Ø 50 mm probe from outside, other types of luminaires		P
	Lamp and starterholders in portable and adjustable luminaires comply with double or reinforced insulation requirements		N/A
	Basic insulation only accessible under lamp or starter replacement		N/A
	Protection in any position		N/A
	Double-ended tungsten filament lamp		N/A
	Insulation lacquer not reliable		N/A
	Double-ended high pressure discharge lamp		N/A
	Relevant warning according to 3.2.18 fitted to the luminaire		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.11 (8.2.2)	Portable luminaire adjusted in most unfavourable position		N/A
3.11 (8.2.3.a)	Class II luminaire:		
	- basic insulated metal parts not accessible during starter or lamp replacement		N/A
	- basic insulation not accessible other than during starter or lamp replacement		N/A
	- glass protective shields not used as supplementary insulation		N/A
3.11 (8.2.3.b)	BC lampholder of metal in class I luminaires shall be earthed		N/A
3.11 (8.2.3.c)	SELV circuits with exposed current carrying parts:		
	Ordinary luminaire:		
	- touch current		N/A
	- no-load voltage.....		N/A
	Other than ordinary luminaire:		
	- nominal voltage		N/A
3.11 (8.2.4)	Portable luminaire have protection independent of supporting surface		N/A
3.11 (8.2.5)	Compliance with the standard test finger or relevant probe		P
3.11 (8.2.6)	Covers reliably secured		P
3.11 (8.2.7)	Discharging of capacitors $\geq 0,5 \mu\text{F}$		N/A
	Portable plug connected luminaire with capacitor		N/A
	Other plug connected luminaire with capacitor		N/A
	Discharge device on or within capacitor		N/A
	Discharge device mounted separately		N/A

3.12 (12)	ENDURANCE TEST AND THERMAL TEST		P
3.12.2 (-)	If IP > IP 20 relevant test of (12.4), (12.5) and (12.6) after (9.2) before (9.3) specified in 3.13		—
3.12 (12.3)	Endurance test:		P
	- mounting-position	Acc. To mounting instruction	—
	- test temperature (°C)	35°C	—
	- total duration (h)	240 H	—
	- supply voltage: Un factor; calculated voltage (V)...		—

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- lamp used..... :		—
3.12 (12.3.2)	After endurance test:		
	- no part unserviceable		P
	- luminaire not unsafe		P
	- no damage to track system		N/A
	- marking legible		P
	- no cracks, deformation etc.		P
3.12 (12.4)	Thermal test (normal operation)	(see Annex 2)	P
3.12 (12.5)	Thermal test (abnormal operation)	(see Annex 2)	P
3.12 (12.6)	Thermal test (failed lamp control gear condition):		
3.12 (12.6.1)	Through wiring or looping-in wiring loaded by a current of (A) :		—
	- case of abnormal conditions :		—
	- electronic lamp control gear		N/A
	- measured winding temperature (°C): at 1,1 Un :		—
	- measured mounting surface temperature (°C) at 1,1 Un :		N/A
	- calculated mounting surface temperature (°C) :		N/A
	- track-mounted luminaires		N/A
3.12 (12.6.2)	Temperature sensing control		
	- case of abnormal conditions :		—
	- thermal link		N/A
	- manual reset cut-out		N/A
	- auto reset cut-out		N/A
	- measured mounting surface temperature (°C) :		N/A
	- track-mounted luminaires		N/A
3.12 (12.7)	Thermal test (failed lamp control gear in plastic luminaires):		N/A
3.12 (12.7.1)	Luminaire without temperature sensing control		N/A
3.12 (12.7.1.1)	Luminaire with fluorescent lamp ≤ 70W		N/A
	Test method 12.7.1.1 or Annex W :		—
	Test according to 12.7.1.1:		
	- case of abnormal conditions :		—

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- Ballast failure at supply voltage (V)		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
	Test according to Annex W:		
	- case of abnormal conditions		—
	- measured winding temperature (°C): at 1,1 Un		—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un		—
	- calculated temperature of fixing point/exposed part (°C)		—
	Ball-pressure test	See Table 3.15 (13.2.1)	N/A
3.12 (12.7.1.2)	Luminaire with discharge lamp, fluorescent lamp > 70W, transformer > 10 VA		
	- case of abnormal conditions		—
	- measured winding temperature (°C): at 1,1 Un		—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un		—
	- calculated temperature of fixing point/exposed part (°C)		—
	Ball-pressure test	See Table 3.15 (13.2.1)	N/A
3.12 (12.7.1.3)	Luminaire with short circuit proof transformers ≤ 10 VA		N/A
	- case of abnormal conditions		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
3.12 (12.7.2)	Luminaire with temperature sensing control		N/A
	- thermal link	Yes ☐ No ☐	—
	- manual reset cut-out	Yes ☐ No ☐	—
	- auto reset cut-out	Yes ☐ No ☐	—
	- case of abnormal conditions		—
	- highest measured temperature of fixing point/exposed part (°C):		—
	Ball-pressure test:	See Table 3.15 (13.2.1)	N/A
3.12.1 (-)	Temperature reduction if for outdoor use only		N/A
3.12.2 (-)	(See above)		—

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
3.12.3 (-)	Glass covers used within the thermal limits declared by the glass manufacturer		N/A

3.13 (9)	RESISTANCE TO DUST, SOLID OBJECTS AND MOISTURE		P
3.13.1 (-)	If IP > IP 20 the order of tests as specified in clause 3.12		P
3.13 (9.2)	Tests for ingress of dust, solid objects and moisture:		—
	- classification according to IP..... :	IP66	—
	- mounting position during test..... :	Acc. to mounting instruction	—
	- fixing screws tightened; torque (Nm)..... :	Acc. to mounting instruction	—
	- tests according to clauses..... :		—
	- electric strength test afterwards		P
	a) no deposit in dust-proof luminaire		P
	b) no talcum in dust-tight luminaire		P
	c) no trace of water on current-carrying parts or on insulation where it could become a hazard		P
	d) i) For luminaires without drain holes – no water entry		P
	d) ii) For luminaires with drain holes – no hazardous water entry		N/A
	e) no water in watertight luminaire		P
	f) no contact with live parts (IP 2X)		P
	f) no entry into enclosure (IP 3X and IP 4X)		P
	f) no contact with live parts (IP3X and IP4X)		P
	g) no trace of water on part of lamp requiring protection from splashing water		N/A
	h) no damage of protective shield or glass envelope		N/A
3.13 (9.3)	Humidity test 48 h		P

3.14 (10)	INSULATION RESISTANCE AND ELECTRIC STRENGTH		P
3.14 (10.2.1)	Insulation resistance test		P
	Cable or cord covered by metal foil or replaced by a metal rod of mm Ø..... :		—
	Insulation resistance (MΩ)..... :		—
	SELV		
	- between current-carrying parts of different polarity :		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- between current-carrying parts and mounting surface..... :		N/A
	- between current-carrying parts and metal parts of the luminaire :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5 :		N/A
	Other than SELV		
	- between live parts of different polarity :	>4 Mohm	P
	- between live parts and mounting surface :	>4 Mohm	P
	- between live parts and metal parts :	>4 Mohm	P
	- between live parts of different polarity through action of a switch..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :	>4 Mohm	P
	- Insulation bushings as described in Section 5 :		N/A
3.14 (10.2.2)	Electric strength test		P
	Dummy lamp		N/A
	Luminaires with ignitors after 24 h test		N/A
	Luminaires with manual ignitors		N/A
	Test voltage (V) :		P
	SELV		
	- between current-carrying parts of different polarity :		N/A
	- between current-carrying parts and mounting surface..... :		N/A
	- between current-carrying parts and metal parts of the luminaire :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5 :		N/A
	Other than SELV		
	- between live parts of different polarity :	1500V	P
	- between live parts and mounting surface :	1500V	N/A
	- between live parts and metal parts :	1500V	P

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	- between live parts of different polarity through action of a switch..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5 :		N/A
3.14 (10.3)	Touch current or protective conductor current (mA) :	<<0,5	P

3.15 (13)	RESISTANCE TO HEAT, FIRE AND TRACKING		
3.15 (13.2.1)	Ball-pressure test	See Test Table 3.15 (13.2.1)	N/A
3.15 (13.3.1)	Needle-flame test (10 s)	See Test Table 3.15 (13.3.1)	N/A
3.15 (13.3.2)	Glow-wire test (650°C)	See Test Table 3.15 (13.3.2)	N/A
3.15 (13.4)	Proof tracking test (IEC 60112)	See Test Table 3.15 (13.4)	N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

3.7 (11.2)	TABLES: Creepage distances and clearances						p	
Table 11.1	Minimum distances (mm) for a.c. (50/60 Hz) sinusoidal voltages							
RMS working voltage (V) not exceeding		50	150	250	500	750	1000	
Creepage distances								
Required basic insulation, PTI ≥ 600		0,6	0,8	1,5	3	4	5,5	
Measured				>2				
Required basic insulation, PTI < 600		1,2	1,6	2,5	5	8	10	
Measured								
Required supplementary insulation PTI ≥ 600		-	0,8	1,5	3	4	5,5	
Measured				>2				
Required supplementary insulation PTI < 600		-	1,6	2,5	5	8	10	
Measured								
Required reinforced insulation		-	3,2	5	6	8	11	
Measured				>7				
Clearances								
Required basic insulation		0,2	0,8	1,5	3	4	5,5	
Measured				>2				
Required supplementary insulation		-	0,8	1,5	3	4	5,5	
Measured								
Required reinforced insulation		-	1,6	3	6	8	11	
Measured				>4				
Table 11.2	Minimum distances (mm) for non-sinusoidal pulse voltages							
Rated pulse voltage (peak kV)		2,0	2,5	3,0	4,0	5,0	6,0	8,0
Required clearances		1,0	1,5	2	3	4	5,5	8
Measured								
Rated pulse voltage (peak kV)		10	12	15	20	25	30	40
Required clearances		11	14	18	25	33	40	60
Measured								
Rated pulse voltage (peak kV)		50	60	80	100	-	-	-
Required clearances		75	90	130	170	-	-	-
Measured								

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

3.15 (13.2.1)	TABLE: Ball Pressure Test of Thermoplastics			N/A
Allowed impression diameter (mm) :				—
Object/ Part No./ Material	Manufacturer/ trademark	Test temperature (°C)	Impression diameter (mm)	
Supplementary information:				

3.15 (13.3.1)	TABLE: Needle-flame test (IEC 60695-11-5)				N/A
Object/ Part No./ Material	Manufacturer/ trademark	Duration of application of test flame (ta); (s)	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
Supplementary information:					

3.15 (13.3.2)	TABLE: Glow-wire test (IEC 60695-2-11)				N/A
Glow wire temperature :				650°C	—
Object/ Part No./ Material	Manufacturer/ trademark	Duration of application of test flame (ta); (s)	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
Any flame or glowing of the sample extinguished within 30 s of withdrawing the glow-wire, and any burning or molten drop did not ignite the underlying parts (Yes/No)					
Supplementary information:					

3.15 (13.4)	TABLE: Proof tracking test (IEC 60112)				N/A
Test voltage PTI :				175 V	—
Object/ Part No./ Material	Manufacturer/ trademark	Withstand 50 drops without failure on three places or on three specimens			Verdict
Supplementary information:					

ANNEX 1	TABLE: Critical components information				
----------------	---	--	--	--	--

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

Object / part No.	Code	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ¹⁾
Drivers	B	LG Innotek	LLP 110W 1A (LG PISE A110A) 68-110V	V in 120-277V AC Max 110W Vout:68-110Vdc tc:80°C	IEC/ EN 613472-13	CB
Drivers	B	LG Innotek	LLP 55W 1A (LG PISE A55A) 44-55V	V in 120-277V AC Max 55W Vout:44-55-Vdc tc:80°C	IEC/ EN 613472-13	CB
Drivers	B	LG Innotek	LG PISE A027A	V in 120-277V AC Max 27W Vout:22-27-Vdc tc:80°C	IEC/ EN 613472-13	CB
Drivers	B	Tridonic	LCI 27W 1-10V	220-240V 50/60Hz tc 70°C	IEC/ EN 613472-13	CB
Driver	A	LG	PISE-A040D	40W 0.35-0.7A 120-277V 50-60Hz Tc=80°C	IEC 61347-2-13	CB / UL
Driver	A	LG	PISE-A040A	40W 0.35/0.5/0.7 120-277V 50-60Hz Tc=80°C	IEC 61347-2-13	CB / UL
Driver	A	LG	PISE-A075A	75W 0.35/0.5/0.7 120-277V 50-60Hz Tc=80°C	IEC 61347-2-13	CB / UL
Driver	A	LG	PISE-A075D	75W 0.35-0.7A 120-277V 50-60Hz Tc=80°C	IEC 61347-2-13	CB / UL
Drivers	A	LG	PISE-A150D	150W 50/60Hz 0.35-0.7A 120-277V Tc=80°C	IEC 61347-2-13	CB / UL
Drivers	A	LG	PISE-A150A	150W 50/60Hz 0.35/0.5/0.7 120-277V Tc=80°C	IEC 61347-2-13	CB / UL
Drivers	A	PHILIPS	Xi FP 40W 0,3-1,0A SNLDAE 230V S175 sXt	40W 50-60Hz 0,3-1,05A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi FP 40W 0,2-0,7A SNLDAE 230V S175 sXt	40W 50-60Hz 0,2-0,7A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 40W 0,3-1,0A S1 230V S175 sXt	40W 50-60Hz 0,3-1,05A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 40W 0,2-0,7A S1 230V S175 sXt	40W 50-60Hz 0,2-0,7A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 70W 0,2-0,7A SL 230V C150 sXt	70W 50-60Hz 0,2-0,7A 198-264V Tc=85°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi FP 75W 0,2-0,7A SNLDAE 230V S240 sXt	75W 50-60Hz 0,2-0,7A 198-264V Tc=85°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi FP 75W 0,3-1,0A SNLDAE 230V S240 sXt	75W 50-60Hz 0,3-1,05A 198-264V Tc=85°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 75W 0,3-1,0A S1 230V S240 sXt	75W 50-60Hz 0,3-1,05A 198-264V Tc=85°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 75W 0,2-0,7A S1 230V S240 sXt	75W 50-60Hz 0,2-0,7A 198-264V Tc=85°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 150W 0,3-1,0A SL 230V S240 sXt	150W 50-60Hz 0,3-1,05A 198-264V Tc=90°C	IEC 61347-2-13	CB

IEC 60598-2-3						
Clause	Requirement + Test			Result - Remark		Verdict
Drivers	A	PHILIPS	Xi LP 150W 0,3-1,0A SL 230V S240 sXt	150W 50-60Hz 0,3-1,05A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi FP 150W 0,3-1,0A SNLDAE 230V S240 sXt	150W 50-60Hz 0,3-1,05A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi LP 150W 0,2-0,7AA SL 230V S240 sXt	150W 50-60Hz 0,2-0,7A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	PHILIPS	Xi FP 150W 0,2-0,7A SNLDAE 230V S240 sXt	150W 50-60Hz 0,2-0,7A 198-264V Tc=90°C	IEC 61347-2-13	CB
Drivers	A	Meanwell	PLM-12-350 PLM-12E-350	12W 50-60Hz 0.35A 110-240Vac Tc=75°C Ta=50°C	IEC 61347-2-13	CB
Control Device	A	Owlet	LuCo ADP	110-277V 50/60 Hz Tmax = 80°C	IEC/EN 61347	CB / UL
Control Device	A	Owlet	LuCo NXP	110-277V 50/60 Hz Tmax = 80°C	IEC/EN 61347	CB / UL
Control Device	A	Owlet	LuCo P7	110-277V 50/60 Hz Tmax = 75°C	IEC/EN 61347	CB / UL
Control Device	A	Owlet	Shorting Cap	LuCo P7 Empty Body	IEC/EN 61347	Test report P-E16059
Connection Device	A	TE	TE NEMA Socket 7-pin	Power contacts: 15A 480V Dimming contacts: 0.10A 10V	IEC 61347-1 IEC 61347-2-11	CB
FUSE HOLDER	A	Mersen	10x38mm CCR8-10 Series	20-32A 400V	IEC 60269-1 & -2	ENEC
FUSE HOLDER	A	CAMDENBOSS	CFTBN 5x20mm	13A 250V	IEC 60269-1 & -2	VDE / UL
FUSE	A	Mersen	FR10 10x38mm	0.5-32A 400-500V	IEC 60269-1 & -2	ENEC
FUSE	A	Littlefuse	5x20mm 213 Series	0.2-6.3A 250V	IEC 60269-1 & -2	VDE
VDR	A	Littlefuse	TM0V	275 Vac 10kA 20KV (DM)	IECQ-CECC E 1274/F	VDE
ESD	A	Vishay	VR 37	0,5W 2MΩ	DIN EN 60085	VDE
Surge protection Device	A	Vossloh	SPC3/230/10K/i	100-277V 50/60Hz 10kA 20KV (DM) 120KV (CM) Tc=80°C	IEC 61643-11	DEKRA
Surge protection Device(alt)	A	Cirprotec	NSS-10-C12-P NSS-10/230-D-LCF-P	max 320V 50-60 Hz 10kA 20KV (DM) 120KV (CM) Tc=80°C	IEC 61643-11	DEKRA
Terminal	A	WIELAND	GST18i S B	16A/250V 2.5mm²	EN 60998-1&2-2	VDE / UL
Terminal	A	ADELS	LK980-01	2.5mm², 450V 24A	EN 60998-1&2-2	VDE / UL
Terminal	A	ADELS	900-07/Q	0.5-4mm² 450V	EN 60998-1&2-2	VDE / UL
Terminal	A	ADELS	AC-166 ST(D)/3	0.5-2,5mm² 250-400V	EN 60998-1&2-2	VDE / UL
Terminal	A	WAGO	222 Series	0.08-2.5mm² 20A/400V	EN 60998-1&2-2	ENEC / UL
Terminal	A	WAGO	221 Series	0.2-4mm² 32A/450V	EN 60998-1&2-2	ENEC / UL
Terminal	A	WAGO	Connector 2 pole 294 model	24A/500V 0.5-2.5mm²	EN 60998-1&2-2	ENEC
Cable Gland	A	Hummel	HSK-K	IP68-10bar M20x1,5	DIN EN 62444	VDE / UL

IEC 60598-2-3						
Clause	Requirement + Test			Result - Remark		Verdict
Led Modules	A	LG	8 Leds G4TOP @1000 mA 16 Leds G4TOP @1000 mA 24 Leds G4TOP @1000 mA 32 Leds G4TOP @1000 mA	RG	IEC/EN 62031-62471	Tested in appliance
Led Modules	A	LG	8 Leds G4 @1000 mA 16 Leds G4 @1000 mA 24 Leds G4 @1000 mA 32 Leds G4 @1000 mA	RG	IEC/EN 62031-62471	Tested in appliance
Led Modules (Voltana)	A	LG	8 Leds G4L @1000 mA 16 Leds G4L @1000 mA 24 Leds G4L @1000 mA 32 Leds G4L @1000 mA	RG	IEC/EN 62031-62471	Tested in appliance
Led Modules	A	Schröder	2x12 Leds XP-G2 @700 mA 2x16 Leds XP-G2 @700 mA 24 Leds XP-G2 @700 mA 32 Leds XP-G2 @700 mA	RG0	IEC/EN 62031-62471	Tested in appliance
Supplementary information: ¹⁾ Provided evidence ensures the agreed level of compliance. See OD-CB2039. The codes above have the following meaning: A - The component is replaceable with another one, also certified, with equivalent characteristics B - The component is replaceable if authorised by the test house C - Integrated component tested together with the appliance D - Alternative component						

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-1	—				
	Lamp used..... :	8 Led's LG3535	—				
	Lamp control gear used..... :	Tridonic 27W @ 1000 mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 45 °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	45	68			70		
Supply wiring	45	57			90		
Led Module	45	73			85		
Terminal	45	57			110		
Internal wiring	45	57			90		
Supplementary information: Corrected for Ta 45 °C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-1	—				
	Lamp used..... :	8 Led's XPL	—				
	Lamp control gear used..... :	MeanWell PLD-40 @ 1400 mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 55 °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	55	87			90		
Supply wiring	55	64			90		
Led Module	55	106			130		
Terminal	55	64			110		
Internal wiring	55	64			90		
Supplementary information:							
Corrected for Ta 55 °C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-1	—				
	Lamp used..... :	8 Led's LG3535	—				
	Lamp control gear used..... :	Philips 40W @ 700 mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 55 °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	55	78			90		
Supply wiring	55	64			90		
Led Module	55	74			85		
Terminal	55	64			110		
Internal wiring	55	64			90		
Supplementary information:							
Corrected for Ta 55 °C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-2	—				
	Lamp used..... :	16 Led's LG3535	—				
	Lamp control gear used..... :	Xitanium 40W @ 700 mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 40 °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	40	86			90		
Supply wiring	40	50			90		
Led Module	40	65			85		
Terminal	40	50			110		
Internal wiring	40	50			90		
Supplementary information: Corrected for Ta 40°C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-3	—				
	Lamp used..... :	24 Led's LG3535	—				
	Lamp control gear used..... :	Xitanium 150W@1000 (700) mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 35 (55) °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	35 (55)	61 (84)			90		
Supply wiring	35 (55)	46 (64)			90		
Led Module	35 (55)	80 (85)			85		
Terminal	35 (55)	46 (64)			110		
Internal wiring	35 (55)	46 (64)			90		
Supplementary information: Corrected for Ta 35 (55) °C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-4	—				
	Lamp used..... :	32 Led's LG3535	—				
	Lamp control gear used..... :	Xitanium 150W @1000 (700) mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 40 (50) °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	40 (50)	88 (86)			90		
Supply wiring	40 (50)	55 (61)			90		
Led Module	40 (50)	81 (79)			85		
Terminal	40 (50)	55 (61)			110		
Internal wiring	40 (50)	55 (61)			90		
Supplementary information: Corrected for Ta 40 (50) °C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Temperature measurements, thermal tests of Section 12						
	Type reference :	VOLTANA-5	—				
	Lamp used..... :	64 Led's LG3535	—				
	Lamp control gear used..... :	Xitanium 150W @1000 (700) mA	—				
	Mounting position of luminaire :	Horizontal	—				
	Supply wattage (W) :		—				
	Supply current (A) :		—				
	Calculated power factor..... :		—				
	Table: measured temperatures corrected for ta = 35 (50) °C:						
	- abnormal operating mode :		—				
	- test 1: rated voltage..... :		—				
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage :		—				
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage :		—				
	- test 4: 1,1 times rated voltage or 1,05 times rated wattage :		—				
	Through wiring or looping-in wiring loaded by a current of A during the test :		—				
Temperature measurements, (°C)							
Part	Ambient	Clause 12.4 – normal				Clause 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Convertor Tc	35 (50)	81 (85)			90		
Supply wiring	35 (50)	52 (61)			90		
Led Module	35 (50)	82 (80)			85		
Terminal	35 (50)	52 (61)			110		
Internal wiring	35 (50)	52 (61)			90		
Supplementary information: Corrected for Ta 35 (50)°C							

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 3	Screw terminals (part of the luminaire)		N/A
(14)	SCREW TERMINALS		N/A
(14.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(14.3.2.1)	One or more conductors		N/A
(14.3.2.2)	Special preparation		N/A
(14.3.2.3)	Terminal size		N/A
	Cross-sectional area (mm ²)..... :		—
(14.3.3)	Conductor space (mm)..... :		N/A
(14.4)	Mechanical tests		N/A
(14.4.1)	Minimum distance		N/A
(14.4.2)	Cannot slip out		N/A
(14.4.3)	Special preparation		N/A
(14.4.4)	Nominal diameter of thread (metric ISO thread) :		N/A
	External wiring		N/A
	No soft metal		N/A
(14.4.5)	Corrosion		N/A
(14.4.6)	Nominal diameter of thread (mm) :		N/A
	Torque (Nm) :		N/A
(14.4.7)	Between metal surfaces		N/A
	Lug terminal		N/A
	Mantle terminal		N/A
	Pull test; pull (N) :		N/A
(14.4.8)	Without undue damage		N/A

ANNEX 4	Screwless terminals (part of the luminaire)		N/A
(15)	SCREWLESS TERMINALS		N/A
(15.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(15.3.1)	Material		N/A
(15.3.2)	Clamping		N/A
(15.3.3)	Stop		N/A
(15.3.4)	Unprepared conductors		N/A


IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
(15.3.5)	Pressure on insulating material		N/A
(15.3.6)	Clear connection method		N/A
(15.3.7)	Clamping independently		N/A
(15.3.8)	Fixed in position		N/A
(15.3.10)	Conductor size		N/A
	Type of conductor		N/A
(15.5.1)	Terminals internal wiring		N/A
(15.5.1.1)	Pull test spring-type terminals (4 N, 4 samples)		N/A
(15.5.1.2)	Pull test pin or tab terminals (4 N, 4 samples)		N/A
	Insertion force not exceeding 50 N		N/A
(15.5.1.2)	Permanent connections: pull-off test (20 N)		N/A
(15.5.2)	Electrical tests		N/A
	Voltage drop (mV) after 1 h (4 samples)		N/A
	Voltage drop of two inseparable joints		N/A
	Number of cycles:		—
	Voltage drop (mV) after 10th alt. 25th cycle (4 samples)		N/A
	Voltage drop (mV) after 50th alt. 100th cycle (4 samples)		N/A
	After ageing, voltage drop (mV) after 10th alt. 25th cycle (4 samples)		N/A
	After ageing, voltage drop (mV) after 50th alt. 100th cycle (4 samples)		N/A
(15.6)	Terminals external wiring		N/A
	Terminal size and rating		N/A
(15.6.2.1)	Pull test spring-type terminals or welded connections (4 samples); pull (N)		N/A
	Pull test pin or tab terminals (4 samples); pull (N)		N/A

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict


(15.6.3.1)	TABLE: Contact resistance test										N/A
	Voltage drop (mV) after 1 h										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Voltage drop of two inseparable joints										N/A
	Voltage drop after 10th alt. 25th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Voltage drop after 50th alt. 100th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Voltage drop after 50th alt. 100th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Continued ageing: voltage drop after 10th alt. 25th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Continued ageing: voltage drop after 10th alt. 25th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
	Continued ageing: voltage drop after 50th alt. 100th cycle										N/A
	Max. allowed voltage drop (mV) :										—
terminal	1	2	3	4	5	6	7	8	9	10	
voltage drop (mV)											
Supplementary information:											

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

Installation Notice and pictures

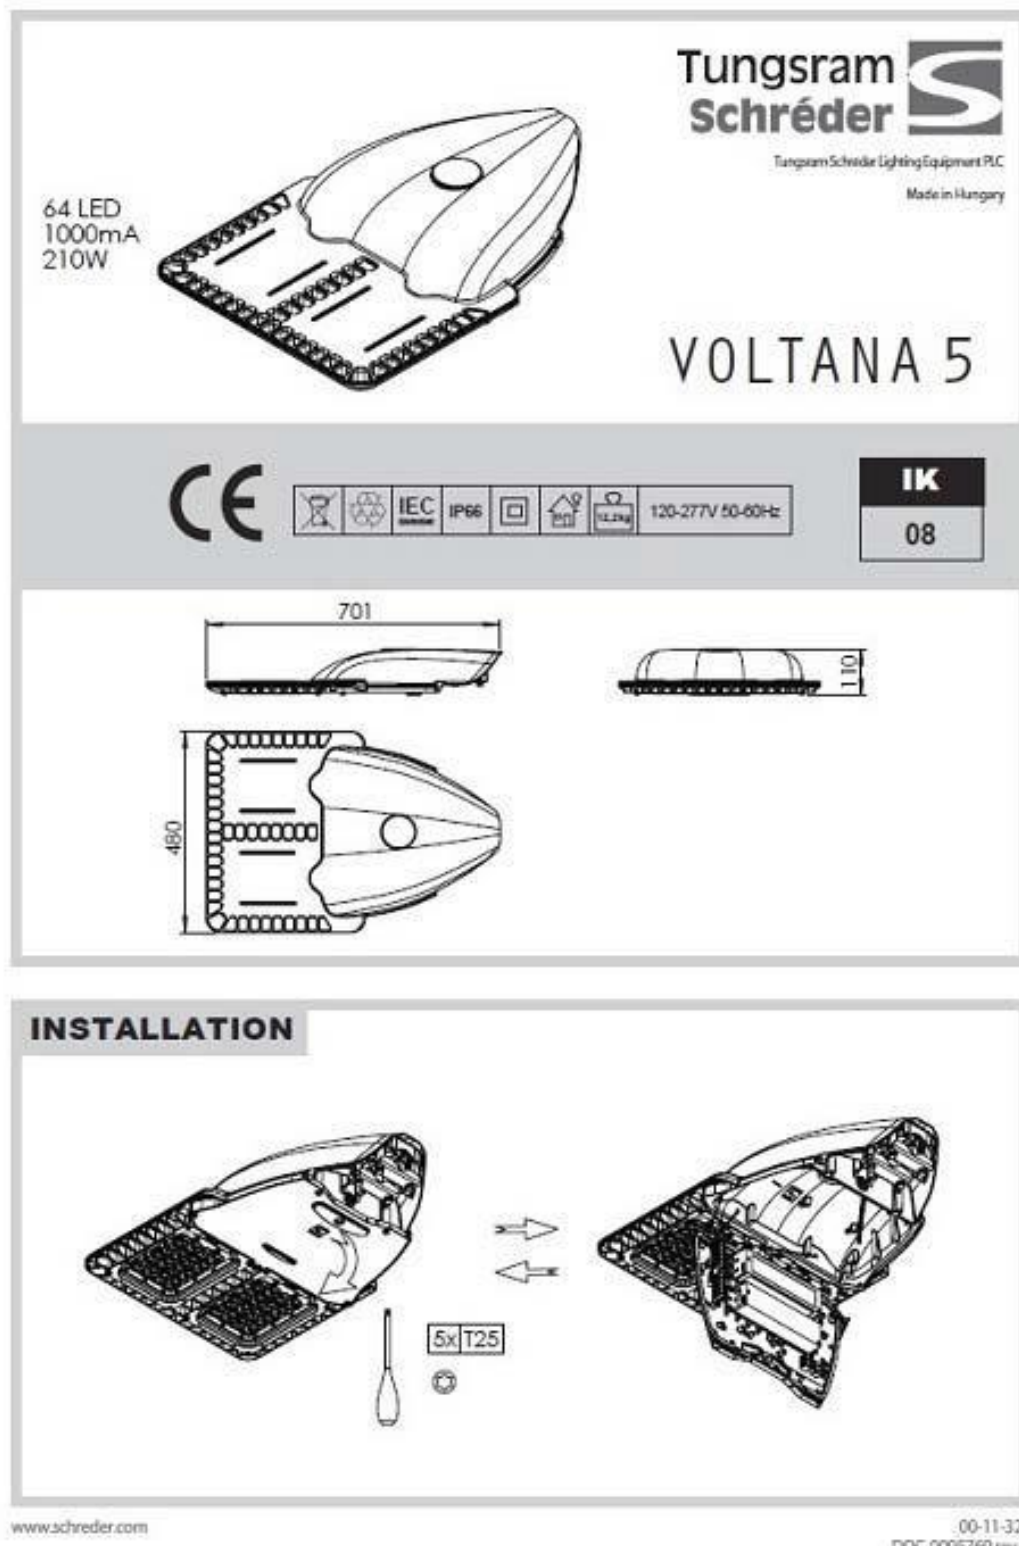


IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

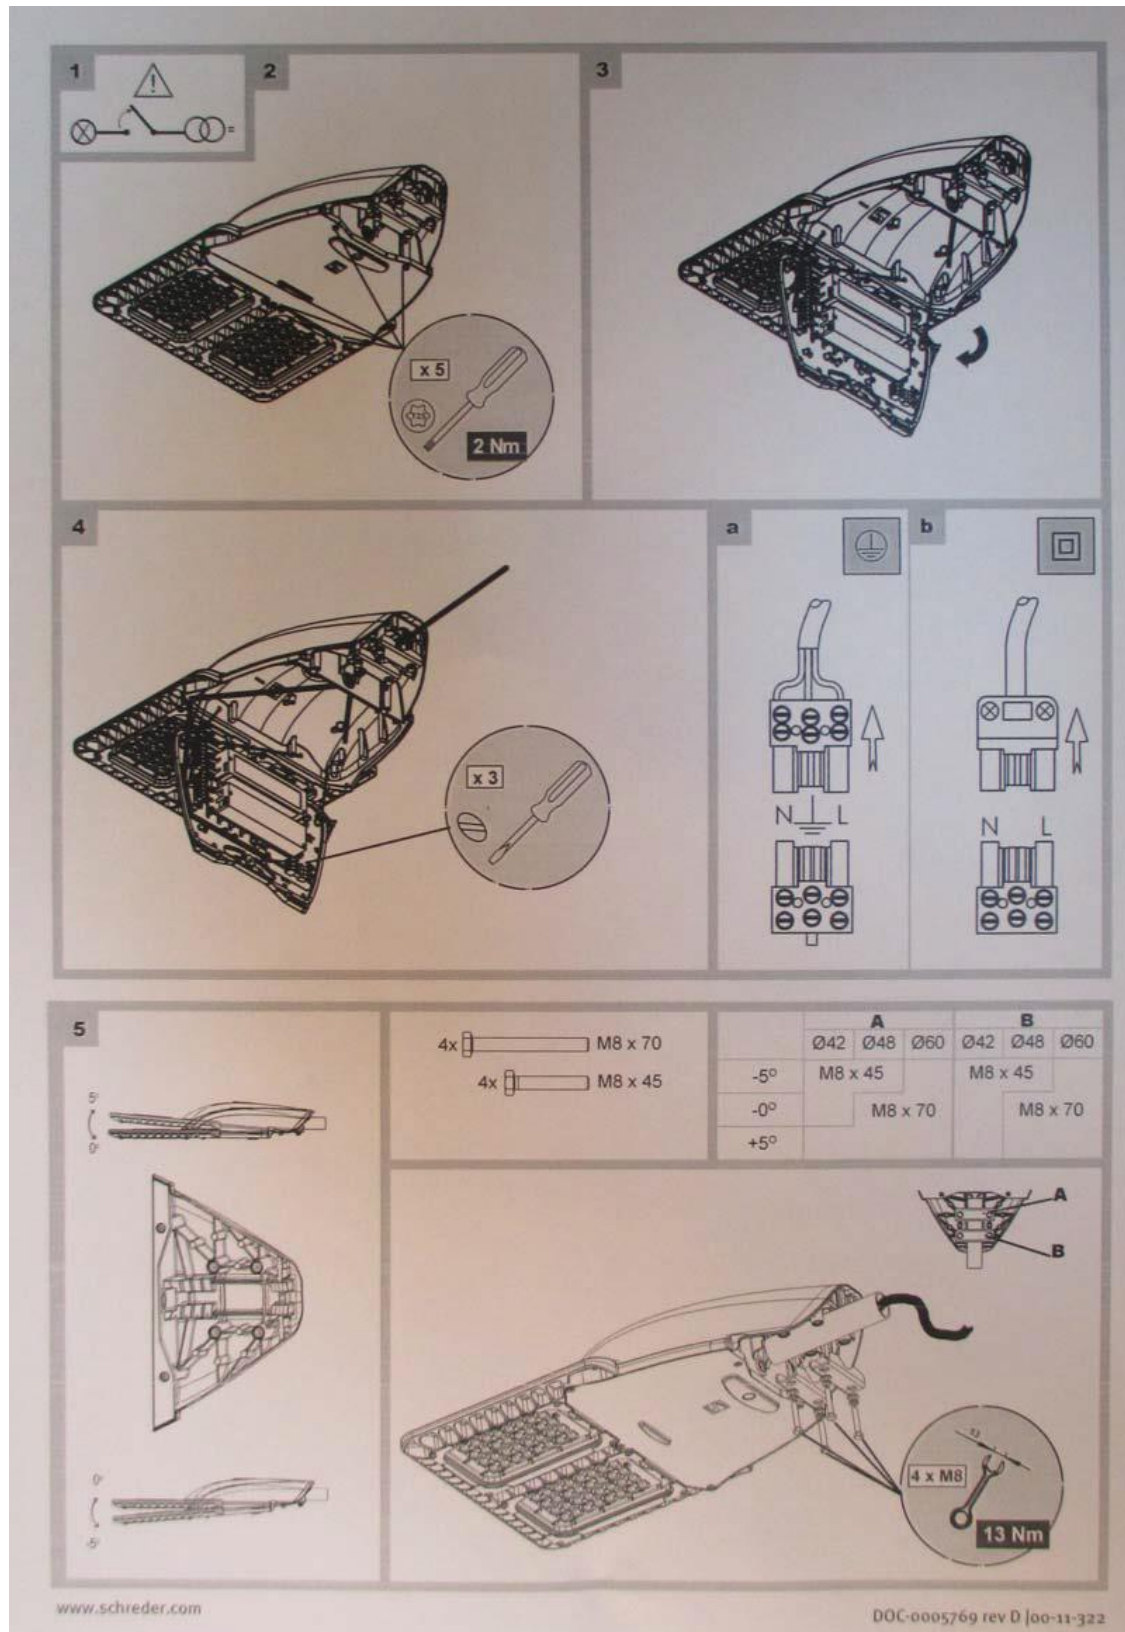

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict



IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

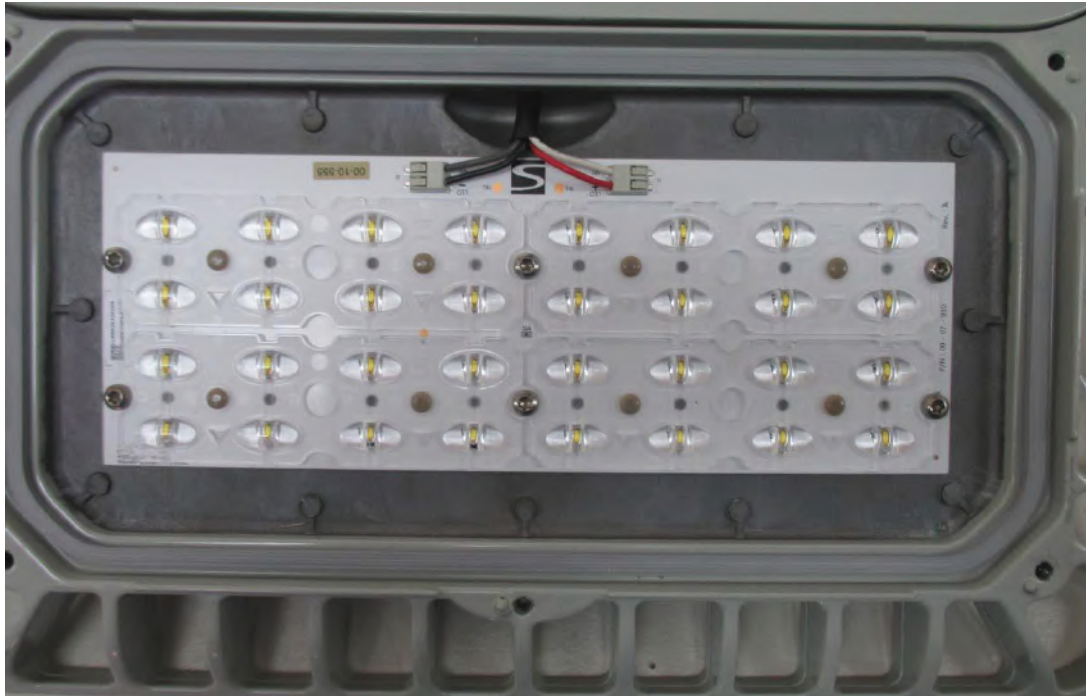

IEC 60598-2-3			
Clause	Requirement + Test	Result - Remark	Verdict



IEC60598_2_3K - ATTACHMENT

Clause	Requirement – Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

ATTACHMENT TO TEST REPORT IEC 60598-2-3
EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES
LUMINAIRES
PART 2: PARTICULAR REQUIREMENTS
SECTION 3: LUMINAIRES FOR ROAD AND STREET LIGHTING

Differences according to : EN 60598-2-3:2003 + A1:2011 used in conjunction with
EN 60598-1:2015

Annex Form No. : EU_GD_IEC60598_2_3K

Annex Form Originator : IMQ S.p.A.

Master Annex Form : 2016-12

Copyright © 2016 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.

	CENELEC COMMON MODIFICATIONS (EN)	P
--	--	----------

3.5 (3)	MARKING	
3.5 (3.3.101)	For luminaires not supplied with terminal block: Adequate warning on the package	N/A

3.6 (4)	CONSTRUCTION	
3.6 (4.11.6)	Electro-mechanical contact systems	N/A

3.10 (5)	EXTERNAL AND INTERNAL WIRING	
3.10 (5.2.1)	Connecting leads	N/A
	- without a means for connection to the supply	N/A
	- terminal block specified	N/A
	- relevant information provided	N/A
	- compliance with 4.6, 4.7.1, 4.7.2, 4.10.1, 11.2, 12 and 13.2 of Part 1	N/A
3.10 (5.2.2)	Cables equal to EN 50525	N/A
	Replace table 5.1 – Supply cord	N/A

3.12 (12)	ENDURANCE TESTS AND THERMAL TESTS	
3.12 (12.4.2c)	Thermal test (normal operation) see footnote c to table 12.2 relating to unsleeved fixed wiring	N/A

ZB	ANNEX ZB, SPECIAL NATIONAL CONDITIONS (EN)	
(3.3)	DK: power supply cords of class I luminaires with label	N/A
(4.5.1)	DK: socket-outlets	N/A

IEC60598_2_3K - ATTACHMENT

Clause	Requirement – Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

(5.2.1)	CY, DK, FI, GB: type of plug		N/A
---------	------------------------------	--	-----

ZC	ANNEX ZC, NATIONAL DEVIATIONS (EN)		
(4 & 5)	FR: Shuttered socket-outlets 10/16A		N/A
	FR: Safety requirements for high buildings (Arrêté du 30 décembre 2011 portant règlement de sécurité pour la construction des immeubles de grande hauteur et leur protection contre les risques d'incendie et de panique; Section VIII; Article GH 48, Eclairage) Glow-wire test for outer parts of luminaires:		
	- 850°C for luminaires in stairways and horizontal travel paths		N/A
	- 650°C for indoor luminaires		N/A
	GB: Requirements according to United Kingdom Building Regulation		N/A

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 16 Led's

Sample n°: P-E14361

Test purpose: Electrical measurements @ 1A

Remarks:

Test request n°: P-D14674

Folder n°: P-F14058

TEST CONDITIONS:

Operator: CLOSSET Frédéric

Driver: LG Innotek PISE-A055A, 1A driver

Load: 16 led's (Typical Vf: 3,18 V)

Power Supply:

Elgar Tw 3500-4

Supply voltage: 230 V 50 Hz

Measurement device:

Fluke Norma 4000 (HF Powermeter, User 10, filter OFF)

CONCLUSIONS:

- Efficiency: 87,0 %
- PF: 0,97
- THD: 8,6 %
- Harmonics distribution complies with the IEC/EN 61000-3-2 Standard.

Duplicate to: Mr M. Thijs

LAB 16/09/2014

J.P. Harchies

//P-14E674

A handwritten signature in blue ink, appearing to read "J.P. Harchies", with a horizontal line drawn underneath.

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 16 led's @ 1A class I

Sample n°:

Test purpose: EMC tests according to EN 55015 & EN 61547 Standards

Remarks:

Test request n°: P-D14700

Folder n°: P-F14058

TEST CONDITIONS:

Operator: ULg - EMC

Test Summary

EN 55015 & EN 61547 Standards

Emission

Standard	Limit / Level	Result	
		PASS	FAIL
EN 55015 Conducted Emission 9kHz- 30 MHz		X	
EN 55015 Annex B 30 MHz – 300 MHz		X	

Immunity

Standard	Limit / Level	Result	
		PASS	FAIL
EN 61000-4-5	0.5 , 1 , 2 & 4 kV M.D. Impulse + @ 90° Impulse - @ 270° 20' between impulse Criteria B required	X	

Driver: LG Innotek PISE-A 055A – 55W 1A (Rev-04)

EMC Auxiliaries: Ferrite W-E 742 700 55

CONCLUSIONS:

VOLTANA-2 16 led's driven @ 1A by LG Innotek 55 W driver complies with the CISPR/EN 55015 and EN 61547 Standards.

Remark: Surge protection tested OK up to 4 KV for both Differential & Common modes (Max ULg facilities).

Duplicate to: Mr M. Thijs
LAB 23/09/2014
J.P. Harchies

//P-14E700

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 Extra Clear glass protectors

Sample n°: P-E15378

Test purpose: Fragmentation test following IEC/EN 60598-2-3 Standard

Remarks:

Test request n°: P-D15559

Folder n°: P-F14058

TEST CONDITIONS:

Operator: BOMBIL Patrick

3 samples under test
Glass thickness: 5 mm



Fragmentation test

- An adhesive sheet is scotched on the protector internal side to hold the particles after breakage.
- Impact with spring punch hammer
- Impact on the external side of protector
- Impact at 3 cm from the mid-point of the longest edge.
- Counting of the particles in the coarsest area in a 5 cm side square within 5 minutes after breakage.

Results:

Sample 1: 117 pieces

Sample 2: 116 pieces

Sample 3: 118 pieces

CONCLUSIONS:

VOLTANA-2 Extra Clear Glass protector complies with fragmentation test following IEC/EN 60598-2-3 Standard.

Duplicate to: Mr M. Thijs

LAB 21/08/2015

L. Maghe

A handwritten signature in blue ink, appearing to read "L. Maghe".

//P-15CR559

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2

Sample n°: P-E14362

Test purpose: Mechanical impact resistance test following IEC/EN 62262 Standard

Remarks:

Test request n°: P-D14698

Folder n°: P-F14058

TEST CONDITIONS:

Operator: BOMBIL Patrick

Smooth extra clear glass
Glass thickness: 5 mm

At pendulum hammer

5 impact points distributed on protector surface
One impact on each point

Test on 5 samples

Test

IK08 : Impact energy: 5 joules
Hammer weight: 1,7 kg
Height of fall: 29,4 cm

Result

OK for the 5 samples for all tested points

CONCLUSIONS:

VOLTANA-2 satisfies the IK08 test following IEC/EN 62262 Standard.

Duplicate to: Mr M. Thijs
LAB 23/09/2014
J.P. Harchies

//P-14E698

A handwritten signature in blue ink, appearing to read "J.P. Harchies", with a horizontal line drawn underneath it.

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 16 led's @ 1A

Sample n°:

Test purpose: Tightness test IP66 following IEC/EN 60598-1 Standard

Remarks:

Test request n°: P-D14696

Folder n°: P-F14058

TEST CONDITIONS:

Operator: BOMBIL Patrick

Preconditioning: endurance test

Test	Result
IP6X : -Luminaire switched ON until stable T° -Talcum in suspension (blowing ON) -After 1', luminaire OFF -Talcum for 3 hours	OK.
IPX6 : - Luminaire switched ON until stable T° - Luminaire switched OFF and immediately sprayed with water jet - Hose Φ 12,5 mm - Water pressure: 1 kg/cm ² - Spraying distance: 3 m - Duration of test: 3 minutes	OK.

CONCLUSIONS:

VOLTANA-2 16 led's @ 1A satisfies the IP66 test following IEC/EN 60598-1 Standard.

Duplicate to: Mr M. Thijs
LAB 23/09/2014
J.P. Harchies

//P-14E696

A handwritten signature in blue ink, appearing to read "Harchies", with a horizontal line drawn underneath it.

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 16 Led's

Sample n°: P-E14361

Test purpose: Thermal test evaluation @ 1A


Remarks:

Test request n°: P-D14697

Folder n°: P-F14058

TEST CONDITIONS:

Operator: CLOSSET Frédéric

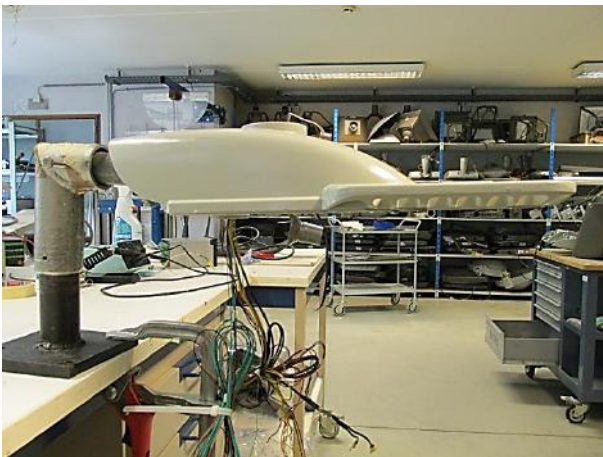

Load: 16 led's

Driver: LG Innotek LLP 55 W 1,0 A
PISE-A055A
Tc 80 °C

Measurement device:

Yokogawa TX10: thermal measurement

Yokogawa WT 210: primary EM

Fluke 87: secondary and led's EM

Junction Temperature measurement method

Junction temperature measurement by base temperature measurement and electrical measurement.

$$T^{\circ}_j = T^{\circ}_b + R_{jb} \times P_{led}$$

CONCLUSIONS:

According to "Led's Lumen Maintenance Criterion" LM80 extrapolation 6.000 hrs, we can state VOLTANA-2 16 led's driven @ 1A by LG Innotek driver LLP 55 W PISE-A055A driver satisfies:

Tq (CEI): 35 °C for led's with L80 – 100 Khrs target

Tq (CEI): 35 °C for lenses in Diakon material

Tq (CEI): 35 °C for driver PISE-A055A

Ta (CEI): 55 °C

Duplicate to: Mr M. Thijs

LAB 23/09/2014

J.P. Harchies

//P-14E697

A handwritten signature in blue ink, appearing to read "Harchies".

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2 – Side entry Configuration

Sample n°: P-E14365

Test purpose: Vibrations test: "Street Lighting Luminaires" testing protocol

Remarks:

Test request n°: P-D14801

Folder n°: P-F14058

TEST CONDITIONS:

Operator: V2i

Testing protocol

"Street Lighting Luminaires" testing protocol

Test Item	Post-top and Side-entry Luminaire
Excitation Direction	3 directions
Search for frequencies and quality factor Q	Excitation: sine sweep Frequency band: 5 - 55 Hz Sweep speed: 1 octave/min. Acceleration: 0.5g
Test	Q < 2 (no natural frequency) Excitation: RANDOM (*) Frequency band: 5 - 55 Hz Acceleration: 0.84g _{RMS} Duration: 1h
	Q > 2 Excitation : sine dwell Frequency : f0 (Qmax) Acceleration : 0.5g Duration : 30 minutes
Search for frequencies and quality factor Q	Excitation: sine sweep Frequency band: 5 - 55 Hz Sweep speed: 1 octave/min. Acceleration: 0.5g

(*) The RANDOM equivalent test consist in an accelerated ageing process of one hour which presents, on a reference one-degree-of-freedom system, an equivalent fatigue damage spectrum than 20 years of mean wind and 90 hours of storms.

CONCLUSIONS:

VOLTANA-2 side entry configuration satisfies the Vibration tests following "Street Lighting Luminaires" testing protocol.

Duplicate to: Mr M. Thijs
LAB 21/10/2014
J.P. Harchies

//P-14E801

Laboratory Service PHYSICAL TEST REPORT



R-Tech
Rue de Mons 3 – B-4000 Liège – Belgium
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90
Member of Schröder Group

Subject: VOLTANA-2

Sample n°: P-E14363

Test purpose: Aerodynamic wind test

Remarks:

Test request n°: P-D14699

Folder n°: P-F14058

TEST CONDITIONS:

Operator: ULg – CAT Soufflerie

2 tests realized:

- 1) Aerodynamic Coefficient determination
- 2) Endurance test

1) Aerodynamic coefficient determination

	<u>Value (m²)</u>		
<u>Wind Direction</u>	<u>Cd.S (drag)</u>	<u>Cs.S (Side)</u>	<u>Cl.S (Lift)</u>
Front	0,004	-0,004	0,002
Side	0,019	0,019	0,019

2) Endurance test: wind qualification test

Wind direction: Side

Wind resistance: 10' at 180 km/h

Result: OK

CONCLUSIONS:


VOLTANA-2 satisfies the wind speed test 180 Km/h for 10 minutes.
See Aerodynamic coefficients here above.

Duplicate to: Mr M. Thijs
LAB 23/09/2014
J.P. Harchies

//P-14E699

VOLTANA

ILUMINAT CU LEDURI,
POTRIVIT ORICUI

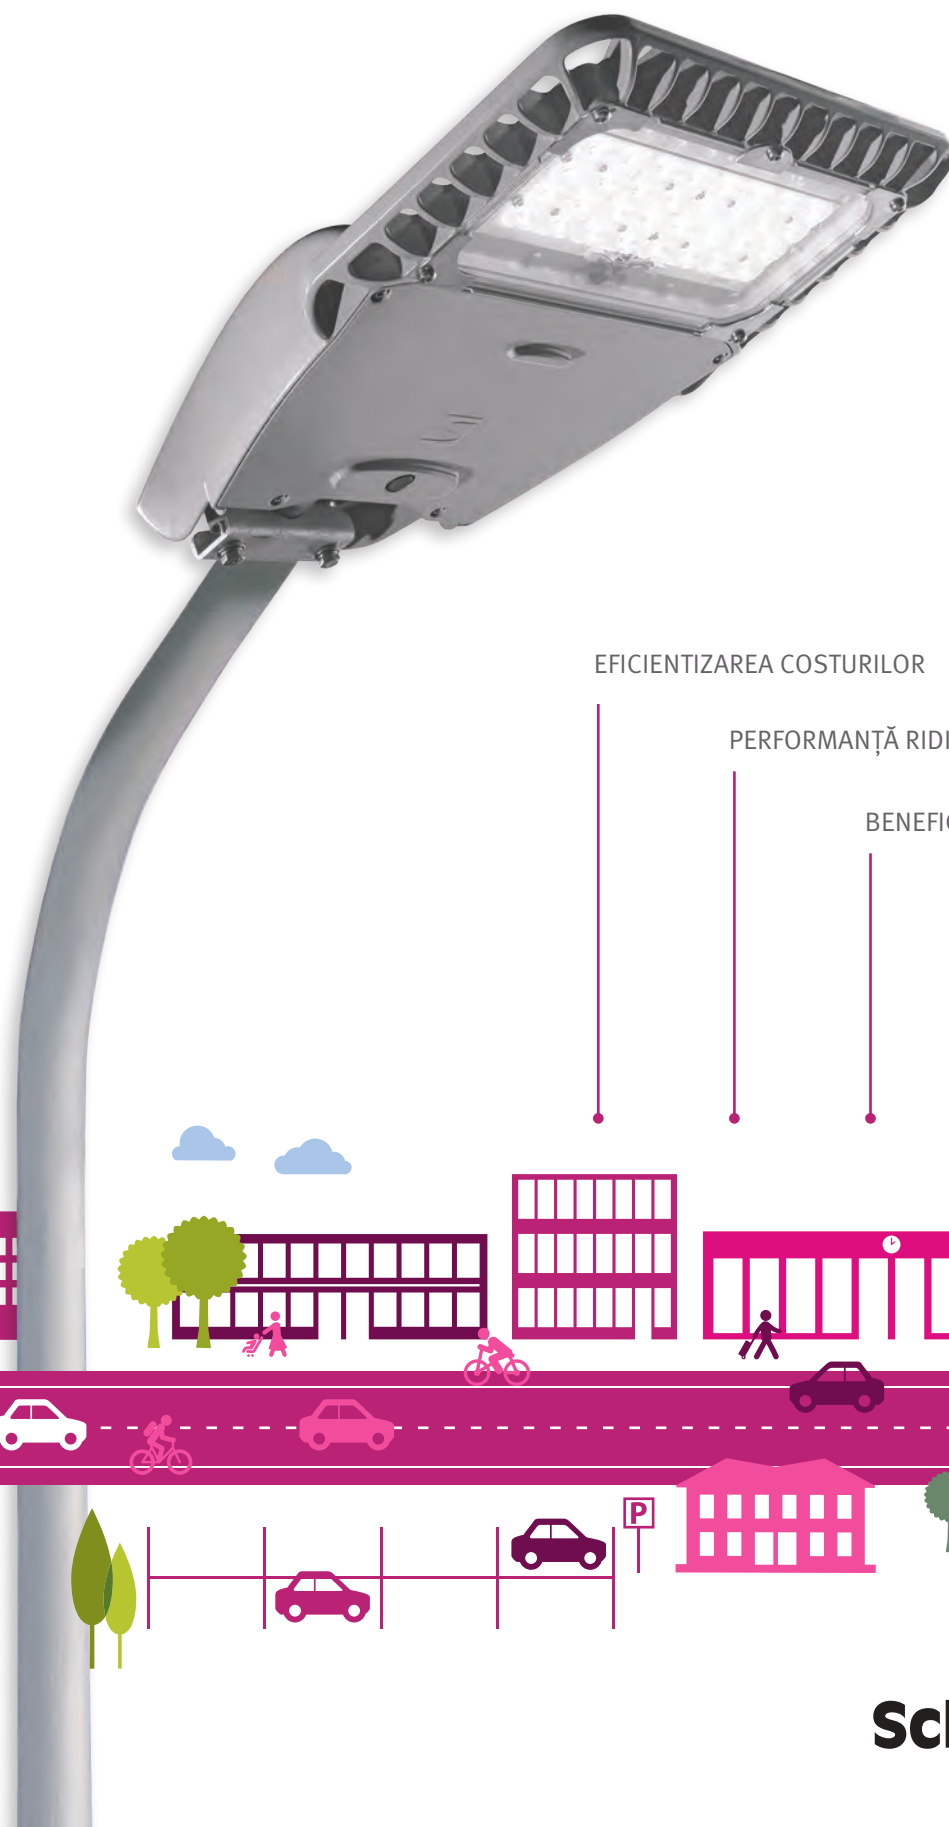

EFICIENTIZAREA COSTURILOR

PERFORMANȚĂ RIDICATĂ

BENEFICII REMARCABILE

NU NECESITĂ ÎNTREȚINERE

Schröder



VOLTANA



CEA MAI NOUĂ, RENTABILĂ ȘI PERFORMANTĂ GAMĂ DE APARATE DE ILUMINAT, CARE ÎȘI ACOPERĂ INVESTIȚIA ÎN TIMP

POSIBILITATEA DE A RECUPERA INVESTIȚIA RAPID, PENTRU ILUMINAREA ORICĂRUI TIP DE PEISAJ URBAN SAU RURAL, A STAT LA BAZA DEZVOLTĂRII GAMEI VOLTANA. DEVIZA NOASTRĂ ESTE: „ILUMINATUL CU LED ESTE PENTRU ORICINE”.

CALITATE FĂRĂ COMPROMISURI

Bazate pe modulul LED LensoFlex®2, aparatele de iluminat Voltana furnizează soluții de iluminat durabile, care scad semnificativ consumul de energie și îmbunătățesc nivelul de iluminat.

INVESTIȚII MINIME

Disponibil în 5 dimensiuni, cu flux luminos cuprins între 900 de lumeni și 23.900 lumeni, având numeroase distribuții luminoase de înaltă eficiență și diverse opțiuni pentru control, gama Voltana întâmpină toate nevoile de iluminat urban și rutier, cu investiții minime.

RECUPERARE RAPIDĂ, ECONOMII DE DURATĂ

Cu o durată de viață de 100.000 de ore, Voltana permite evitarea a 4, până la 6 schimbări ale lămpilor, comparativ cu sursele de iluminat convenționale. În perioada în care, pentru aparatele cu lămpi, ar fi necesară înlocuirea aparatului de iluminat, Voltana câștigă deja bătălia pentru scăderea costurilor totale, față de soluțiile HID. În primul rând, Voltana recuperează investiția, apoi continuă să ofere beneficii substanțiale, pentru o lungă perioadă de timp.



ZONE PIETONALE

Străzi, alei și piste
de biciclete



STRADAL

Străzi rezidențiale



Spații comune, zone
comerciale din mediul
urban



CĂI DE CIRCULAȚIE

Căi de circulație
din mediul rural



Căi de circulație
din mediul urban



substituit HID

20/50W

70W

100W


150W

250W



ALTE MEDII ÎN CARE **VOLTANA** OFERĂ BENEFICII-CHEIE PENTRU CLIENT



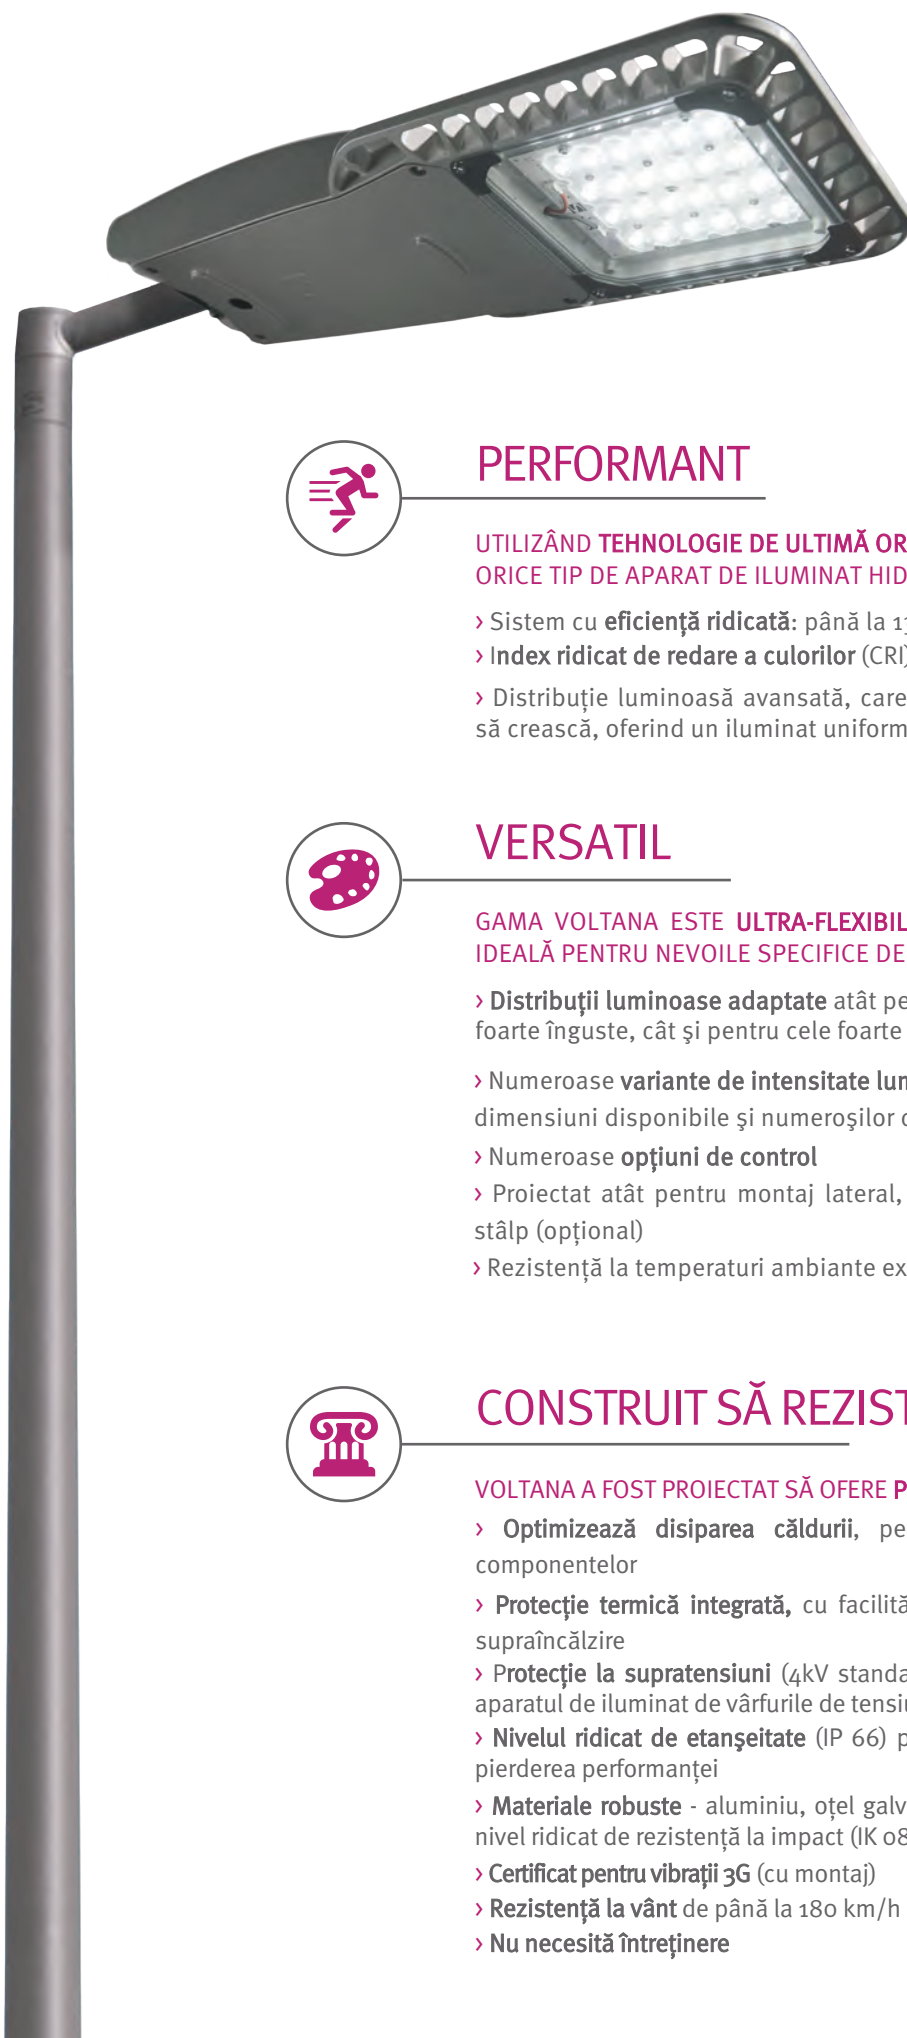

PERFORMANT

UTILIZÂND **TEHNOLOGIE DE ULTIMĂ ORĂ**, VOLTANA SURCLASEAZĂ ORICE TIP DE APARAT DE ILUMINAT HID:

- › Sistem cu **eficiență ridicată**: până la 130 lm/ W
- › **Index ridicat de redare a culorilor (CRI) > 70**
- › Distribuție luminoasă avansată, care permite ca spațiul dintre stâlpi să crească, oferind un iluminat uniform



VERSATIL

GAMA VOLTANA ESTE **ULTRA-FLEXIBILĂ**, ASTFEL CĂ OFERĂ SOLUȚIA IDEALĂ PENTRU NEVOILE SPECIFICE DE ILUMINAT:

- › **Distribuții luminoase adaptate** atât pentru zonele și căile de circulație foarte înguste, cât și pentru cele foarte largi
- › Numeroase **variante de intensitate luminoasă**, mulțumită celor 6 dimensiuni disponibile și numeroșilor curenți conductori
- › Numeroase **opțiuni de control**
- › Proiectat atât pentru montaj lateral, cât și pentru fixarea în vârf de stâlp (opțional)
- › Rezistență la temperaturi ambiante extreme, de până la 55°C



CONSTRUIT SĂ REZISTE

VOLTANA A FOST PROIECTAT SĂ OFERE **PERFORMANȚĂ PE TERMEN LUNG**

- › **Optimizează disiparea căldurii**, pentru a crește durata de viață a componentelor
- › **Protecție termică integrată**, cu facilități de reducere a fluxului, în caz de supraîncălzire
- › **Protecție la supratensiuni** (4kV standard, 10 kV opțional) pentru a proteja aparatul de iluminat de vârfurile de tensiune
- › **Nivelul ridicat de etanșeitate** (IP 66) previne distrugerea componentelor & pierderea performanței
- › **Materiale robuste** - aluminiu, oțel galvanizat și sticlă securizată, pentru un nivel ridicat de rezistență la impact (IK 08)
- › **Certificat pentru vibrații 3G** (cu montaj)
- › **Rezistență la vânt** de până la 180 km/h
- › **Nu necesită întreținere**



CONFORM

GAMA VOLTANA A FOST **CERTIFICATĂ** DE CELE MAI PRETENȚIOASE ORGANISME EUROPENE ȘI AMERICANE:

- › ENEC
- › ETL / UL
- › date despre iluminatul cu LEDuri



DEZVOLTARE DURABILĂ

DE LA ÎNCEPUT, APARATUL VOLTANA A FOST DEZVOLTAT PENTRU A **PROTEJA MEDIUL**

- › **Materiale reciclabile** (aluminiiu, oțel și sticlă)
- › **Profil destinat protecției mediului** (PEP) pentru scăderea ampretei ecologice
- › **Emisii de CO₂ reduse** (economie și întreținere)
- › Fără poluare luminoasă (**ULOR 0%**), mulțumită distribuției luminoase precise



SOCIAL

VOLTANA ADUCE NUMEROASE **BENEFICII COLECTIVE**

- › Vizibilitate îmbunătățită, cu lumină albă, care oferă **contrast ridicat**
- › **Siguranță ridicată**, pentru pietoni și pentru conducătorii auto
- › Opțional, iluminat la cerere, pentru a oferi lumină atunci când și acolo unde este cu adevărat necesară
- › **Mai puține interferențe în trafic**, datorită faptului că nu este necesară întreținerea și datorită posibilității de monitorizare
- › Contribuie la **administrarea eficientă a finanțelor** și la consumul responsabil de energie



PRECIS

CU 6 DIMENSIUNI DISPONIBILE, VOLTANA RĂSPUNDE EXACT **NEVOILOR SPECIFICE**

- › **Investiție optimizată**, cu minimum de resurse
- › **Adaptare precisă** la nevoile reale
- › **Design uniform** pentru întregul proiect
- › **Ușor de utilizat** pentru instalator (opțional, poate fi furnizat pre-cablat)



INTELIGENT

CU NUMEROASE **OPȚIUNI DE CONTROL**, VOLTANA OFERĂ OPORTUNITĂȚI PENTRU CREAREA DE SCENARII DE ILUMINAT NELIMITATE ȘI PENTRU **ÎMBUNĂTĂȚIREA MANAGEMENTULUI OPERAȚIONAL**

- › Disponibil cu profil **DALI 1-10 V** sau **profil de reducere personalizat**
- › **Flux Luminos Constant (CLO)**, pentru compensarea automată a deprecierei fluxului
- › Poate funcționa într-o **rețea independentă** limitată sau în **rețeaua unui oraș**, prin comunicație fără fir. Scenariile pot fi îmbunătățite prin **senzori externi**.*
- › Disponibil cu **fotocelulă** sau **priză NEMA P7**, pentru a opera în noua platformă Owlet IoT

CARACTERISTICI - CHEIE


	Voltana 0	Voltana 1	Voltana 2	Voltana 3	Voltana 4	Voltana 5
Flux luminos standard (gamă) ^(*)	700 - 2,500lm	800 - 3,000lm	1,800 - 6,100lm	2,700 - 9,200lm	3,700 - 12,700lm	7,500 - 25,200lm
Consum de energie (W) ^(*)	8 - 30W	10 - 31W	20 - 56W	28 - 82W	36 - 110W	70 - 215W
Flux rezidual pe durata de viață @ tq 25°C	Curent până la 700mA: up to 95% Curent de la 701mA până la 1A: până la 90%					@100,000h
Temperatură de culoare	alb cald sau neutru					
Etanș. compartiment optic						IP 66 ^(**)
Etanș. placă echip. control						IP 66 ^(**)
Rezistență la impact (sticlă)						IK 08 ^(***)
Putere nominală	120 - 277V - 50 - 60Hz					
Clasă electrică	EU I sau II ^(**)					
Înălțimea de instalare	4 - 12m					
Materiale						
Corp	Aluminiu turnat sub presiune					
Difuzor	Sticlă (polycarbonat pentru unele variante ale Voltana 0)					
Culoare	RAL 7038 Orice altă culoare din paletarul RAL, la cerere					

^(*) Fluxul inițial și consumul de curent al aparatului sunt valori orientative, pentru temperatură ambientală de 25°C. Fluxul real depinde de condițiile de mediu (de exemplu, temperatură) și poate varia, în anumite configurații. Valorile comunicate sunt supuse modificărilor, conform evoluției tehnologice. Pentru a verifica dacă acest document cuprinde ultimele informații disponibile, vă rugăm să vizitați www.schreder.com


^(**) conform standardului IEC - EN 60598 (doar Voltana 0 este disponibil cu Clasa I) – ^(***) conform standardului IEC - EN 62262

DIMENSIUNI | GREUTATE

	Voltana 0	Voltana 1	Voltana 2	Voltana 3	Voltana 4	Voltana 5
L	416mm	501mm	518mm	641mm	555mm	705mm
W	156mm	181mm	240mm	240mm	380mm	480mm
H	91mm	87mm	108mm	111mm	112mm	109mm
KG	2.6kg	4kg	5kg	6kg	8kg	12kg

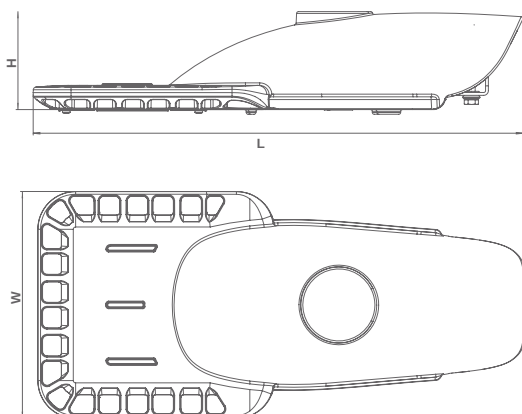


ADAPTOR VÂRF DE STÂLP

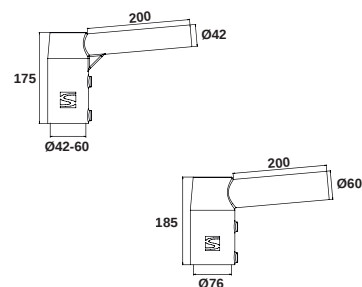


REGLAJE UNGHI ÎNCLINARE


VOLTANA 0

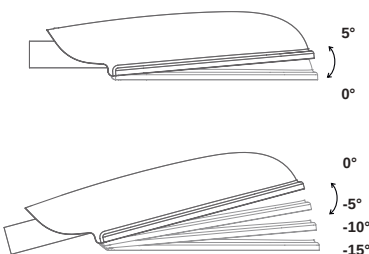

VOLTANA 1 - 5

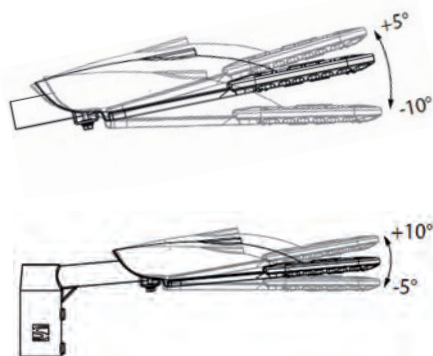

MONTAJ UNIVERSAL (OPȚIONAL PENTRU VOLTANA 0-1-2-3-4)



Ø 32 - 48mm
Ø 42 - 60mm
Ø 76mm

ÎNLOCUIȚI-VĂ ACTUALUL SISTEM DE ILUMINAT ȘI FACEȚI ECONOMII IMEDIAT, CU VOLTANA!

Prin simpla înlocuire a aparatelor de iluminat cu lămpi pe bază de sodiu cu aparatele Voltana, economiile de energie devin impresionante. În varianta plug-and-play, opțiunile de control - care nu sunt disponibile sau sunt foarte limitate în cazul aparatelor HPS - nu sunt incluse. În funcție de diferite scenarii, aceste opțiuni pot crește semnificativ economiile de energie, oferind, în același timp, siguranță și confort pentru toți utilizatorii și îmbunătățind managementul operațional al întregului sistem.


zone pietonale P5-P2		zone pietonale P1		căi de circulație clasificate M6-M5		căi de circulație clasificate M4		căi de circulație clasificate M3		căi de circulație clasificate M2	
aparat HPS 70W	Voltana 1	aparat HPS 100W	Voltana 2	aparat HPS 100W	Voltana 2	aparat HPS 150W	Voltana 3	aparat HPS 150W	Voltana 4	aparat HPS 250W	Voltana 5
	economii de 67%		economii de 56%		economii de 56%		economii de 58%		economii de 45%		economii de 35%
78W ^(*)		110W ^(*)		110W ^(*)		167W ^(*)		167W ^(*)		280W ^(*)	
26W ^(*)		48W ^(*)		48W ^(*)		70W ^(*)		92W ^(*)		180W ^(*)	

(*) Consum de energie total al sistemului

STUDIU DE CAZ

FLEXIBILITATEA DE CARE AVEȚI NEVOIE, PENTRU SCĂDEREA CHELTUIELILOR DE 5 ORI

Cu o investiție minimă (24 de LEDuri, versiunea 1A), Voltana 3 oferă o soluție extrem de competitivă - comparativ cu aparatele de iluminat de 150W, cu lămpi pe bază de sodiu- pentru a ilumina o cale de circulație clasificată M3 (conform standardului CIE 115), cu o recuperare a investiției în mai puțin de 4 ani și economii de energie de până la 79%.

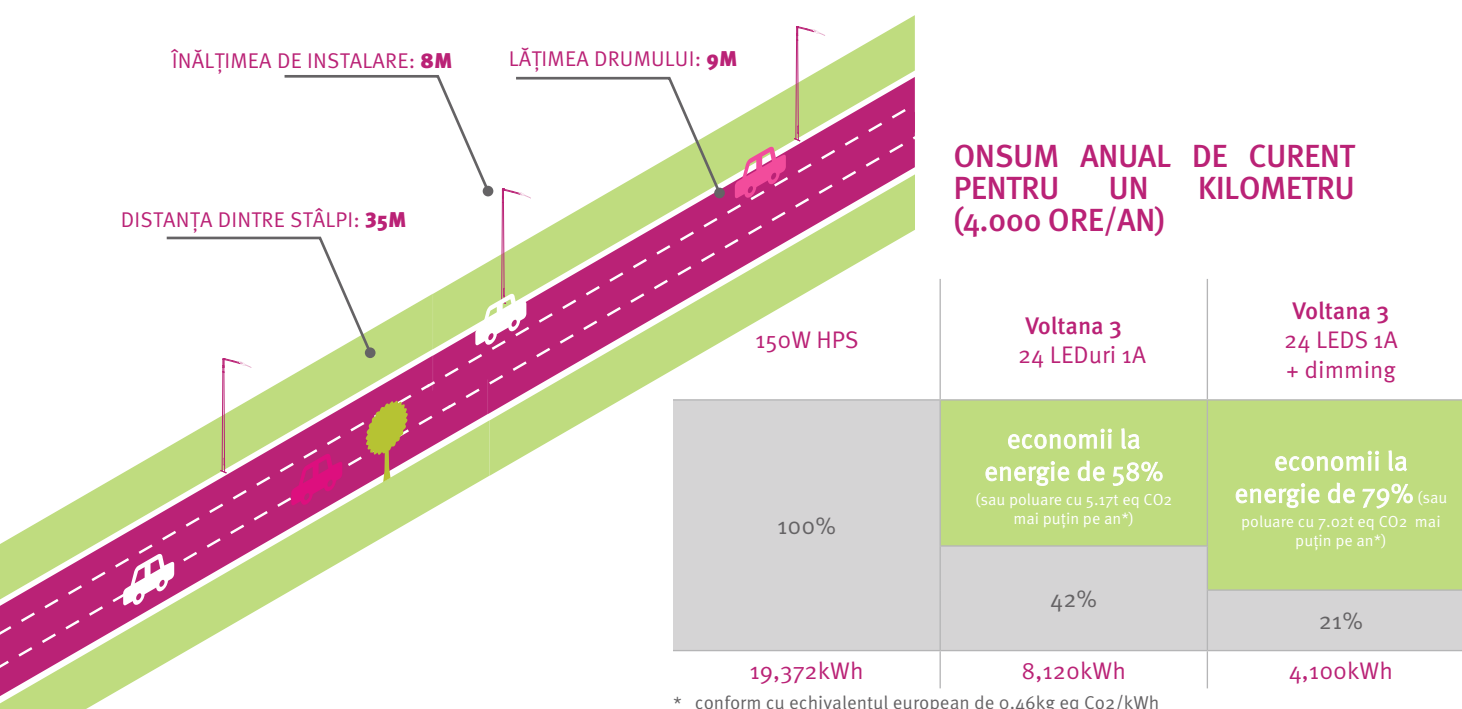



SIGURANȚĂ



STARE DE BINE



DEZVOLTARE DURABILĂ



ECONOMII



SOLUȚII



Drepturi de autor © Schréder S.A. 2017 - Editor Executiv: Stéphane Halleux - RTech, S.A. - Rue de Mons 3 - B-4000, Liège (Belgia) - Informațiile prezente au caracter pur orientativ. Mulțumită dezvoltării continue, am putea fi nevoiți să modificăm caracteristicile produselor noastre, fără notificare. Cum acestea pot prezenta caracteristici diferite, în funcție de cerințele fiecărei țări, vă invităm să ne consultați.

