

Quality System Registration



BRITISH
ENGINEERING
SERVICES

This is to certify that:

Friulair srl.
Via Cisis #36
Frazione Strassoldo
33050 Cervignano del Friuli (UD)
Italy,

Friulair srl.
In. Est. 49/5 Moo 5
Tungsukhla
Sriracha Chonburi 20230
Thailand

Friulair srl.
Viale Europa SN
33041 Aiello del Friuli (UD)
Italy

Has been granted Registration Certificate No: **BES/21/CAT000513373/9001/2**

In respect of a Quality Management System which has been assessed and found to comply with the requirements of ISO 9001:2015 for the following:

SCOPE:

Design, Manufacture and Assembly of Pressure Vessels, Air Dryers, Water Chillers, Heat Exchangers and other Pressure equipment for the Chemical, Petro-Chemical, Pharmaceutical, Food, Textile and other other industries.

For British Engineering Services:

First registered: **28 May 2002**

Valid from: **07 May 2021**

Expiry: **15 May 2024**

Issued by:
British Engineering Services
Unit 718 Eddington Way
Birchwood Park
Warrington
WA3 6BA



BRITISH
ENGINEERING
SERVICES



*This certificate remains the property of British Engineering Services
and is bound by the terms of the Certification Agreement*

Quality System Registration



IRISH
ENGINEERING
SERVICES

This is to certify that:

Friulair srl.
Via Cisis #36
Frazione Strassoldo
33050 Cervignano del Friuli (UD)
Italy

Friulair srl.
In. Est. 49/5 Moo 5
Tungsukhla
Sriracha Chonburi 20230
Thailand

Friulair srl.
Viale Europa SN
33041 Aiello del Friuli (UD)
Italy

Has been granted Registration Certificate No: **ICAT000530940/PED/v2.0**

In respect of a Quality Management System which has been assessed and found to comply with the requirements of module **D1, E1 & H** of Annex III of the Pressure Equipment Directive 2014/68/EU for the following:

SCOPE:

Design, Manufacture and Assembly of Pressure Vessels, Air Dryers, Water Chillers, Heat Exchangers and other Pressure equipment for the Chemical, Petro-Chemical, Pharmaceutical, Food, Textile and other other industries.

For Irish Engineering Services:

Nick Mayoh
2021.09.02 12:52:29
+01'00'

Certification Services Scheme Leader (ROI)



First registered: **20/12/2020**

Valid from: **19/04/2021**

Expiry: **18/04/2024**

- When module D or E is used in conjunction with module B see the latest issue of the Type Examination Schedule issued to the certificate holder.
- For pressure equipment in categories II, III and IV – permanent joining procedures and personnel shall be approved by an EU – 27 Notified Body/RTPO.
- For pressure equipment in categories III and IV – non-destructive testing personnel qualifications shall be approved by an EU – 27 Notified Body/RTPO.

Issued by:

Irish Engineering Services

RSA House, Dundrum Town Centre, Sandyford Road, Dublin 16, D16 FC92, Ireland



This certificate remains the property of Irish Engineering Services and is bound by the terms of the Certification Agreement.

Quality System Registration



This is to certify that:

Friulair srl.
Via Cisis #36
Frazione Strassoldo
33050 Cervignano del Friuli (UD)
Italy

Friulair srl.
In. Est. 49/5 Moo 5
Tungskhla
Sriracha Chonburi 20230
Thailand

Friulair srl.
Viale Europa SN
33041 Aiello del Friuli (UD)
Italy

Has been granted Registration Certificate No: **BES/21/CAT000513373/PESR/1**

In respect of a Quality Management System which has been assessed and found to comply with the requirements of modules D, D1, E1 & H of Part 3 of the Pressure Equipment (Safety) Regulations 2016 (Inc. Brexit amendments 2021) for the following:

SCOPE:

Design, Manufacture and Assembly of Pressure Vessels, Air Dryers, Water Chillers, Heat Exchangers and other Pressure equipment for the Chemical, Petro-Chemical, Pharmaceutical, Food, Textile and other industries.

For British Engineering Services:

Certification Services Scheme Leader

First registered: **28th May 2002**

Valid from: **29th July 2021**

Expiry: **15th May 2024**

When module D or E is used in conjunction with module B see the latest issue of the Type Examination Schedule issued to the certificate holder

Issued by:
British Engineering Services
Unit 718 Eddington Way
Birchwood Park
Warrington
WA3 6BA

***This certificate remains the property of British Engineering Services
and is bound by the terms of the Certification Agreement***

LA TECNOLOGIA DELL'ALLUMINIO FINALIZZATA AL RISPARMIO ENERGETICO ALUMINIUM TECHNOLOGIES DIRECT TO ENERGY SAVING

Fridair ha perfezionato la propria gamma di essiccatori per il trattamento dell'aria con la tecnologia di raffreddamento a liquido. Il nuovo ACT (Aluminium Coding Technology) mira alla riduzione dei consumi energetici.

Main features are:

- low pressure drop even with load variances;
- low power consumption thanks to the ALU-DRY heat exchanger, high efficiency compressors, innovative hot gas by-pass valve and zero loss drain condensate system from ACT 180 included;
- basco consumo energetico grazie all'impiego dello scambiatore ALU-DRY, di compressori ad alta efficienza, dell'innovativa valvola di controllo per il gas caldo e dei canali di drenaggio (dal ACT 180 incluso);
- risparmio energetico grazie al gruppo di scarico a basso consumo e alla sua installazione dopo a stagione ed un filtro; In alternativa può essere installato uno scambiatore elettronico capacitivo;
- funzionalità anche in condizioni estreme;
- costante Pressure Drop Point with differing load conditions;
- silenziosità anche in condizioni di funzionamento;
- silenziosità anche in condizioni di funzionamento;
- funzionalità anche in condizioni estreme di lavoro (aria in ingresso 70°C e ambiente 50°C).

The components of ACT range, from refrigerant to materials of construction, have been selected with maximum respect for the environment and their ability to be recycled.

La serie ACT è stata progettata nel massimo rispetto dell'ambiente visto l'utilizzo di refrigeranti ecologici e la selezione di materiali costruttivi riciclabili.

I DETTAGLI TECNICI - TECHNICAL DETAILS

PANNELLO DI CONTROLLO - CONTROL PANEL

DMC34 CONTROLLER
Il corretto funzionamento dei modelli ACT 3...160 viene controllato e monitorato attraverso il sistema digitale DMC34 che, per mezzo del display a 3 cifre, visualizza la temperatura del punto di rugiada (in °C o °F) ed indica le ore totali di funzionamento dell'essiccatore. Lo strumento include inoltre la funzione di controllo del ventilatore del condensatore, avviso di manutenzione programmata, temporizzatore per gestione dello scarico condensato e segnalazione di eventuali condizioni anomale (reportata anche sul contatto di allarme dedicato).

DMC34 CONTROLLER
Operation of all models ACT 3...160 is controlled and monitored by DMC34 digital controller. Featuring a 3-digit display, the DMC34 shows the dew point temperature (in °C or °F) and indicates the total running time of the dryer. The instrument also includes the fan control function, scheduled maintenance reminder, timer for the condenser drain valve and detection of any dryer malfunction (also reported on the potential free alarm contact).

DISPOSITIVI DI CONTROLLO E DI PROTEZIONE

CONTROL AND PROTECTION DEVICES

Tutti i modelli sono equipaggiati di serie con un pressostato per il comando del ventilatore per il controllo della pressione del condensatore. Inoltre, i modelli ACT 3...160 sono dotati di protezioni per il controllo della pressione del sistema. Le protezioni sono:

- pressostato di sicurezza per alta pressione del refrigerante (per ACT 80...160);
- pressostato di sicurezza per bassa pressione del refrigerante (per ACT 80...160);
- termostato di sicurezza a rampa manuale (per ACT 35...160), che arresta il compressore (irrigorifero) in caso di alta temperatura del refrigerante;
- termostato di sicurezza a rampa manuale (per ACT 35...160), che arresta il compressore (irrigorifero) in caso di alta temperatura del refrigerante;
- termostato di sicurezza a rampa manuale (per ACT 35...160), che arresta il compressore (irrigorifero) in caso di alta temperatura del refrigerante;


All models are fitted with a fan pressure switch to control the refrigerant condensing.

- ACT 35 and 160, are equipped with some specific devices to protect the components of the unit:
- high temperature pressure switch (for ACT 80...160);
- low temperature pressure switch (for ACT 80...160);
- re-set high temperature cut-out (for ACT 35...160), which stops the refrigerating compressor when discharge temperature is too high (e.g. clogged or blocked condenser). As option the temperature cut-out can be mounted on ACT 3...40 models.

SCARICATORE DI CONDENSA - CONDENSATE DRAIN

I modelli ACT 3...160 sono equipaggiati di un sistema elettronico temporizzato per lo scarico della condensa interfacciato con lo strumento DMC34. Il tempo di scarico ed il tempo di pausa tra un intervento e l'altro sono regolabili. Il gruppo di scarico comprende anche una valvola a sfera con un tempo di chiusura regolabile. In alternativa può essere installato uno scambiatore elettronico capacitivo.

ACT 3...160 models are fitted with an electronic system to drain the condensate interfaced to the DMC34 controller. Drainage and pause times are adjustable. Drainage group includes also a ball isolation valve and a strainer. A zero loss drain is available as an option.

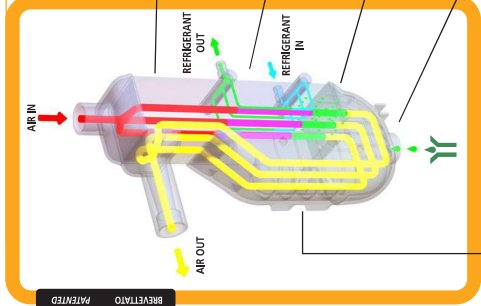

SCAMBIATORE DI ESSICCAZIONE ALU-DRY ALU-DRY HEAT EXCHANGER

Il modulo ultrasottile di essiccazione installato in un unico elemento lo scambiatore di calore ALU-DRY, pre-raffredda l'aria in ingresso al condensatore, riducendo il consumo di energia. Il flusso dell'aria unita lungo un percorso discendente, quindi con scarico della condensa naturalmente facilitato. I flussi complementari in controcorrente assicurano la massima efficienza dello scambiatore.

The ultra-thin drying module, pre-cools the air entering the condenser, reducing energy consumption. The air flows down in a single unit, making condensation removal easier. The complementary flows in counter-current ensure the maximum efficiency of the exchanger.

SEPARATORE DI CONDENSA TIPO "TUMBLER"

Dispositivo di separazione ad alta efficienza integrato nel modulo di essiccazione. Non richiede manutenzione ed offre il miglior vantaggio di creare un effetto di coalescenza a freddo per un ottimo essiccamento dell'aria.

High efficiency condensation separator is located within the heat exchanger module. No maintenance is required and it offers the best advantage of creating a cold coalescence effect for optimal drying of the air.

VOLUME DI RICOINVIO - LARGE CAPACITY

Generoso volume di accumulo, per un corretto funzionamento dell'essiccatore anche con aria in ingresso estremamente umida.

The large capacity separator is designed to hold condensate also at high humidity in compressed air.

BASSA PERDITA DI PRESSIONE - LOW PRESSURE DROP

L'ampia sezione dei canali di flusso assicura una velocità dell'aria ridotta, tale da limitare le perdite di carico.

The large cross section of flow channels leads to low air velocities and reduced pressure drop.

COMPRESSORE - COMPRESSOR

I modelli ACT 3...40 sono equipaggiati con compressori a pistoni ad alta efficienza. I modelli ACT 3...40 are fitted with high efficiency piston compressors sourced from major producers.

ROTATIVO - ROTARY
Per i modelli ACT 35...160 (con alimentazione monofase). Questa nuova tecnologia viene applicata in sostituzione dei tradizionali compressori frigoriferi alternativi. La compressione del refrigerante avviene tramite l'interazione tra uno statore cilindrico ed un nucleo eccentrico rotante, che serve la riduzione dell'usura delle parti in contatto con la conseguente ottimizzazione dell'affidabilità.

For models ACT 35...160 (with single-phase power supply). This is a new technology applied to refrigerants as an alternative to the traditional piston compressor. Compression of the refrigerant is achieved by way of interaction between a cylindrical stator and a rotating eccentric nucleus. In this method, the parts which come into contact with one another are wear-resistant and therefore more reliable.

SCROLL - SCROLL

A partire dal modello ACT 180 il compressore è di tipo scroll. L'argenteo ingegnere del motore a spirale assicura una compressione del refrigerante molto più silenziosa e con un consumo di energia inferiore. La spirale è realizzata in lega di alluminio e ha una vita media di oltre 100.000 ore.

From model ACT 180 on, the type of compressor used is the scroll. The scroll compressor performs well and has low energy consumption and refrigeration sector, the scroll compressor performs well and has low energy consumption. Compression of the refrigerant is achieved by way of two concentric coils: one fixed and the other mobile. The scrolls are wear-resistant, highly reliable and guarantee a high level of noise reduction.



LA VALVOLA DI BYPASS "GAS CALDO" - "HOT GAS" BYPASS VALVE
Di nuova concezione e con precisioni operative non ancora disponibili sul mercato, la valvola di bypass "gas caldo" previene la formazione di ghiaccio all'interno dell'evaporatore a qualsiasi condizione di carico, regolando durante il collaudo finale dell'essiccatore, non necessita di ulteriori regolazioni.

The precise and accurate hot gas bypass valve, which prevents the formation of ice inside the evaporator at any load condition, is a recent development unavailable in the past. The valve is set during final test and no further adjustments are necessary.



FACILE MANUTENZIONE - EASY MAINTENANCE

La serie ACT è stata progettata e costruita per agevolare eventuali operazioni di ispezione e manutenzione. Le cofanature, di facile rimozione, offrono l'immediato accesso alle parti del sistema. La chiara disposizione dei componenti, la semplice composizione del circuito refrigerante e la numerazione dei cavi dell'impianto elettrico facilitano le normali operazioni di controllo dell'operatore.

The ACT series has been designed and built to facilitate any inspection and maintenance operations that may prove necessary. The easy access to the components, the clear arrangement of the components, the simple composition of the refrigerant circuit and the numbering of the wires in the electrical system, facilitate the operator when carrying out standard controls.

I DETTAGLI TECNICI [ACT 180...3000] - TECHNICAL DETAILS [ACT 180...3000]

PANNELLO DI CONTROLLO - CONTROL PANEL



DMC 24 CONTROLLER

Oltre a richiudere le caratteristiche dello strumento DMC34, il nuovo controller offre l'innovativa funzione per la gestione programmata delle manutenzioni, un contatore ed interfaccia RS485 per la connessione a PC. Le quattro serie di temperatura ed il traduttore di pressione riportano sul display i valori di funzionamento e permettono la gestione delle funzioni ACT (Advanced Fan Control) per il controllo automatico della condensazione, e ASV (Advanced Alarm) per la segnalazione di anomalie. Il sistema di controllo è interfacciato al sistema di controllo del drenaggio (DMS) per la gestione dello scarico della condensa capacitivo, e AAL (Advanced Alarm Log) (Advanced Alarm Log) per la gestione dello scarico della condensa capacitivo, e AAL (Advanced Alarm Log) per la gestione dello scarico della condensa capacitivo, e AAL (Advanced Alarm Log) per la gestione dello scarico della condensa capacitivo.


DMC 24 CONTROLLER

In addition to the characteristics already present in the DMC34 model, this new controller features a new client protection function, which allows the user to perform the maintenance operations, a working meter and a RS485 interface for connection to a PC. The four temperature series and the pressure transducer report the operating values on the display and enable the functions ACT (Advanced Fan Control) for the control of refrigerant condensing, and the ASV (Advanced Service Warning) to receive advance warning of defects. Control and protective devices are now included in the DMC24 controller and interfaced to the operator through the functions AOS (Advanced Alarm System) for the management of the condensate drain (capacitive), and AAL (Advanced Alarm Log) (Advanced Alarm Log) for the management of the condensate drain (capacitive), and AAL (Advanced Alarm Log) for the management of the condensate drain (capacitive).

Di ispezione dal modello ACT 180 compreso sono dotati di un sistema di scarico capacitivo, interfacciato con lo strumento DMC24, in grado di garantire lo scarico completo della valle condensa senza il spreco d'aria compressa.

ACT 180 drive and larger are equipped with a zero loss drain system interfaced to the DMC24 to assure the drainage of the condensed water only with no air loss.



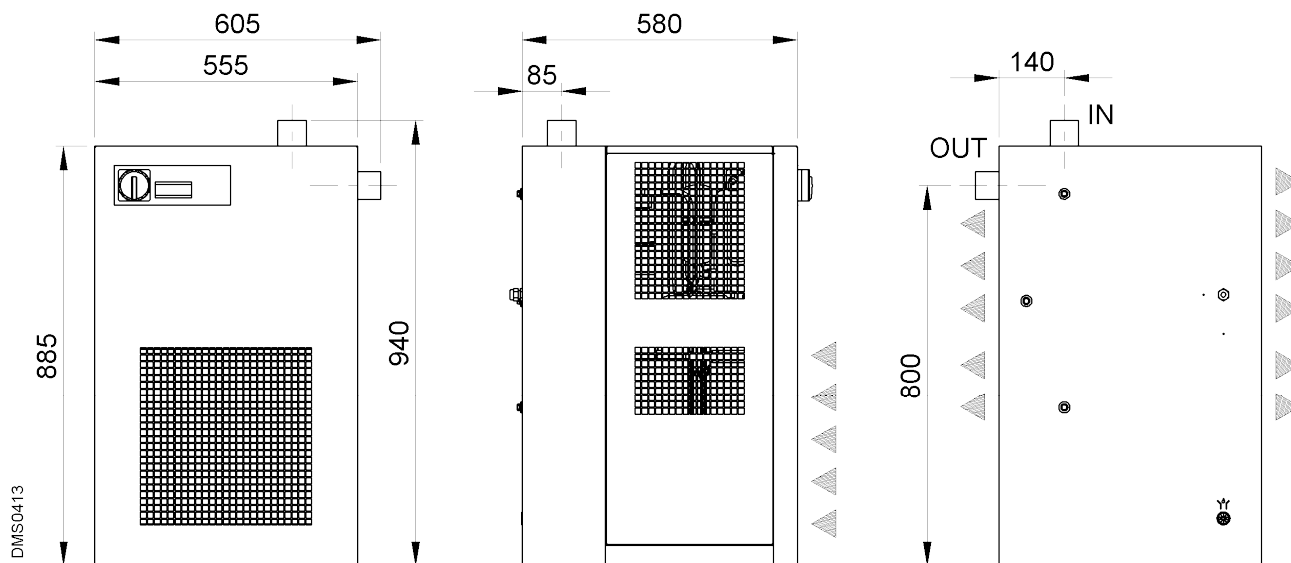

Air flow at nominal condition ¹	5500 l/min - 330 m ³ /h - 194 Scfm
Pressure DewPoint at nominal condition ¹	3 °C
Nominal ambient temperature	25 °C
Max. ambient temperature	50 °C
Min. ambient temperature	1 °C
Nominal inlet air temperature	35 °C
Max. inlet air temperature	70 °C
Nominal inlet air pressure	7 barg
Max. inlet air pressure	14 barg
Air pressure drop at nominal conditions - Δp	0.15 bar
Inlet-outlet air connection	G 1.1/2" BSP – F
Refrigerant type and quantity	R407C – 0.70 kg
Cooling air flow	450 m ³ /h
Heat rejection	3430 W
Power supply	1/230V/50Hz
Nominal electric consumption	700 W – 3.4 A
Full Load Amperage FLA	8.8 A
Max. noise level a 1m	< 70 dbA
Weight net - gross	55 – 67 kg

¹ The nominal condition refers to an ambient temperature of +25°C with inlet air at 7 barg and 35°C.

Correction factor for operating pressure changes :										
Inlet air pressure barg	4	5	6	7	8	10	12	14		
Correction factor	0.77	0.86	0.93	1.00	1.05	1.14	1.21	1.27		
Correction factor for ambient temperature changes :										
Ambient temperature °C	≤ 25	30	35	40	45	50				
Correction factor	1.00	0.96	0.90	0.82	0.72	0.60				
Correction factor for inlet air temperature changes :										
Air temperature °C	≤ 25	30	35	40	45	50	55	60	65	70
Correction factor	1.20	1.12	1.00	0.83	0.69	0.59	0.50	0.44	0.39	0.37
Correction factor for DewPoint changes :										
DewPoint °C	3	5	7	10						
Correction factor	1.00	1.09	1.19	1.37						

Subject to technical modification without notice. Errors not excluded.

FRIULAIR S.r.l. - 33050 CERVIGNANO DEL FRIULI (UD) - ITALY - Via Cisis, 36 – Fraz. Strassoldo

Tel. +39.0431.939416 r.a. - Fax +39.0431.939419 - E-MAIL com@friulair.com



IT DICHIARAZIONE DI CONFORMITÀ UE
 EN EU DECLARATION OF CONFORMITY
 FR DÉCLARATION UE DE CONFORMITÉ
 DE EU-KONFORMITÄTSERLÄRUNG
 ES DECLARACIÓN UE DE CONFORMIDAD
 PT DECLARAÇÃO UE DE CONFORMIDADE

FRIULAIR s.r.l. via Cisis, 36 - Cervignano del Friuli (UDINE) - ITALY

IT	Dichiara sotto la sua esclusiva responsabilità che l'essiccatore per aria compressa:
EN	Declares under its sole responsibility that the dryer for compressed air:
FR	Déclare sous son entière responsabilité que le sécheur par réfrigération:
DE	Erklärt unter ihrer alleinigen Verantwortung, dass der Kältetrockner:
ES	Declara bajo su exclusiva responsabilidad que el secador para aire comprimido:
PT	Declara sob a sua exclusiva responsabilidade que o secador de ar comprimido:

IT	Modello	FR	Modèle	ES	Modelo	(Model
EN	Model	DE	Modell	PT	Modelo	

IT	Numero di serie	FR	N° de série	ES	N° de fábrica	(Serial No.)
EN	Serial No.	DE	Seriennummer	PT	N° de fábrica	

IT	È conforme alle direttive europee:
EN	Is in conformity with the European Union Directives:
FR	Est conforme aux directives européennes:
DE	Ist in Übereinstimmung mit der Europäischen Richtlinien:
ES	Es conforme a las directivas europeas:
PT	Está em conformidade às directivas europeias:
2014/68/EU – Notified Body: Irish Engineering Services, Dublin, IE - No. 2820 – Module H	
2006/42/EC	
2014/30/EU	
2014/35/EU	
2011/65/EU	

IT	Norme:	FR	Normes:	ES	Normas:
EN	Norms:	DE	Normen:	PT	Normas:
ASME VIII Div.1		EN378-2		EN14119	
EN12100		EN12451		EN14120	
EN60204-1				EN61000-6-2	
				EN10028-3	
				EN61000-6-4	

IT	Nome e indirizzo della persona autorizzata a costituire il fascicolo tecnico:
EN	Name and address of the person authorized to compile the technical file:
FR	Le nom et l'adresse de la personne autorisée à constituer le dossier technique:
DE	Name und Anschrift der Person, die bevollmächtigt ist, die technischen Unterlagen zusammenzustellen:
ES	Nombre y dirección de la persona facultada para elaborar el expediente técnico:
PT	Nome e endereço da pessoa autorizada a compilar o processo técnico:
Eric Raffaglio – via Cisis, 36 – Cervignano del Friuli (UDINE) - ITALY	

IT	La presente dichiarazione di conformità è rilasciata sotto la responsabilità esclusiva del fabbricante.
EN	This declaration of conformity is issued under the sole responsibility of the manufacturer.
FR	La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.
DE	Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller.
ES	La presente declaración de conformidad se expide bajo la exclusiva responsabilidad del fabricante.
PT	A presente declaração de conformidade é emitida sob a exclusiva responsabilidade do fabricante.

IT	Luogo / Data	FR	Lieu / Date	ES	Lugar / Fecha	Cervignano del Friuli , (Date)
EN	Place / Date	DE	Ort / Datum	PT	Lugar / Data	

IT	Amministratore Delegato	DE	CEO
EN	CEO	ES	CEO
FR	PDG	PT	CEO

Luigi Vaccaro

Reference: MTender ID [ocds-b3wdp1-MD-1654006644605](#)To: [CENTRUL PENTRU ACHIZITII PUBLICE CENTRALIZATE IN SANATATE](#)

Name of project: "Medical devices (Medical oxygen production station) according to the needs of IMSP Clinical Hospital for Traumatology and Orthopedics for 2022 (repeated)"

Declaration

We FRIULAIR SRL, official manufacturers of REFRIGERATION AIR DRYERS & ACCESSORIES, Italian Company having factories at via Cisis, 36 - Frazione Strassoldo — 33052 Cervignano del Friuli (UD) - Italy, do hereby confirm the below listed specifications:


COMPRESSED AIR DRYING SYSTEM 1 pc. Model: ACT55	
Refrigerated air dryer, air cooled	yes
Nominal working pressure 7 bar	yes
Working pressure supported by vessel max 14 bar	yes
Pressure drop on dryer @nominal conditions max 0.15 bar	yes
Drying capacity, at 7 bar @ 25°C/35°C = 5,5 m ³ / min.	yes
Ecological refrigerant R407C	yes
Guaranteed dew point @nominal conditions $\leq +3\text{ °C} - +5\text{ °C}$	yes
Dew point sensor	yes
Alarm when the dew point is exceeded	yes
Power supply 230/50 V / Hz +/- 10%	yes
Standard electric motor type	yes
Ambient temperature $\geq +1\text{ °C} \text{ \& } \leq +50\text{ °C}$	yes
Air inlet temperature $\geq +1\text{ °C} \text{ \& } \leq +70\text{ °C}$	yes
Dryer works automatically, controlled by an electronic system with display	yes
Condensate separator with automatic purge	yes
The dryer operates continuously	yes
Control panel	yes
CE type conformity marking	yes
All components of the system are new (unused). Year of production is after 2022	yes
The unit REFRIGERATION AIR DRYERS & ACCESORIES ACT55, qty. 1, will be made available for shipment in a time not exceeding the 75 (seventy-five) days from Order Confirmation and the receipt of the contractual down payment (notified by your bank).	

Cervignano del Friuli (UD), June 14th, 2022

Friulair S.r.l.

Mr. Sandro Mascellani

General Manager

**FRIULAIR S.R.L.**

33052 CERVIGNANO DEL FRIULI (UD)

Fraz. STRASSOLDI - ITALY

Via Cisis, 36 - S.S. 352 km. 21

Tel. 0431.939416 - Fax 0431.939419

Part. IVA: 00430110312

INFORMATION LETTER

To whom it may concern

We, **FRIULAIR S.R.L.**, located in *Via Cisis, 36, 33052 Cervignano del Friuli UD, Italy*, who are official producers (manufacturers) of **REFRIGERATION AIR DRYERS & ACCESORIES** declare that we provide relevant certificates of conformity for our products with each delivery, as these are issued to a specific product and tied to a specific serial number. Therefore we cannot issue any declaration of conformity in advance for any products. We can only supply a declaration of conformity already issued for a product, as “MODEL” that can only be used as such.

Cervignano del Friuli (UD), June 14th, 2022

Friulair S.r.l.

Mr. Sandro Mascellani

General Manager

FRIULAIR S.R.L.
33052 CERVIGNANO DEL FRIULI (UD)
Fraz. STRASSOLDO - ITALY
Via Cisis, 36 - S.S. 352 km. 21
Tel. 0431.939416 - Fax 0431.939419
Part. IVA: 00430110312

INFORMATION LETTER

To whom it may concern

We, **FRIULAIR S.R.L.**, located in *Via Cisis, 36, 33052 Cervignano del Friuli UD, Italy*, who are official producers (manufacturers) of *REFRIGERATION AIR DRYERS & ACCESORIES* do hereby confirm that we provide under normal operating conditions according to our user manual (in particular referring, but not limiting to paragraphs of “Safety rules”, “Installation”, “Start-up”, “Technical data”, “Maintenance, troubleshooting,..”) a 10 years of useful time for: Compressed Air Dryer, Model ACT.

In case of use without following the manufacturer's recommendations, all these declared are considered null.

Cervignano del Friuli (UD), July 05th, 2022

Friulair S.r.l.

Mr. Sandro Mascellani

General Manager



FRIULAIR S.R.L.
33050 CERVIGNANO DEL FRIULI (UD)
Fraz. STRASSOLDI - ITALY
Via Cisis, 36 - S.S. 352 km. 21
Tel. 0431.939416 - Fax 0431.939419
Part. IVA: 00430110312