


Parametrii cazanului avariata,
ce urmează a fi înlocuit cu altul nou

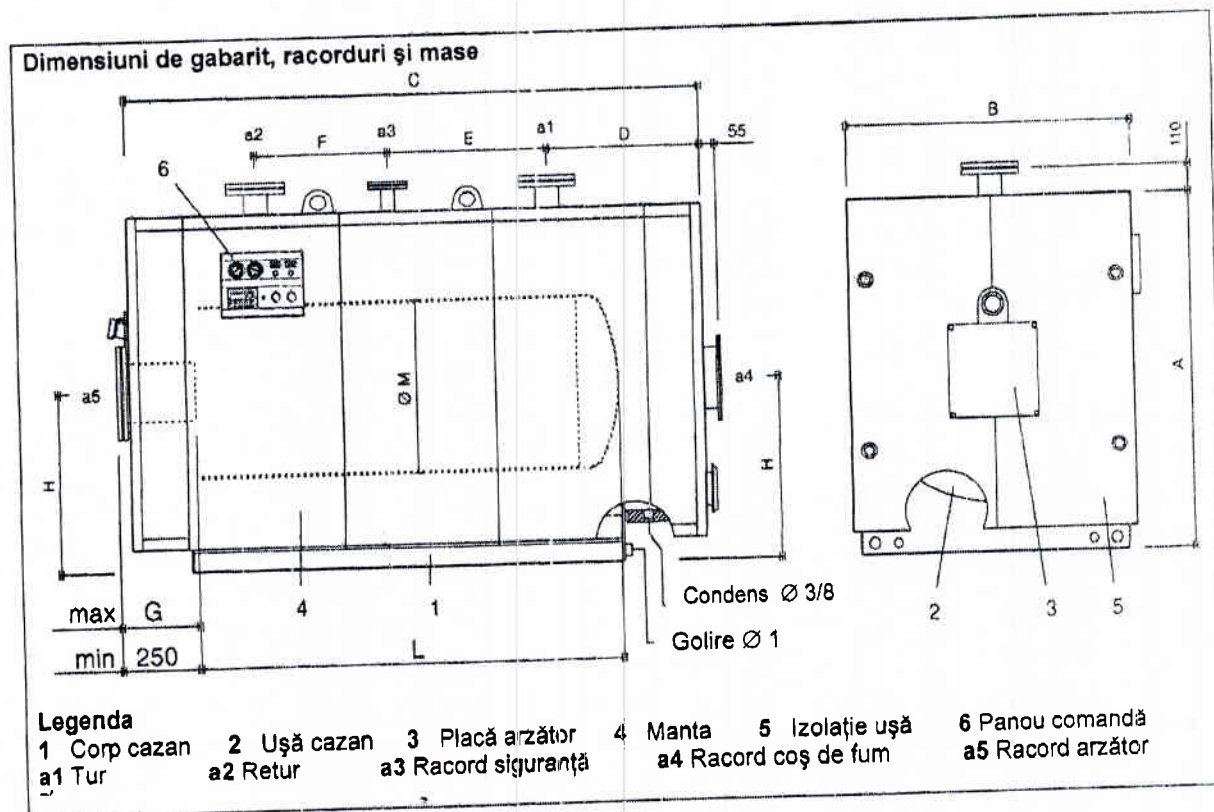

CIRCUITUL HIDRAULIC

MODEL PREXTHERM	A (mm)	B (mm)	C (mm)	D (mm)	E (mm)	F (mm)	G (mm)	H (mm)	L (mm)	M (mm)
550	1400	1230	2363	746	500	500	340	720	1600	700
620	1400	1230	2563	746	700	500	340	720	1800	700
800	1540	1365	2570	782	525	620	360	790	1850	800
1000	1540	1365	3020	782	975	620	360	790	2300	800
1300	1630	1465	3248	853	920	805	370	840	2500	850
1600	1780	1605	3532	975	1070	805	380	915	2700	950
2000	1880	1710	3658	1010	1100	805	400	965	2800	1000

MODEL PREXTHERM	a1-a2	a3 (Ø*)	a4 (mm)	a5 (mm)	Masa netă fără apă (kg)	Masa netă cu apă (kg)
550	DN 100	DN 40	350	240	1150	2002
620	DN 100	DN 40	350	240	1240	2176
800	DN 125	DN 65	400	270	1580	2640
1000	DN 125	DN 65	400	270	1830	3120
1300	DN 150	DN 65	450	300	2290	3900
1600	DN 150	DN 100	450	300	3000	5260
2000	DN 150	DN 100	500	300	3470	6220

- Legenda**
1 Corp cazan
2 Ușă cu placă portarător
3 Cameră gaze arse
4 Manta
5 Izolație termică

