


Nr. de inv. orig.	Data și semnătura	Nr. de inv. schimb.

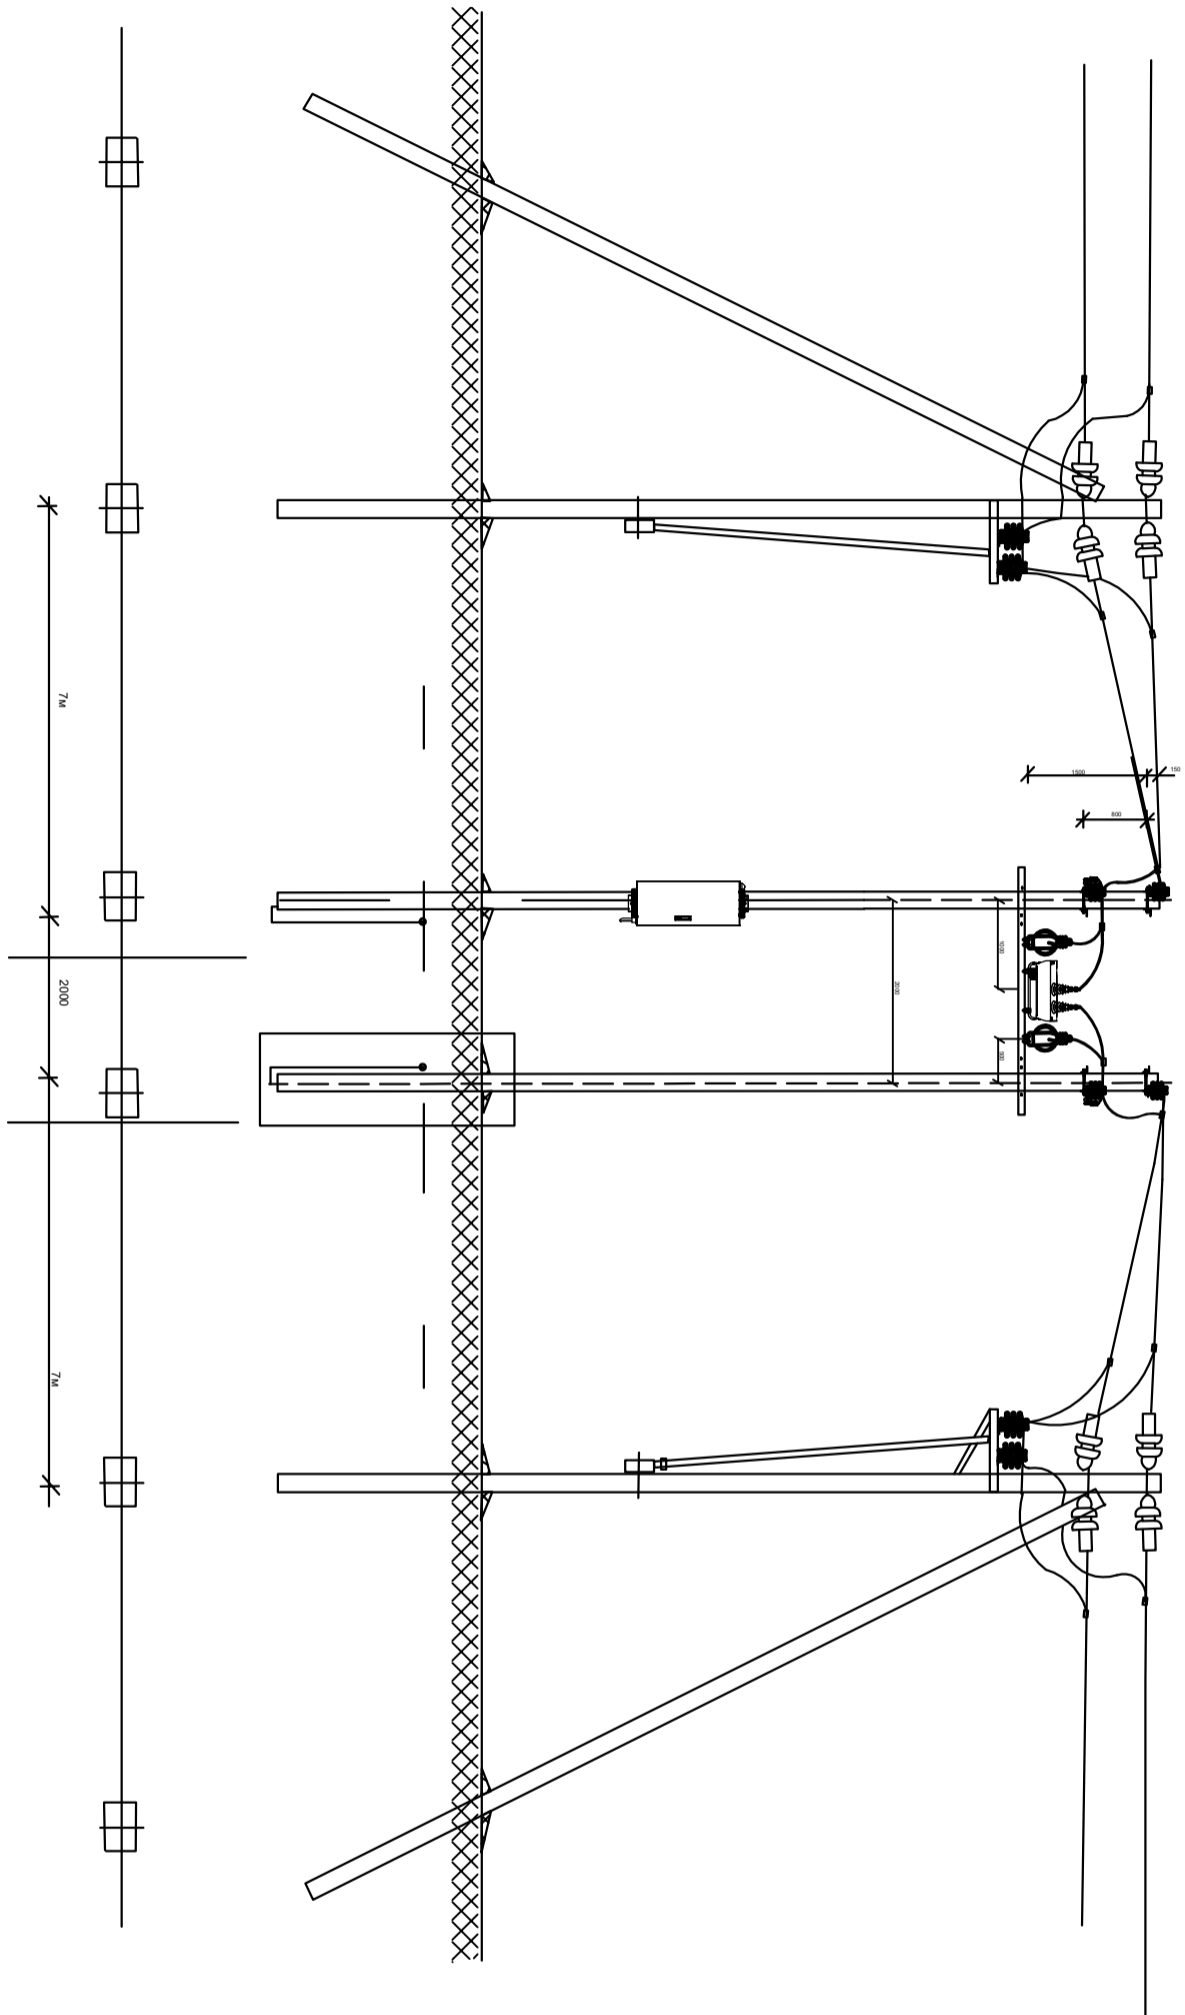

69-CM			
<i>Automatic Circuit 3-phase Recloser rated at 15.5 kV equipped with RC-10 control cubicle OSM 15-16-800-310</i>			
Nr. sec.	Coala	Nr. doc.	Semnăt
Sp. princ.	Bîrsan V.		03.18
Verificat	Noga L.		03.18
Elaborat	Codreanu I.		03.18
pilon de capăt pentru separatorul-fuzibil			Faza
Концевая опора для предохранителя-разъединителя			Plansa
			4
			11
			Planse
			PE
			"ABSOLUT ENERGIE" SRL