


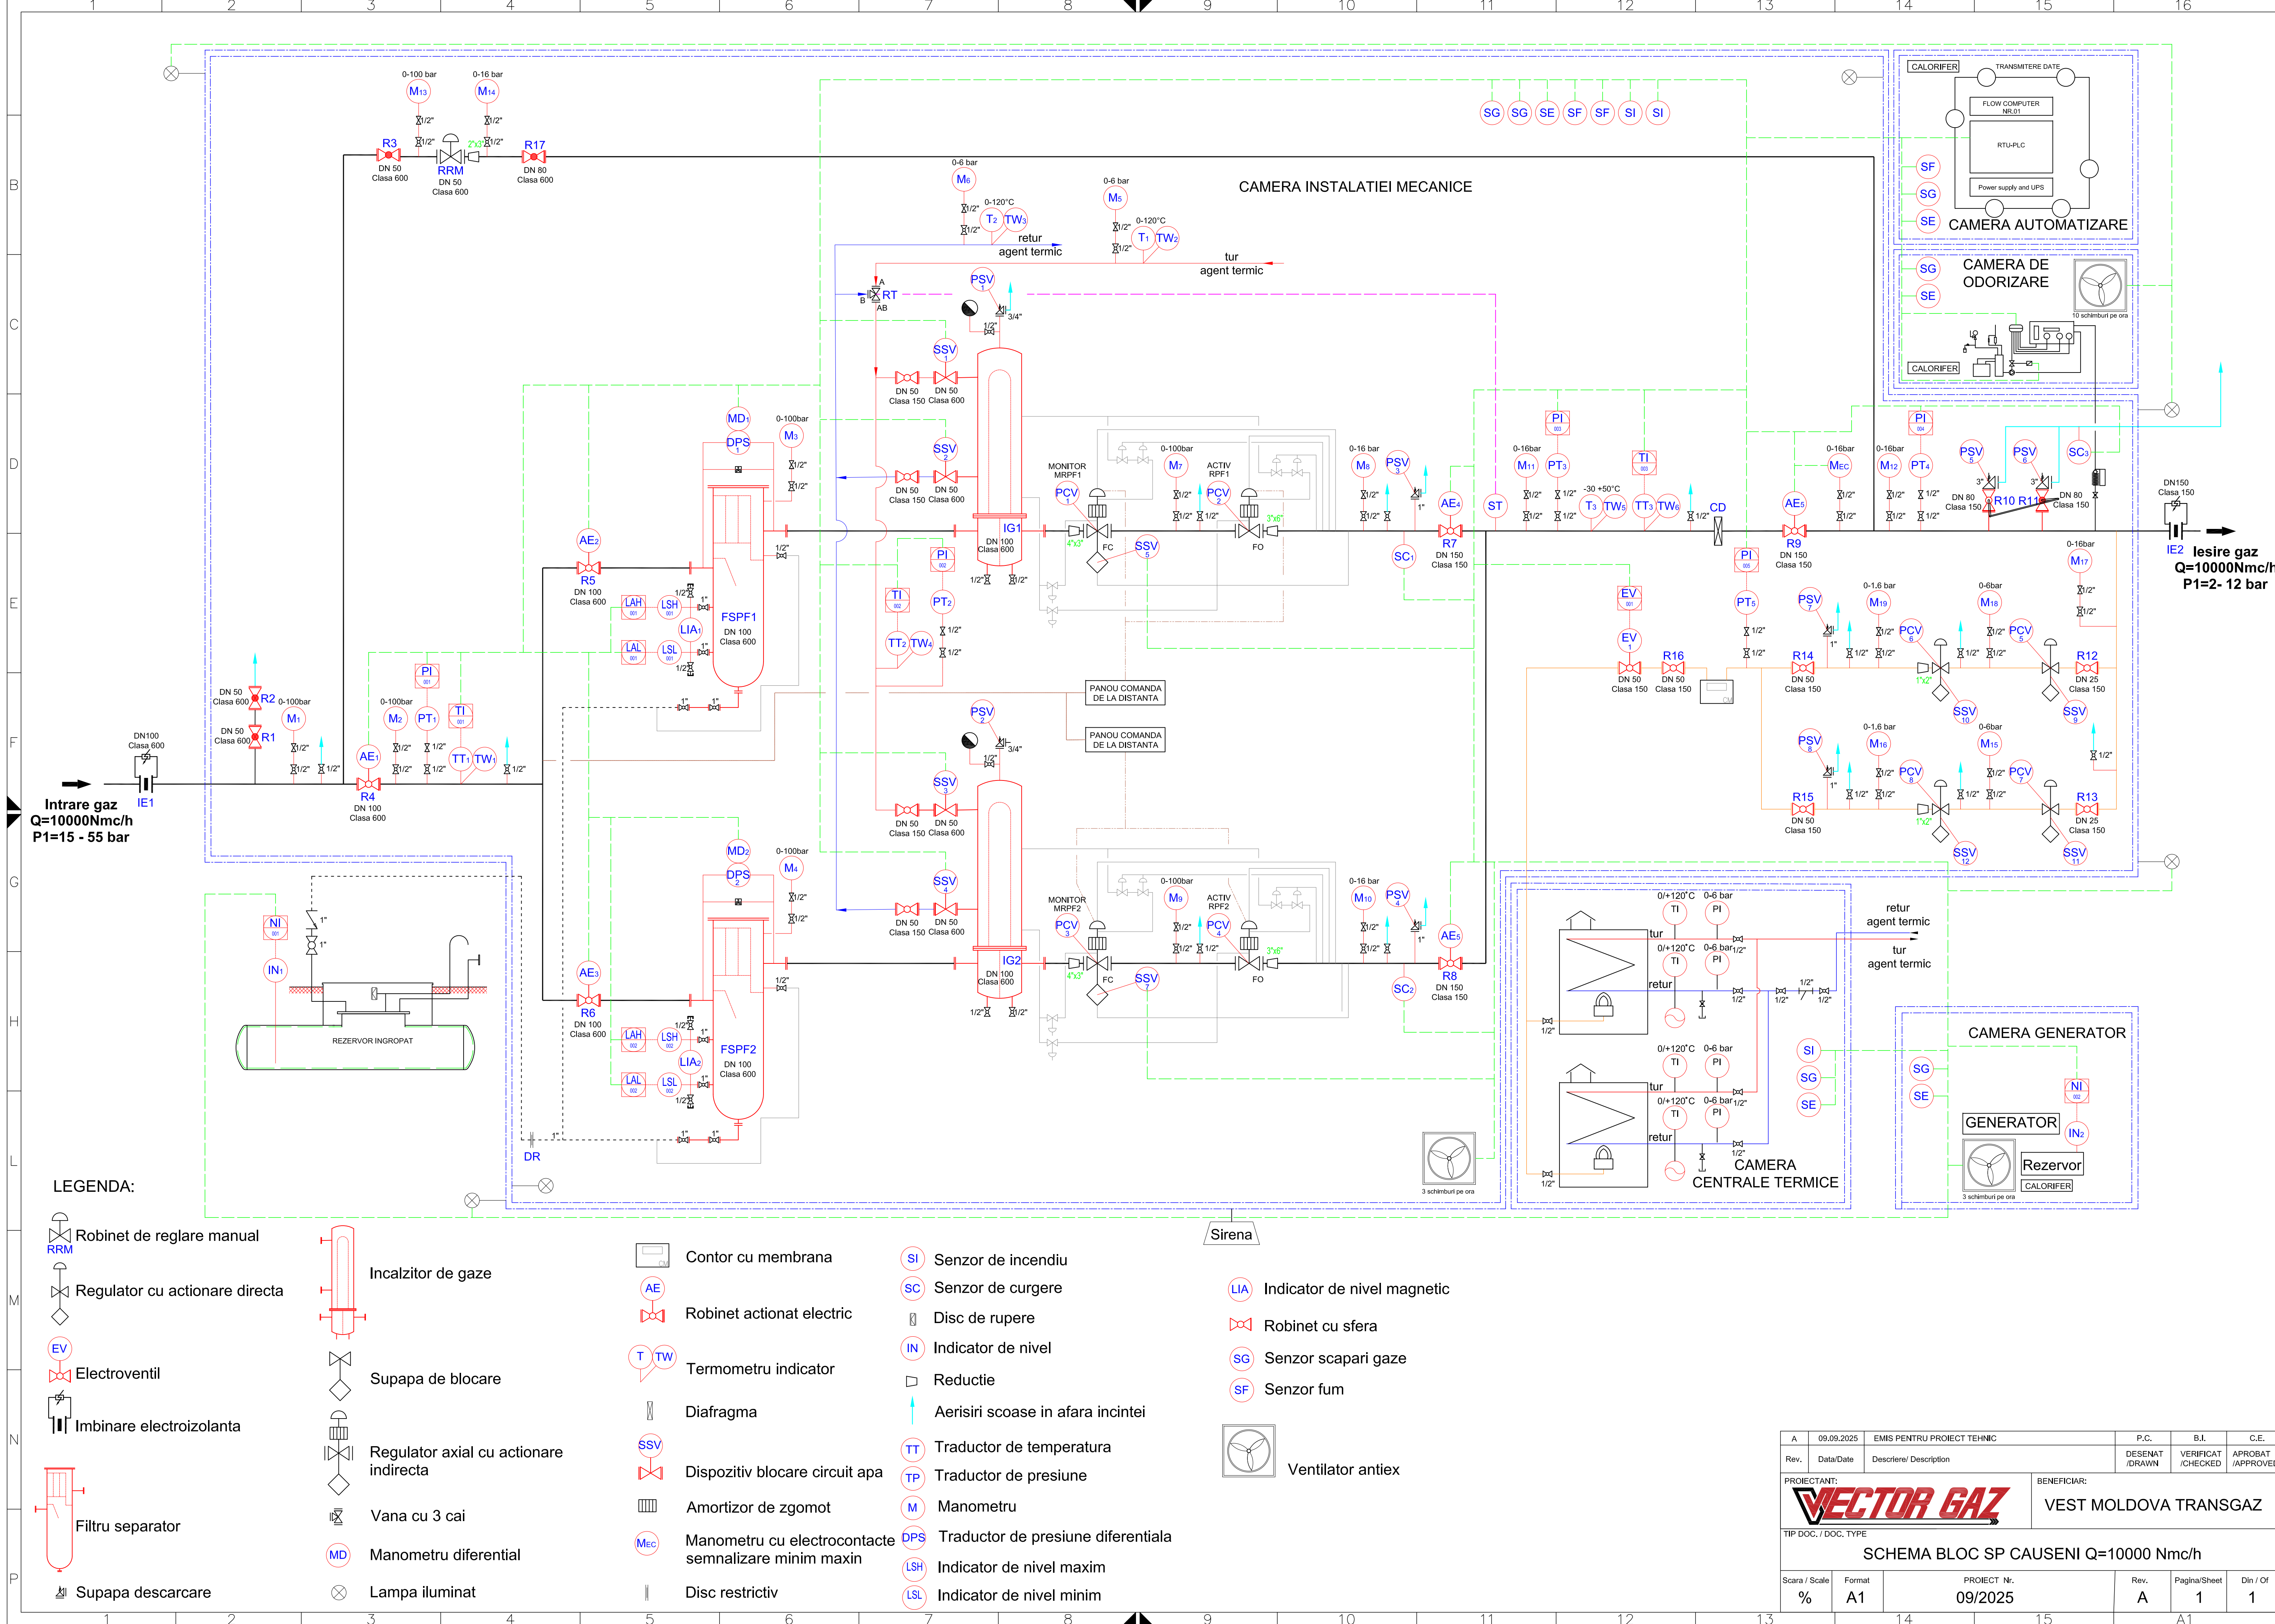

Intrare gaz
Q=10000Nmc/h
P1=15 - 55 bar

IE2 iesire gaz
Q=10000Nmc/h
P1=2- 12 bar

LEGENDA:

- Robinet de reglare manual

Regulator cu actionare directa

Electroventil

Imbinare electroizolanta

Filtru separator

Supapa descarcare
- Incalzitor de gaze

Supapa de blocare

Regulator axial cu actionare indirecta

Vana cu 3 cai

Manometru diferential

Lampa iluminat
- Contor cu membrana

Robinet actionat electric

Termometru indicator

Diafragma

Dispozitiv blocare circuit apa

Amortizor de zgomot

Manometru cu electrocontacte semnalizare minim maxim

Disc restrictiv
- Senzor de incendiu

Senzor de curgere

Disc de rupere

Indicator de nivel

Reductie

Aerisiri scoase in afara incintei

Traductor de temperatura

Traductor de presiune

Manometru

Traductor de presiune diferentiala

Indicator de nivel maxim

Indicator de nivel minim
- Indicator de nivel magnetic

Robinet cu sfera

Senzor scapari gaze

Senzor fum

Ventilator antiexp

A	09.09.2025	EMIS PENTRU PROIECT TEHNIC		P.C.	B.I.	C.E.	
Rev.	Data/Date	Descriere/ Description		DESENAT /DRAWN	VERIFICAT /CHECKED	APROBAT /APPROVED	
PROIECTANT: 				BENEFICIAR: VEST MOLDOVA TRANSGAZ			
TIP DOC. / DOC. TYPE							
SCHEMA BLOC SP CAUSENI Q=10000 Nmc/h							
Scara / Scale	Format	PROIECT Nr.			Rev.	Pagina/Sheet	Din / Of
%	A1	09/2025			A	1	1