

TEST REPORT EN14825:2016	
Report Number:	GDKA20201028001
Date of issue:	28 Oct,2020
Total number of pages:	8
Tested by (name+signature):	HE RI LANG 何日朗
Approved by (name+signature):	CHEN GANG QUAN 陈钢权
	
Applicant's name:	HISENSE (GUANGDONG) AIR CONDITIONING Co., Ltd.
Address:	No. 8 HISENSE ROAD, ADVANCED MANUFACTURING JIANGSHA DEMONSTRATION PARK, JIANGMEN CITY, GUANGDONG PROVINCE, P.R.CHINA
Standard:	EN14825:2016 COMMISSION REGULATION EU No 626:2011 COMMISSION REGULATION EU No 2016/2282 COMMISSION REGULATION EU No 2017/254
Test item description:	Split type air-Conditioner (Room Air Conditioner)
Trade Mark:	Hisense
Manufacturer:	HISENSE (GUANGDONG) AIR CONDITIONING Co., Ltd.
Model/Type reference:	REA26IN KC / REA26OUT KC
Ratings:	220-240V~, 50Hz, R32, IPX4 for outdoor unit,
Rev.02: Add new panel.	

List of Attachments (including a total number of pages in each attachment):

1.Photo document 2.Hisense Europe Model Name

Summary of testing:

The products tested comply with the requirements of EN14825:2016

Tests performed :

The appliances comply with the above standards.

Tests Date: 2020.10.20-2020.10.26

Tests Result: Pass

Testing location:

No. 8 HISENSE ROAD, ADVANCED
MANUFACTURING JIANGSHA DEMONSTRATION
PARK, JIANGMEN CITY, GUANGDONG PROVINCE
P.R.CHINA

Pdesign Capacity/SEER Cooling: 2.6KW/6.1

Pdesign Capacity/SCOP Heating(AVERAGE): 2.0KW/4.0

Test laboratory Information:

Name: Testing Center of Hisense(Guangdong) Air Conditioner Co., Ltd.

Address: No. 8 HISENSE ROAD, ADVANCED MANUFACTURING JIANGSHA DEMONSTRATION
PARK, JIANGMEN CITY, GUANGDONG PROVINCE, P.R.CHINA

Laboratory Accreditation Certificate:

Shown on page 3

Copy of marking plate:

The artwork below may be
only a draft.

MODE		COOLING	HEATING
CAPACITY	W	2600	2700
POWER INPUT (FOR INDOOR UNIT ONLY)	W	25	25
CURRENT (FOR INDOOR UNIT ONLY)	A	0.25	0.25
RATED POWER INPUT (FOR INDOOR UNIT ONLY)	W	40	
RATED CURRENT (FOR INDOOR UNIT ONLY)	A	0.25	
MAX DISCHARGE PRESSURE	MPa	4.15	
MAX SUCTION PRESSURE	MPa	1.6	
SOUND POWER	dB(A)	56	
POWER SUPPLY: 220V-240V~/50Hz		AIR FLOW: 550 m ³ /h	
ANTI-ELECTRIC SHOCK: CLASS I		REFRIGERANT: SAME AS OUTDOOR'S	
NET WEIGHT: 7.1kg		CLIMATE TYPE: T1	
ELECTRIC CHARACTERISTICS ARE ONLY FOR INDOOR UNIT.			

REA26IN KC
ROOM AIR CONDITIONER



Made In P.R.C.
Hisense Corporation

MODE		COOLING	HEATING
CAPACITY	W	2600	2700
POWER INPUT	W	855	700
CURRENT	A	3.9	3.1
RATED POWER INPUT	W	1500	
RATED CURRENT	A	7.5	
MAX DISCHARGE PRESSURE	MPa	4.15	
MAX SUCTION PRESSURE	MPa	1.6	
SOUND POWER	dB(A)	62	
POWER SUPPLY: 220-240V~/50Hz		NET WEIGHT: 23kg	
ANTI-ELECTRIC SHOCK: CLASS I		CLIMATE TYPE: T1	
DEGREES OF PROTECTION: IPX4		Contains fluorinated greenhouse gases covered by the Kyoto Protocol	
MAX. PRESSURE OF COIL: 20MPa		GWP:675; 0.311 tonnes CO ₂ equivalent	
REFRIGERANT: R32/0.46kg			

REA26OUT KC
ROOM AIR CONDITIONER



Made In P.R.C.
Hisense Corporation



**China National Accreditation Service for Conformity Assessment
LABORATORY ACCREDITATION CERTIFICATE
(Registration No. CNAS L7450)**

**Testing Center of Hisense (Guangdong) Air Conditioner
Co., Ltd.**

No.8, Hisense Road, Advanced Manufacturing Jiangsha Demonstration Park,
Jiangmen, Guangdong, China

is accredited in accordance with ISO/IEC 17025: 2005 General Requirements for the Competence of Testing and Calibration Laboratories(CNAS-CL01 Accreditation Criteria for the Competence of Testing and Calibration Laboratories) for the competence to undertake the service described in the schedule attached to this certificate.

The scope of accreditation is detailed in the attached schedule bearing the same registration number as above. The schedule form an integral part of this certificate.

Date of Issue: 2018-02-12

Date of Expiry: 2024-02-11

Date of Initial Accreditation: 2015-02-04

Signed on behalf of China National Accreditation Service for Conformity Assessment

A handwritten signature in black ink, appearing to be "Qianhua".

China National Accreditation Service for Conformity Assessment(CNAS) is authorized by Certification and Accreditation Administration of the People' s Republic of China (CNCA) to operate the national accreditation schemes for conformity assessment. CNAS is a signatory of the International Laboratory Accreditation Cooperation Mutual Recognition Arrangement (ILAC-MRA) and the Asia Pacific Laboratory Accreditation Cooperation Mutual Recognition Arrangement (APLAC-MRA). The validity of the certificate can be checked on CNAS website at <http://www.cnas.org.cn/english/findanaccreditedbody/index.shtml>

Test conditions

1.1. Rating conditions. Cooling mode

	Test mode	Outdoor heat exchanger		Indoor heat exchanger	
		Inlet dry bulb temperature °C	Inlet wet bulb temperature °C	Inlet water temperature °C	Inlet wet bulb temperature °C
Standard rating conditions	A	35	-	27	19
Part load conditions according the standard EN 14825:2018	B	30	-	27	19
	C	25	-	27	19
	D	20	-	27	19

1.2. Rating conditions for air-to-air units. Heating mode

	Test mode	Outdoor heat exchanger		Indoor heat exchanger	
		Inlet dry bulb temperature °C	Inlet wet bulb temperature °C	Inlet water temperature °C	Inlet wet bulb temperature °C
Standard rating conditions	R	7	6	20	-
Part load conditions according the standard EN 14825:2016 for heating season Average	A(A)	-7	-8	20	-
	B(A)	2	1	20	-
	C(A)	7	6	20	-
	D(A)	12	11	20	-
	E(A)	-10 (TOL)	-	20	-
	F(A)*	-7 (Tbiv)	-8	20	-
Part load conditions according the standard EN 14825:2016 for heating season Warmer	B(W)	2 (TOL)	1	20	-
	C(W)	7	6	20	-
	D(W)	12	11	20	-
	F(W)**	4 (Tbiv)	3	20	-
	E(C)	-20 (TOL)	-	20	-
	F(C)***	-10 (Tbiv)	-	20	-

* To reduce the tests, for Average conditions, is assumed Tbiv=-7°C.

** To reduce the tests, for Warmer conditions, is assumed Tbiv=4°C.

EU SEER/SCOP Test 欧盟SEER/SCOP测试

Version 1.0

Test Standard 测试标准:	<input checked="" type="checkbox"/> (EU) No 626/2011	<input checked="" type="checkbox"/> (EU) No 206/2012	<input checked="" type="checkbox"/> EN14825	<input checked="" type="checkbox"/> EN 14511	<input checked="" type="checkbox"/> EN 12102	<input type="checkbox"/> Other _____
---------------------	--	--	---	--	--	--------------------------------------

requirement: 产品审批要求:	
requirement for rated SEER 的额定制冷季节能效比要求 (%)	requirement for rated SCOP 额定制热季节性能系数要求 (%)
<input type="checkbox"/> >=100%	<input type="checkbox"/> >=100%
	requirement for Sound Power 声功率要求
<input type="checkbox"/> <=Rated	
<input checked="" type="checkbox"/> Inverter Single Split type 变频一拖一分体机 <input type="checkbox"/> On/off Single Split type 定速一拖一分体机 <input type="checkbox"/> Inverter Multisplit type 变频一拖多分体机 <input type="checkbox"/> On/off Multisplit type 定速一拖多分体机	

Test Date: 测试日期:	2020.10.26	Manufacturer Model: 工厂型号:	AS-09UW4RYRCA03
---------------------	------------	------------------------------	-----------------

Test Result:

Function (indicate to which function information applies)					If function includes heating: Indicate the heating season the information relates to. Indicated values should relate to one heating season at a time. Include at least the heating season 'Average'.				
Cooling	Y				Average (mandatory)	Y			
Heating	Y				Warmer (if designated)	Y			
					Colder (if designated)	N			

Item	Symbol	Rated value	Tested Value	Unit	Item	symbol	Rated value	Tested Value	unit
Design load					Seasonal efficiency				
cooling	Pdesignc	2.6	2.606	kW	cooling	SEER	6.1	6.11	—
heating/Average	Pdesignh	2.0	2.010	kW	heating/Average	SCOP(A)	4.0	4.02	—
heating/Warmer	Pdesignh	2.4	2.402	kW	heating/Warmer	SCOP(W)	5.1	5.10	—
heating/Colder	Pdesignh	NA	NA	kW	heating/Colder	SCOP(C)	NA	NA	—


Declared capacity (*) for cooling, at indoor temperature 27(19) °C and outdoor temperature Tj					Declared energy efficiency ratio (*), at indoor temperature 27(19) °C and outdoor temperature Tj				
Tj = 35 °C	Pdc	2.60	2.606	kW	Tj = 35 °C	EERd	3.1	3.11	—
Tj = 30 °C	Pdc	1.90	1.946	kW	Tj = 30 °C	EERd	5.1	5.18	—
Tj = 25 °C	Pdc	1.30	1.306	kW	Tj = 25 °C	EERd	7.5	7.56	—
Tj = 20 °C	Pdc	1.40	1.408	kW	Tj = 20 °C	EERd	10.0	10.05	—

Declared capacity (*) for heating/Average season, at indoor temperature 20 °C and outdoor temperature Tj					Declared coefficient of performance (*)/Average season, at indoor temperature 20 °C and outdoor temperature Tj				
Tj = - 7 °C	Pdh	1.77	1.775	kW	Tj = - 7 °C	COPd	2.8	2.82	—
Tj = 2 °C	Pdh	1.17	1.170	kW	Tj = 2 °C	COPd	3.9	3.99	—
Tj = 7 °C	Pdh	0.80	0.802	kW	Tj = 7 °C	COPd	5.0	5.08	—
Tj = 12 °C	Pdh	1.00	1.013	kW	Tj = 12 °C	COPd	6.7	6.78	—
Tj = bivalent temperature	Pdh	1.77	1.775	kW	Tj = bivalent temperature	COPd	2.8	2.82	—
Tj = operating limit	Pdh	1.68	1.682	kW	Tj = operating limit	COPd	2.6	2.61	—

Declared capacity (*) for heating/Warmer season, at indoor temperature 20 °C and outdoor temperature Tj					Declared coefficient of performance (*)/Warmer season, at indoor temperature 20 °C and outdoor temperature Tj				
Tj = 2 °C	Pdh	1.68	1.685	kW	Tj = 2 °C	COPd	3.45	3.460	—
Tj = 7 °C	Pdh	1.64	1.648	kW	Tj = 7 °C	COPd	4.68	4.690	—
Tj = 12 °C	Pdh	0.78	0.786	kW	Tj = 12 °C	COPd	6.50	6.510	—
Tj = bivalent temperature	Pdh	2.07	2.075	kW	Tj = bivalent temperature	COPd	3.90	3.940	—
Tj = operating limit	Pdh	1.68	1.685	kW	Tj = operating limit	COPd	3.45	3.460	—

Declared capacity (*) for heating/Colder season, at indoor temperature 20 °C and outdoor temperature Tj					Declared coefficient of performance (*)/Colder season, at indoor temperature 20 °C and outdoor temperature Tj				
Tj = - 7 °C	Pdh	NA	NA	kW	Tj = - 7 °C	COPd	NA	NA	—
Tj = 2 °C	Pdh	NA	NA	kW	Tj = 2 °C	COPd	NA	NA	—
Tj = 7 °C	Pdh	NA	NA	kW	Tj = 7 °C	COPd	NA	NA	—
Tj = 12 °C	Pdh	NA	NA	kW	Tj = 12 °C	COPd	NA	NA	—
Tj = bivalent temperature	Pdh	NA	NA	kW	Tj = bivalent temperature	COPd	NA	NA	—
Tj = operating limit	Pdh	NA	NA	kW	Tj = operating limit	COPd	NA	NA	—

Tj = -15 °C	Pdh	NA	NA	kW	Tj = -15 °C	COPd	NA	NA	—
Bivalent temperature					Operating limit temperature				
heating/Average	Tbiv	-7	NA	°C	heating/Average	Tol	-10	NA	°C
heating/Warmer	Tbiv	NA	NA	°C	heating/Warmer	Tol	NA	NA	°C
heating/Colder	Tbiv	NA	NA	°C	heating/Colder	Tol	NA	NA	°C
Power consumption of cycling					Efficiency of cycling				
cooling	Pcycc	NA	NA	kW	cooling	EERcyc	NA	NA	—
heating	Pcyhc	NA	NA	kW	heating	COPcyc	NA	NA	—
Degradation co-efficient cooling (**)	Cdc	0.25	NA	—	Degradation co-efficient heating (**)	Cdh	0.25	NA	—
Electric power input in power modes other than 'active mode'					Seasonal electricity consumption				
off mode	P _{OFF}	0.00100	0.00100	kW	cooling	Q _{CE}	149	149.3	kWh/a
standby mode	P _{SB}	0.00100	0.00100	kW	heating/Average	Q _{HE}	700	700	kWh/a
thermostat-off mode	P _{TO}	0.025	0.025	kW	heating/Warmer	Q _{HE}	659	659.4	kWh/a
crankcase heater mode	P _{CK}	NA	NA	kW	heating/Colder	Q _{HE}	NA	NA	kWh/a
Capacity control (indicate one of three options)					Other items				
fixed	N				Sound power level (indoor)	LWA	56	55.8	dB(A)
					Sound power level (outdoor)	LWA	62	61.6	dB(A)
staged	N				Global warming potential	GWP	675	NA	kgCO ₂ eq.
variable	Y				Rated air flow (indoor/outdoor)	—	—	—	m ³ /h
TEST CONCLUSION: 测试结论									
Are the SEER and SCOP TEST results Compliant or Non-Compliant? SEER/SCOP测试是否符合要求?								Compliant	

Tested by (name + signature)

Approved by (name + signature)

测试员 (姓名, 签名)

批准人 (姓名, 签名)

SOUND ACOUSTIC TEST REPORT

MANUFACTURER MODEL:

AS-09UW4RYRCA03

MANUFACTURER:

Hisense

TEST DATE :

2020.10

Cooling only model 单冷机

Cooling and Heating model 冷暖机

Window type 窗机

Split type 分体机

Portable 移动空调

Dehumidifier 除湿机

TEST CONDITION:

IDU Background noise:

18dB(A)

Connecting pipe length for split type:

5m

4m

7.5m

other _____

TEST RESULT:

Rated Sound Power dB(A)

Cooling mode


Indoor Unit Sound Power dB(A)

55.8dB(A)

Outdoor Unit Sound Power dB(A)

61.6dB(A)

Rating Label:

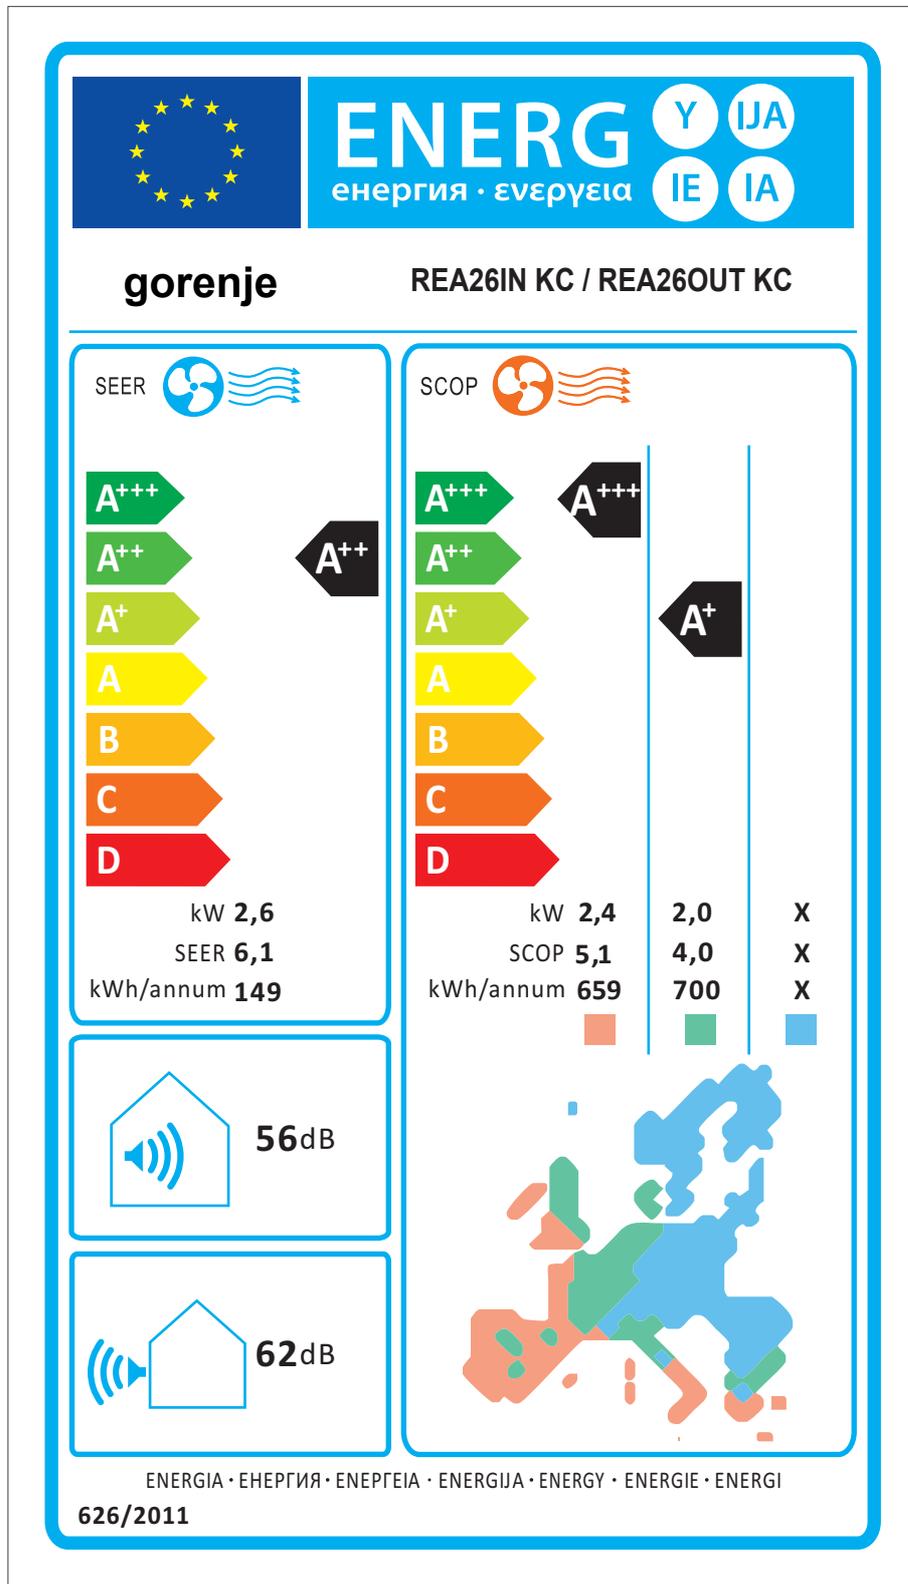

Indoor Unit:



Outdoor Unit:

