



Luminaire with increased IK and convenient tool-free service access, with four types of mounting brackets available as an accessory. Future-proof luminaire with Zhaga / NEMA connector option.

- Possible illuminance control
- Modern design
- Simple one person mounting
- Reliability



Other pictures



Code	Type of optics	Luminaire power [W]	Lumen luminaire [lm]	Efficacy [lm/W]	Colour temperature [K]	CRI/Ra	Operating temperature range [°C]
130822.7L162.190.002	O19	99	15000	152	5700	>70	-35 ... +50

Technical data

Mounting

on pillar $\varnothing 60/40$ mm, on outriggers $\varnothing 60/40$ mm

Body colour

gray

Optimum operating temperature

25°C

RAL

7035

Body

high pressure die-cast aluminum

Lateral Surface Wind Exposed

0.039 m²

Electrical data

Power supply efficiency
≥93%

Power
220-240V 50/60Hz
(permissible range 198-242 V)

Includes light source
yes

Type of equipment
D4i

Optical data

Way of lighting
direct

Type of optic
O19

Diffuser
tempered glass

Colour temperature [K]
5700

CRI/Ra
>70

MacAdam's steps
5

ULOR / DLOR
0% / 100%

Photobiological risk group
RG1

General data

Additional information

Tool-free access to the power supply, ZHAGA*, Corrosion protection, NTC, Power cable 2x1.5 mm² - 1.5m, 10kV surge protection, power supply with dimming function from 100% to 50% in 10% steps, power supply with protection against voltage fluctuations, overvoltage, temperature and overload, THD <8%, internal marking of the luminaire (manufacturer's name, model number, year of manufacture, rated voltage, rated frequency, luminaire power, colour temperature)

Other remarks

the pole and boom are not part of the luminaire

Lifetime LED L90
100 000 h

Warranty
10 years

*Pictures and dimensions of the standard luminaire (does not include the ZHAGA socket).

Changing the power supply model* does not affect the luminous flux behaviour tolerance (+/-10%) and luminaire power consumption +/-5% (*While maintaining the same current settings)

In order to apply the luminaire in an aggressive environment, for example with an increased concentration of sulfur, salt or other aggressive substances, a consultation with the LUG

Technical Preparation of Production Branch is required.

Luminous flux tolerance +/- 10%.

Power tolerance +/- 5%.

Lighting beam, light intensity distribution and light efficiency were examined in accordance with the EN ISO 17025:2005 norm for EN13032 norm series and the LM-79 norm.

Up-to-date product info and General Warranty Terms available on our website www.luglightfactory.com


Detailed information on luminous fluxes and powers for individual indexes are indicated on the product data sheet.

The parameters in the data sheet are given for Ta=25°C.


The operating temperature ranges apply only to luminaires used in the outdoor environment.

Colour temperature tolerance +/- 5%.

Dimensions

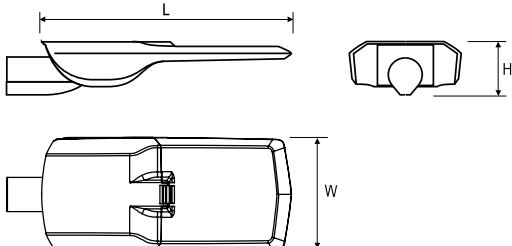Dimensions* [mm] LxWxH	Pallet quantity	Quantity in package	Net weight [kg]	
543x248x102	50	1	6.1	

Light beam curves

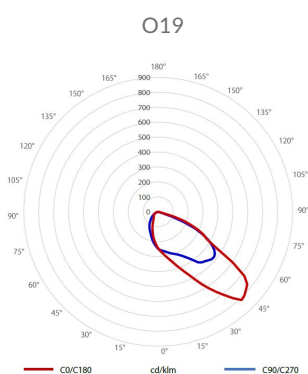



Łukasiewicz- IMiF PREDOM
Division
53, Krakowiaków Str.
02-255 WARSAW, POLAND

ENEC Certification Body registered under ID 30. Validity of ENEC licences can be checked at www.enec.com
Jednostka Certyfikująca ENEC zarejestrowana pod numerem ID 30. Ważność licencji można sprawdzić na www.enec.com

LICENCE

CERTIFICATE/CERTYFIKAT

to use the European Mark

Licencja na używanie europejskiego Znaku



Licence/Certificate No. / Licencja/ Certyfikat Nr 0296/ENEC/22

Under the conditions given in the following pages of this document, the licence to use the ENEC Mark in conjunction with the suffix 30, as shown above, has been issued to:

Zgodnie z warunkami przedstawionymi na następujących stronach tego dokumentu, licencja na używanie Znaku ENEC w połączeniu z przyrostkiem 30, jak ukazano powyżej, została wydana dla:

LUG Light Factory Sp. z o.o.

ul. Gorzowska 11, 65-127 Zielona Góra, Polska / Poland

For the products: *Dla wyrobów:*

Luminaires for road and street lighting *Oprawy oświetleniowe drogowe i uliczne*

Manufacturing place: *Miejsce Produkcji*

LUG Light Factory Sp. z o.o.

ul. Gorzowska 11, 65-127 Zielona Góra, Polska / Poland

Trade name: *Znak towarowy:*



Type(s)/Model(s): *Typ(y), model(e):*

URBINO LED IK10 family cl. II – series (see Appendix/ *patrz Załącznik*)

Technical data/ Dane Techniczne: 220-240V, 50/60Hz, IP 66, cl. II – details in the Appendix/*Szczegóły w Załączniku*

Complying with the following European Standards: *Zgodnymi z następującymi normami europejskimi*

EN 60598-2-3:2003

EN 60598-2-3:2003/A1:2011

EN IEC 60598-1:2021

EN IEC 60598-1:2021/A11:2022

EN 62262:2002

(the test reports/ *raporty z badań:* Ref. No. B10-3/124/B/22 + Att. No. 1 (EU GD and ND rep. ref. B10-3/124/B/1/22) dated 21.0.09.2022
B10-3/125/B/22 dated 30.08.2022 performed by the Testing Laboratory Łukasiewicz-IMiF PREDOM Division (Accreditation PCA AB 003).

Date: *Data*

30-09-2022

Signatures:

Name:

Józef Foks

Filip Walczak

Position:

Certification Office
Łukasiewicz- IMiF PREDOM

Leader of the Łukasiewicz- IMiF
PREDOM Division

This licence has been issued under the presumption and conditional on the fact that the licensee holds all necessary legal rights with regard to the product presented for testing and certification. The ENEC mark may be applied to the products as specified in this licence for the duration of the Licence Agreement. No. R6/ENEC/10/20 dated 2020-01-15 and under conditions of the Licence agreement. This licence is issued on 30-09-2022 and expires upon withdrawal any of the above mentioned standards.
Niniejsza licencja została wydana zgodnie z założeniem i pod warunkiem, że licencjodawca posiada wszelkie niezbędne prawa w odniesieniu do wyrobu przedstawionego do badań i certyfikacji. Znak ENEC może być stosowany na wyrobach wymienionych w niniejszej licencji przez okres obowiązywania Umowy licencyjnej Nr R6/ENEC/10/20 z dnia 2020-01-15 i na warunkach tej Umowy. Niniejsza licencja została wydana w dniu 30-09-2022 i traci ważność po wycofaniu którejkolwiek z wyżej wymienionych norm.




Additional information – see the Appendix.

Dodatkowe informacje – patrz Załącznik.



Test Report issued under the responsibility of:
Łukasiewicz - IMiF PREDOM Division

TEST REPORT IEC 62471 Photobiological safety of lamps and lamp systems	
Report Reference No.	B10-3/122/B/22
Date of issue	2022-08-23
Total number of pages	21
Name of Testing Laboratory preparing the Report	Łukasiewicz - IMiF PREDOM Division 02-255 Warszawa, ul. Krakowiaków 53, Poland
Applicant's name	LUG Light Factory Sp z.o.o.
Address	65-127 Zielona Góra, ul. Gorzowska 11, Poland
Test specification:	
Standard	IEC 62471:2006
Test procedure	CB
Non-standard test method	N/A
Test Report Form No.	IEC62471B
TRF Originator	VDE Testing and Certification Institute
Master TRF	Dated 2018-08-16
Copyright © 2018 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.	
This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.	
If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.	
This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.	
General disclaimer:	
The test results presented in this report relate only to the object tested. This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.	

Test item description	Luminaires for road and street lighting	
Trade Mark	LUG	
Manufacturer	LUG Light Factory Sp z o.o. ul. Gorzowska 11; 65-127 Zielona Góra, Poland	
Model/Type reference	URBINO LED IK10 family – series	
Ratings	220-240V, 50/60Hz, 102W, IP66, IK10, cl. II	
Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
<input checked="" type="checkbox"/>	CB Testing Laboratory:	Łukasiewicz - IMiF PREDOM Division
Testing location/ address	02-255 Warszawa, ul. Krakowiaków 53, Poland	
Tested by (name, function, signature)	J. Śmigrodzki	
Approved by (name, function, signature) ..	T. Małyska	
Supervised by (+ signature)	F. Walczak	
<input type="checkbox"/>	Testing procedure: CTF Stage 1:	
Testing location/ address		
Tested by (name, function, signature)		
Approved by (name, function, signature) ..		
<input type="checkbox"/>	Testing procedure: CTF Stage 2:	
Testing location/ address		
Tested by (name + signature)		
Witnessed by (name, function, signature) .:		
Approved by (name, function, signature) ..		
<input type="checkbox"/>	Testing procedure: CTF Stage 3:	
<input type="checkbox"/>	Testing procedure: CTF Stage 4:	
Testing location/ address		
Tested by (name, function, signature)		
Witnessed by (name, function, signature) .:		
Approved by (name, function, signature) ..		
Supervised by (name, function, signature) :		

List of Attachments (including a total number of pages in each attachment):

See Attachment No.1 to this test report (Report No. B10-3/122/B/1/22) 2 pages

Summary of testing: Tests Result – Positive

According to ISO / IEC Guide 98-4 for the assessment of compliance of the measurement result with the requirements, criterion B was chosen. 50% risk of incorrect assessment decision belongs to the customer and 50% risk of incorrect assessment belongs to the laboratory

Tests performed (name of test and test clause):

IEC 62471:2006

Testing location:

Łukasiewicz - IMiF PREDOM Division
02-255 Warszawa, ul. Krakowiaków 53, Poland

Summary of compliance with National Differences (List of countries addressed):

See Attachment No.1 to this test report (Report No. B10-3/122/B/1/22)

The product fulfils the requirements of EN 62471:2008

Copy of marking plate:



Test item particulars:	
Tested lamp	<input checked="" type="checkbox"/> continuous wave lamps <input type="checkbox"/> pulsed lamps
Tested lamp system.....	130822.5LR7B27S1405.201.B.V
Lamp classification group	<input checked="" type="checkbox"/> exempt <input type="checkbox"/> risk 1 <input type="checkbox"/> risk 2 <input type="checkbox"/> risk 3
Lamp cap	N/A
Bulb	ML2167043.W727.01A
Rated of the lamp.....	102 W, 220 - 240 V
Furthermore marking on the lamp.....	N/A
Seasoning of lamps according IEC standard	IEC 60589-1
Used measurement instrument	StellarNet UVN-50, IC2 Integrating cube
Temperature by measurement.....	25 °C
Information for safety use	N/A
Possible test case verdicts:	
– test case does not apply to the test object.....	N/A
– test object does meet the requirement	P (Pass)
– test object does not meet the requirement.....	F (Fail)
Testing:	
Date of receipt of test item	2022-07-11
Date (s) of performance of tests	2022-07-11 - 2022-08-23
General remarks:	
"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report.	
Throughout this report a <input checked="" type="checkbox"/> comma / <input type="checkbox"/> point is used as the decimal separator.	
Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60589-1:	
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> Not applicable
When differences exist; they shall be identified in the General product information section.	
Name and address of factory (ies).....	LUG Light Factory Sp. z o.o. ul. Gorzowska 11 65-127 Zielona Góra Poland

General product information and other remarks:

Name and address of the license holder:	LUG Light Factory Sp. z.o.o. ul. Gorzowska 11, 65-127 Zielona Góra - Poland
Address of the factory:	LUG Light Factory Sp. z .o. ul. Gorzowska 11, 65-127 Zielona Góra - Poland
Name of product:	Luminaires for road and street lighting
Type (model):	URBINO LED IK10 family - series (see bellow)
Trade mark :	LUG
Technical data:	
rated voltage	220 - 240V
rated frequency	50 / 60Hz
protection against electric shock	class I or class II
degree of protection	IP 66; IK10
ta	-40°C to 50°C -35°C to 50°C* -30°C to 50°C** -25°C to 50°C***

* - For luminaires equipped with:

- Vossloh Schwabe SPC/230/10K/i

** - For luminaires equipped with:

- Tridonic LCA 120W 300-1050mA
- Philips Xi FP 70W 0.3-1.0A NLD C150 230V sXt
- Philips Xi FP 110W 0.3-1.0A NLD C150 230V sXt
- Vossloh Schwabe SP/230/10K

*** - For luminaires equipped with:

- LACROIX DL-PAK 70

Choice sheet of the luminaires URBINO LED IK10 - series:**Example of symbol:**

130752.5LR7B40S2470.101.B.N.V.P.K.O

Designations used on the marking of luminaires (some designation may not appear in the name) :

- | | |
|-----------------------|---|
| 1. 13075 | - Code of the series Urbino LED IK10 with LED Cree XPG-3 modules |
| 13082 | - Code of the series Urbino LED IK10 with LED Luxeon 5050 modules |
| 2. 2 | - Color:
2: grey
5: graphite
0: another |
| 3. 5L | - Type of power supply:
2L - DIMM 1-10V
3L – DALI
5L – on-off
6L – on-off / DALI
7L – ZHAGA D4i
PL – programmable |
| 4. R7 | - CRI:
R7 = 70-79
R8 = 80-89 |
| 5. B40 | - Color temperature:
B22 = 2200K
B27 = 2700K
B30 = 3000K
B40 = 4000K
B57 = 5700K
B65 = 6500K |
| 6. S2470 | - Luminous flux (S2470 = 24700lm) |
| 7. 1 | - Safety Class I |
| 2 | - Safety Class II |
| 8. 01 | - Optic type – for road lighting
01 to 99 |
| 9. B.N.V.P.K.O | - Additional equipment
A - additional corrosion protection |

B - Tool-free access to the LED Driver

N - NEMA Socket

Z - ZHAGA Socket

T - NTC Sensor

W - Twilight Sensor

V - Surge Device Protector 10kV

Y - Surge Device Protector 20kV

P- Anti pressure vent

I- iBloc ("URBAN" smart city system)

K- Knife switch connector

C - RAL Color

After the review of the construction and components the luminaire 130822.5LR7B27S1405.201.B.V has been tested as the representative of all luminaires.

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
4	EXPOSURE LIMITS		P
4.1	General		P
	The exposure limits in this standard is not less than 0,01 ms and not more than any 8-hour period and should be used as guides in the control of exposure		P
	Detailed spectral data of a light source are generally required only if the luminance of the source exceeds $10^4 \text{ cd}\cdot\text{m}^{-2}$	see clause 4.3	P
4.3	Hazard exposure limits		P
4.3.1	Actinic UV hazard exposure limit for the skin and eye		P
	The exposure limit for effective radiant exposure is $30 \text{ J}\cdot\text{m}^{-2}$ within any 8-hour period		P
	To protect against injury of the eye or skin from ultraviolet radiation exposure produced by a broad-band source, the effective integrated spectral irradiance, E_s , of the light source shall not exceed the levels defined by:		P
	$E_s \cdot t = \sum_{200}^{400} \sum_t E_\lambda(\lambda, t) \cdot S_{UV}(\lambda) \cdot \Delta t \cdot \Delta \lambda \leq 30 \quad \text{J}\cdot\text{m}^{-2}$		P
	The permissible time for exposure to ultraviolet radiation incident upon the unprotected eye or skin shall be computed by:		P
	$t_{\max} = \frac{30}{E_s} \quad \text{s}$		P
4.3.2	Near-UV hazard exposure limit for eye		P
	For the spectral region 315 nm to 400 nm (UV-A) the total radiant exposure to the eye shall not exceed $10000 \text{ J}\cdot\text{m}^{-2}$ for exposure times less than 1000 s. For exposure times greater than 1000 s (approximately 16 minutes) the UV-A irradiance for the unprotected eye, E_{UVA} , shall not exceed $10 \text{ W}\cdot\text{m}^{-2}$.		P
	The permissible time for exposure to ultraviolet radiation incident upon the unprotected eye for time less than 1000 s, shall be computed by:		P
	$t_{\max} \leq \frac{10\,000}{E_{UVA}} \quad \text{s}$		P
4.3.3	Retinal blue light hazard exposure limit		P
	To protect against retinal photochemical injury from chronic blue-light exposure, the integrated spectral radiance of the light source weighted against the blue-light hazard function, $B(\lambda)$, i.e., the blue-light weighted radiance, L_B , shall not exceed the levels defined by:		P
	$L_B \cdot t = \sum_{300}^{700} \sum_t L_\lambda(\lambda, t) \cdot B(\lambda) \cdot \Delta t \cdot \Delta \lambda \leq 10^6 \quad \text{J} \cdot \text{m}^{-2} \cdot \text{sr}^{-1}$	for $t \leq 10^4 \text{ s}$ $t_{\max} = \frac{10^6}{L_B}$	P

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
	$L_B = \sum_{300}^{700} L_\lambda \cdot B(\lambda) \cdot \Delta\lambda \leq 100 \quad W \cdot m^{-2} \cdot sr^{-1}$	for $t > 10^4$ s	P
4.3.4	Retinal blue light hazard exposure limit - small source		N/A
	Thus the spectral irradiance at the eye E_λ , weighted against the blue-light hazard function $B(\lambda)$ shall not exceed the levels defined by:	see table 4.2	N/A
	$E_B \cdot t = \sum_{300}^{700} \sum_t E_\lambda(\lambda, t) \cdot B(\lambda) \cdot \Delta\lambda \leq 100 \quad J \cdot m^{-2}$	for $t \leq 100$ s	N/A
	$E_B = \sum_{300}^{700} E_\lambda \cdot B(\lambda) \cdot \Delta\lambda \leq 1 \quad W \cdot m^{-2}$	for $t > 100$ s	N/A
4.3.5	Retinal thermal hazard exposure limit		P
	To protect against retinal thermal injury, the integrated spectral radiance of the light source, L_λ , weighted by the burn hazard weighting function $R(\lambda)$ (from Figure 4.2 and Table 4.2), i.e., the burn hazard weighted radiance, shall not exceed the levels defined by:		P
	$L_R = \sum_{380}^{1400} L_\lambda \cdot R(\lambda) \cdot \Delta\lambda \leq \frac{50\,000}{\alpha \cdot t^{0,25}} \quad W \cdot m^{-2} \cdot sr^{-1}$	($10 \mu s \leq t \leq 10$ s)	P
4.3.6	Retinal thermal hazard exposure limit – weak visual stimulus		N/A
	For an infrared heat lamp or any near-infrared source where a weak visual stimulus is inadequate to activate the aversion response, the near infrared (780 nm to 1400 nm) radiance, L_{IR} , as viewed by the eye for exposure times greater than 10 s shall be limited to:		N/A
	$L_{IR} = \sum_{780}^{1400} L_\lambda \cdot R(\lambda) \cdot \Delta\lambda \leq \frac{6\,000}{\alpha} \quad W \cdot m^{-2} \cdot sr^{-1}$	$t > 10$ s	N/A
4.3.7	Infrared radiation hazard exposure limits for the eye		P
	The avoid thermal injury of the cornea and possible delayed effects upon the lens of the eye (cataractogenesis), ocular exposure to infrared radiation, E_{IR} , over the wavelength range 780 nm to 3000 nm, for times less than 1000 s, shall not exceed:		P
	$E_{IR} = \sum_{780}^{3000} E_\lambda \cdot \Delta\lambda \leq 18\,000 \cdot t^{-0,75} \quad W \cdot m^{-2}$	$t \leq 1000$ s	P
	For times greater than 1000 s the limit becomes:		
	$E_{IR} = \sum_{780}^{3000} E_\lambda \cdot \Delta\lambda \leq 100 \quad W \cdot m^{-2}$	$t > 1000$ s	P

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
4.3.8	Thermal hazard exposure limit for the skin		P
	Visible and infrared radiant exposure (380 nm to 3000 nm) of the skin shall be limited to:		
	$E_H \cdot t = \sum_{380}^{3000} \sum_t E_\lambda(\lambda, t) \cdot \Delta t \cdot \Delta \lambda \leq 20\,000 \cdot t^{0,25} \quad \text{J} \cdot \text{m}^{-2}$		P
5	MEASUREMENT OF LAMPS AND LAMP SYSTEMS		P
5.1	Measurement conditions		P
	Measurement conditions shall be reported as part of the evaluation against the exposure limits and the assignment of risk classification.		P
5.1.1	Lamp ageing (seasoning)		P
	Seasoning of lamps shall be done as stated in the appropriate IEC lamp standard.		P
5.1.2	Test environment		P
	For specific test conditions, see the appropriate IEC lamp standard or in absence of such standards, the appropriate national standards or manufacturer's recommendations.		P
5.1.3	Extraneous radiation		P
	Careful checks should be made to ensure that extraneous sources of radiation and reflections do not add significantly to the measurement results.		P
5.1.4	Lamp operation		P
	Operation of the test lamp shall be provided in accordance with:		P
	– the appropriate IEC lamp standard, or		N/A
	– the manufacturer's recommendation		P
5.1.5	Lamp system operation		P
	The power source for operation of the test lamp shall be provided in accordance with:		P
	– the appropriate IEC standard, or		N/A
	– the manufacturer's recommendation		P
5.2	Measurement procedure		P
5.2.1	Irradiance measurements		P
	Minimum aperture diameter 7mm.		P
	Maximum aperture diameter 50 mm.		P
	The measurement shall be made in that position of the beam giving the maximum reading.		P
	The measurement instrument is adequate calibrated.		P

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
5.2.2	Radiance measurements		P
5.2.2.1	Standard method		N/A
	The measurements made with an optical system.		N/A
	The instrument shall be calibrated to read in absolute radiant power per unit receiving area and per unit solid angle to acceptance averaged over the field of view of the instrument.		N/A
5.2.2.2	Alternative method		P
	Alternatively to an imaging radiance set-up, an irradiance measurement set-up with a circular field stop placed at the source can be used to perform radiance measurements.		P
5.2.3	Measurement of source size		P
	The determination of α , the angle subtended by a source, requires the determination of the 50% emission points of the source.		P
5.2.4	Pulse width measurement for pulsed sources		N/A
	The determination of Δt , the nominal pulse duration of a source, requires the determination of the time during which the emission is > 50% of its peak value.		N/A
5.3	Analysis methods		P
5.3.1	Weighting curve interpolations		P
	To standardize interpolated values, use linear interpolation on the log of given values to obtain intermediate points at the wavelength intervals desired.	see table 4.1	P
5.3.2	Calculations		P
	The calculation of source hazard values shall be performed by weighting the spectral scan by the appropriate function and calculating the total weighted energy.		P
5.3.3	Measurement uncertainty		P
	The quality of all measurement results must be quantified by an analysis of the uncertainty.	see Annex C in the norm	P
6	LAMP CLASSIFICATION		P
	For the purposes of this standard it was decided that the values shall be reported as follows:		P
	– for lamps intended for general lighting service, the hazard values shall be reported as either irradiance or radiance values at a distance which produces an illuminance of 500 lux, but not at a distance less than 200 mm		P
	– for all other light sources, including pulsed lamp sources, the hazard values shall be reported at a distance of 200 mm		N/A

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
6.1	Continuous wave lamps		P
6.1.1	Except Group		P
	In the except group are lamps, which does not pose any photobiological hazard. The requirement is met by any lamp that does not pose:		P
	– an actinic ultraviolet hazard (E_s) within 8-hours exposure (30000 s), nor		P
	– a near-UV hazard (E_{UVA}) within 1000 s, (about 16 min), nor		P
	– a retinal blue-light hazard (L_B) within 10000 s (about 2,8 h), nor		P
	– a retinal thermal hazard (L_R) within 10 s, nor		P
	– an infrared radiation hazard for the eye (E_{IR}) within 1000 s		P
6.1.2	Risk Group 1 (Low-Risk)		N/A
	In this group are lamps, which exceeds the limits for the except group but that does not pose:		N/A
	– an actinic ultraviolet hazard (E_s) within 10000 s, nor		N/A
	– a near ultraviolet hazard (E_{UVA}) within 300 s, nor		N/A
	– a retinal blue-light hazard (L_B) within 100 s, nor		N/A
	– a retinal thermal hazard (L_R) within 10 s, nor		N/A
	– an infrared radiation hazard for the eye (E_{IR}) within 100 s		N/A
	Lamps that emit infrared radiation without a strong visual stimulus and do not pose a near-infrared retinal hazard (L_{IR}), within 100 s are in Risk Group 1.		N/A
6.1.3	Risk Group 2 (Moderate-Risk)		N/A
	This requirement is met by any lamp that exceeds the limits for Risk Group 1, but that does not pose:		N/A
	– an actinic ultraviolet hazard (E_s) within 1000 s exposure, nor		N/A
	– a near ultraviolet hazard (E_{UVA}) within 100 s, nor		N/A
	– a retinal blue-light hazard (L_B) within 0,25 s (aversion response), nor		N/A
	– a retinal thermal hazard (L_R) within 0,25 s (aversion response), nor		N/A
	– an infrared radiation hazard for the eye (E_{IR}) within 10 s		N/A
	Lamps that emit infrared radiation without a strong visual stimulus and do not pose a near-infrared retinal hazard (L_{IR}), within 10 s are in Risk Group 2.		N/A

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict
6.1.4	Risk Group 3 (High-Risk)		N/A
	Lamps which exceed the limits for Risk Group 2 are in Group 3.		N/A
6.2	Pulsed lamps		N/A
	Pulse lamp criteria shall apply to a single pulse and to any group of pulses within 0,25 s.		N/A
	A pulsed lamp shall be evaluated at the highest nominal energy loading as specified by the manufacturer.		N/A
	The risk group determination of the lamp being tested shall be made as follows:		N/A
	– a lamp that exceeds the exposure limit shall be classified as belonging to Risk Group 3 (High-Risk)		N/A
	– for single pulsed lamps, a lamp whose weighted radiant exposure or weighted radiance does is below the EL shall be classified as belonging to the Exempt Group		N/A
	– for repetitively pulsed lamps, a lamp whose weighted radiant exposure or weighted radiance dose is below the EL, shall be evaluated using the continuous wave risk criteria discussed in clause 6.1, using time averaged values of the pulsed emission		N/A

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict

Table 4.1	Spectral weighting function for assessing ultraviolet hazards for skin and eye			P
Wavelength ¹ λ , nm	UV hazard function $S_{uv}(\lambda)$	Wavelength λ , nm	UV hazard function $S_{uv}(\lambda)$	
200	0,030	313*	0,006	
205	0,051	315	0,003	
210	0,075	316	0,0024	
215	0,095	317	0,0020	
220	0,120	318	0,0016	
225	0,150	319	0,0012	
230	0,190	320	0,0010	
235	0,240	322	0,00067	
240	0,300	323	0,00054	
245	0,360	325	0,00050	
250	0,430	328	0,00044	
254*	0,500	330	0,00041	
255	0,520	333*	0,00037	
260	0,650	335	0,00034	
265	0,810	340	0,00028	
270	1,000	345	0,00024	
275	0,960	350	0,00020	
280*	0,880	355	0,00016	
285	0,770	360	0,00013	
290	0,640	365*	0,00011	
295	0,540	370	0,000093	
297*	0,460	375	0,000077	
300	0,300	380	0,000064	
303*	0,120	385	0,000053	
305	0,060	390	0,000044	
308	0,026	395	0,000036	
310	0,015	400	0,000030	

¹ Wavelengths chosen are representative: other values should be obtained by logarithmic interpolation at intermediate wavelengths.
* Emission lines of a mercury discharge spectrum.

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict

Table 4.2	Spectral weighting functions for assessing retinal hazards from broadband optical sources	P
Wavelength nm	Blue-light hazard function B (λ)	Burn hazard function R (λ)
300	0,01	
305	0,01	
310	0,01	
315	0,01	
320	0,01	
325	0,01	
330	0,01	
335	0,01	
340	0,01	
345	0,01	
350	0,01	
355	0,01	
360	0,01	
365	0,01	
370	0,01	
375	0,01	
380	0,01	0,1
385	0,013	0,13
390	0,025	0,25
395	0,05	0,5
400	0,10	1,0
405	0,20	2,0
410	0,40	4,0
415	0,80	8,0
420	0,90	9,0
425	0,95	9,5
430	0,98	9,8
435	1,00	10,0
440	1,00	10,0
445	0,97	9,7
450	0,94	9,4
455	0,90	9,0
460	0,80	8,0
465	0,70	7,0
470	0,62	6,2
475	0,55	5,5
480	0,45	4,5
485	0,40	4,0
490	0,22	2,2
495	0,16	1,6
500-600	$10^{[(450-\lambda)/50]}$	1,0
600-700	0,001	1,0
700-1050		$10^{[(700-\lambda)/500]}$
1050-1150		0,2
1150-1200		$0,2 \cdot 10^{0,02(1150-\lambda)}$
1200-1400		0,02

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict

Table 5.4 Summary of the ELs for the surface of the skin or cornea (irradiance based values)						P
Hazard Name	Relevant equation	Wavelength range nm	Exposure duration sec	Limiting aperture rad (deg)	EL in terms of constant irradiance $W \cdot m^{-2}$	
Actinic UV skin & eye	$E_S = \sum E_\lambda \cdot S(\lambda) \cdot \Delta\lambda$	200 – 400	< 30000	1,4 (80)	30/t	
Eye UV-A	$E_{UVA} = \sum E_\lambda \cdot \Delta\lambda$	315 – 400	≤ 1000 > 1000	1,4 (80)	10000/t 10	
Blue-light small source	$E_B = \sum E_\lambda \cdot B(\lambda) \cdot \Delta\lambda$	300 – 700	≤ 100 > 100	< 0,011	100/t 1,0	
Eye IR	$E_{IR} = \sum E_\lambda \cdot \Delta\lambda$	780 – 3000	≤ 1000 > 1000	1,4 (80)	18000/t ^{0,75} 100	
Skin thermal	$E_H = \sum E_\lambda \cdot \Delta\lambda$	380 – 3000	< 10	2π sr	20000/t ^{0,75}	

Table 5.5 Summary of the ELs for the retina (radiance based values)						P
Hazard Name	Relevant equation	Wavelength range nm	Exposure duration sec	Field of view radians	EL in terms of constant radiance $W \cdot m^{-2} \cdot sr^{-1}$	
Blue light	$L_B = \sum L_\lambda \cdot B(\lambda) \cdot \Delta\lambda$	300 – 700	0,25 – 10 10-100 100-10000 ≥ 10000	$0,011 \cdot \sqrt{(t/10)}$ 0,011 $0,0011 \cdot \sqrt{t}$ 0,1	10 ⁶ /t 10 ⁶ /t 10 ⁶ /t 100	
Retinal thermal	$L_R = \sum L_\lambda \cdot R(\lambda) \cdot \Delta\lambda$	380 – 1400	< 0,25 0,25 – 10	0,0017 $0,011 \cdot \sqrt{(t/10)}$	50000/($\alpha \cdot t^{0,25}$) 50000/($\alpha \cdot t^{0,25}$)	
Retinal thermal (weak visual stimulus)	$L_{IR} = \sum L_\lambda \cdot R(\lambda) \cdot \Delta\lambda$	780 – 1400	> 10	0,011	6000/ α	

IEC 62471			
Clause	Requirement + Test	Result – Remark	Verdict

Table 6.1 Emission limits for risk groups of continuous wave lamps									P
Risk	Action spectrum	Symbol	Units	Emission Measurement					
				Exempt		Low risk		Mod risk	
				Limit	Result	Limit	Result	Limit	Result
Actinic UV	$S_{UV}(\lambda)$	E_s	$W \cdot m^{-2}$	0,001	$2,838 \cdot 10^{-7}$	0,003	N/A	0,03	N/A
Near UV		E_{UVA}	$W \cdot m^{-2}$	10	0	33	N/A	100	N/A
Blue light	$B(\lambda)$	L_B	$W \cdot m^{-2} \cdot sr^{-1}$	100	46	10000	N/A	4000000	N/A
Blue light, small source	$B(\lambda)$	E_B	$W \cdot m^{-2}$	1,0*	N/A	1,0	N/A	400	N/A
Retinal thermal	$R(\lambda)$	L_R	$W \cdot m^{-2} \cdot sr^{-1}$	$28000/\alpha$	N/A	$28000/\alpha$	N/A	$71000/\alpha$	N/A
Retinal thermal, weak visual stimulus**	$R(\lambda)$	L_{IR}	$W \cdot m^{-2} \cdot sr^{-1}$	$6000/\alpha$	N/A	$6000/\alpha$	N/A	$6000/\alpha$	N/A
IR radiation, eye		E_{IR}	$W \cdot m^{-2}$	100	0	570	N/A	3200	N/A

* Small source defined as one with $\alpha < 0,011$ radian. Averaging field of view at 10000 s is 0,1 radian.
 ** Involves evaluation of non-GLS source

List of test equipment used:


A completed list of used test equipment shall be provided in the Test Reports when a Customer's Testing Facility according to CTF stage 1 or CTF stage 2 procedure has been used.

Note: This page may be removed when CTF stage 1 or CTF stage 2 are not used. See also clause 4.8 in OD 2020 for more details.

Clause	Measurement / testing	Testing / measuring equipment / material used, (Equipment ID)	Range used	Last Calibration date	Calibration due date

Photos: 130822.5LR7B27S1405.201.B.V



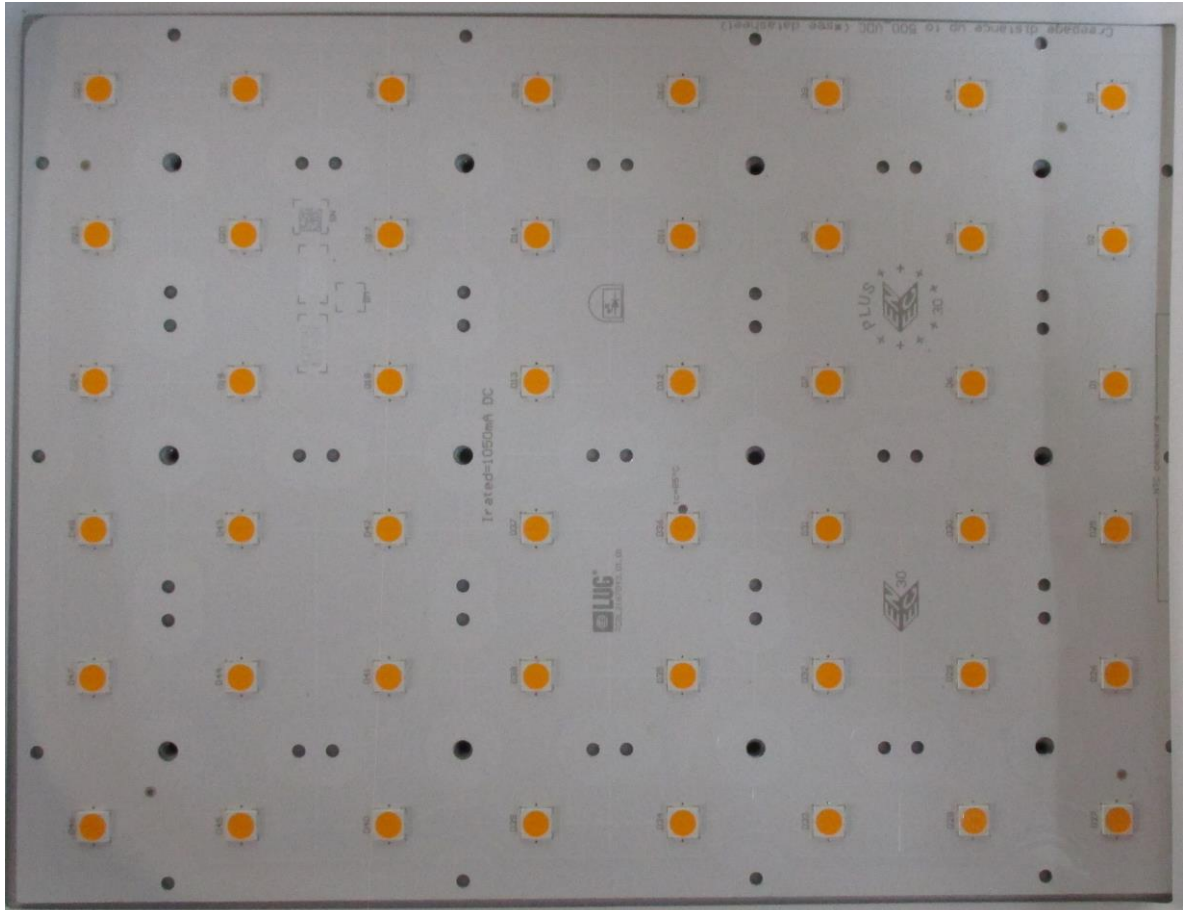

Page 1 of 2		Report No.: B10-3/122/B/1/22	
IEC62471B ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
ATTACHMENT No.1 TO TEST REPORT IEC 62471 Report Ref. No B10-3/122/B/22 EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES Photobiological safety of lamps and lamps systems			
Differences according to..... EN 62471:2008			
Annex Form No..... EU_GD_IEC62471B			
Annex Form Originator OVE			
Master Annex Form..... 2019-01-24			
Copyright © 2019 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			

	CENELEC COMMON MODIFICATIONS (EN)	P
4	EXPOSURE LIMITS	P
	Contents of the whole Clause 4 of IEC 62471:2006 moved into a new informative Annex ZB	—
	Clause 4 replaced by the following:	
	Limits of the Artificial Optical Radiation Directive (2006/25/EC) have been applied instead of those fixed in IEC 62471:2006	P
4.1	General	P
	First paragraph deleted	—

Table 6.1		Emission limits for risk groups of continuous wave lamps (based on EU Directive 2006/25/EC)							P	
Risk	Action spectrum	Symbol	Units	Emission Measurement						
				Exempt		Low risk		Mod risk		
				Limit	Result	Limit	Result	Limit	Result	
Actinic UV	$S_{UV}(\lambda)$	E_s	$W \cdot m^{-2}$	0,001	N/A	-	-	-	-	
Near UV		E_{UVA}	$W \cdot m^{-2}$	0,33	N/A	-	-	-	-	
Blue light	$B(\lambda)$	L_B	$W \cdot m^{-2} \cdot sr^{-1}$	100	46	10000	N/A	4000000	N/A	
Blue light, small source	$B(\lambda)$	E_B	$W \cdot m^{-2}$	0,01*	N/A	1,0	N/A	400	N/A	
Retinal thermal	$R(\lambda)$	L_R	$W \cdot m^{-2} \cdot sr^{-1}$	28000/ α	N/A	28000/ α	N/A	71000/ α	N/A	
Retinal thermal, weak visual stimulus**	$R(\lambda)$	L_{IR}	$W \cdot m^{-2} \cdot sr^{-1}$	545000 $0,0017 \leq \alpha \leq 0,011$	N/A					
				6000/ α $0,011 \leq \alpha \leq 0,1$	N/A					
IR radiation, eye		E_{IR}	$W \cdot m^{-2}$	100	0	570	N/A	3200	N/A	
<p>* Small source defined as one with $\alpha < 0,011$ radian. Averaging field of view at 10000 s is 0,1 radian.</p> <p>** Involves evaluation of non-GLS source</p> <p>NOTE The action functions: see Table 4.1 and Table 4.2 The applicable aperture diameters: see 4.2.1 The limitations for the angular subtenses: see 4.2.2 The related measurement condition 5.2.3 and the range of acceptance angles: see Table 5.5.</p>										



TEST REPORT
EN 62262
Degree of protection provided
by enclosures for electrical equipment
against external mechanical impacts (IK code)

Report Number.: **B10-3/125/B/22**

Date of issue: **2022-08-30**

Total number of pages..... 14

Name of Testing Laboratory: **Łukasiewicz - IMiF PREDOM Division**
preparing the Report.....: **02-255 Warszawa, ul. Krakowiaków 53, Poland**

Applicant's name.....: **LUG Light Factory Sp. z.o.o.**
Address: **65-127 Zielona Góra, ul. Gorzowska 11, Poland**

Test specification:

Standard: EN 62262:2002 (in conjunction with IEC/TR 62696:2011)

Test procedure: ENEC CCA NTR Other: _____

Non-standard test method.....: N/A

Test Report Form No.....: EN_EN62262A

Test Report Form(s) Originator: Łukasiewicz - IMiF PREDOM Division

Master TRF: Dated 2021-11-22

Copyright © 2019 ETICS, Brussels, Belgium. All rights reserved.




This publication may be reproduced in whole or in part for non-commercial purposes as long as the ETICS is acknowledged as copyright owner and source of the material. ETICS takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-ETICS members, the ECS logo and the reference to the ENEC/CCA Scheme procedure shall be removed.

General disclaimer:

The test results presented in this report relate only to the object tested.

This report shall not be reproduced, except in full, without the written approval of the Issuing ECS Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

Test item description	Luminaires for road and street lighting	
Trade Mark	LUG	
Manufacturer	LUG Light Factory Sp. z.o.o. ul. Gorzowska 11, 65-127 Zielona Góra, Poland	
Model/Type reference	URBINO LED IK10 family – series – see also “General product information”	
Ratings	220-240 V 50/60 Hz, IP66, IK10, cl. II (see details – pages 3-6)	
Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
<input checked="" type="checkbox"/>	ECS Testing Laboratory:	Łukasiewicz - IMiF PREDOM Division
Testing location/ address	02-255 Warszawa, ul. Krakowiaków 53, Poland	
Tested by (name, function, signature)	J. Śmigrodzki	
Approved by (name, function, signature) ..	T. Małycka	
Supervised by (name, function, signature) :	F. Walczak	
<input type="checkbox"/>	Testing procedure: TMP/CTF Stage 1:	
Testing location/ address		
Tested by (name, function, signature)		
Approved by (name, function, signature) ..		
<input type="checkbox"/>	Testing procedure: WMT/CTF Stage 2:	
Testing location/ address		
Tested by (name + signature).....		
Witnessed by (name, function, signature) . :		
Approved by (name, function, signature) .. :		

List of Attachments (including a total number of pages in each attachment): N/A

Summary of testing: Positive

According to ISO / IEC Guide 98-4 for the assessment of compliance of the measurement result with the requirements, criterion B was chosen. 50% risk of incorrect assessment decision belongs to the customer and 50% risk of incorrect assessment belongs to the laboratory.

Tests performed (name of test and test clause):

EN 62262:2002 (in conjunction with IEC/TR 62696:2011) - all clauses.

Testing location:

Łukasiewicz- IMiF PREDOM Division
02-255 Warszawa, ul. Krakowiaków 53, Poland

Summary of compliance with National Differences (List of countries addressed): N/A

The product fulfils the requirements of _____ (insert standard number and edition and delete the text in parenthesis, leave it blank or delete the whole sentence, if not applicable)

Copy marking plate:



Test item particulars	Luminaire for road and street lighting
Classification of installation and use	Normal
Supply Connection	Connector
.....	:
Possible test case verdicts:	
- test case does not apply to the test object	: N/A
- test object does meet the requirement	: P (Pass)
- test object does not meet the requirement	: F (Fail)
Testing	:
Date of receipt of test item	: 2022-07-11
Date (s) of performance of tests	: 2022-07-11 - 2022-08-30
General remarks:	
<p>"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report.</p> <p>Throughout this report a <input checked="" type="checkbox"/> comma / <input type="checkbox"/> point is used as the decimal separator.</p>	
Name and address of factory (ies)	LUG Light Factory Sp. z.o.o. ul. Gorzowska 11; 65-127 Zielona Góra, Poland

General product information and other remarks:

Name and address of the license holder:	LUG Light Factory Sp. z o.o. ul. Gorzowska 11, 65-127 Zielona Góra - Poland
Address of the factory:	LUG Light Factory Sp. z o.o. ul. Gorzowska 11, 65-127 Zielona Góra - Poland
Name of product:	Luminaires for road and street lighting
Type (model):	URBINO LED IK10 family - series (see bellow)
Trade mark :	LUG
Technical data:	
rated voltage	220 - 240V
rated frequency	50 / 60Hz
protection against electric shock	class I or class II
degree of protection	IP 66; IK10
ta	-40°C to 50°C -35°C to 50°C* -30°C to 50°C** -25°C to 50°C***

* - For luminaires equipped with:

- Vossloh Schwabe SPC/230/10K/i

** - For luminaires equipped with:

- Tridonic LCA 120W 300-1050mA
- Philips Xi FP 70W 0.3-1.0A NLD C150 230V sXt
- Philips Xi FP 110W 0.3-1.0A NLD C150 230V sXt
- Vossloh Schwabe SP/230/10K

*** - For luminaires equipped with:

- LACROIX DL-PAK 70

Choice sheet of the luminaires URBINO LED IK10 - series:**Example of symbol:**

130752.5LR7B40S2470.101.B.N.V.P.K.O

Designations used on the marking of luminaries (some designation may not appear in the name) :

- | | |
|-----------------|---|
| 1. 13072 | - Code of the series Urbino LED IK10 with LED Cree XPG-3 modules |
| 13082 | - Code of the series Urbino LED IK10 with LED Luxeon 5050 modules |
| 2. 2 | - Color:
2: grey
5: graphite
0: another |
| 3. 5L | - Type of power supply:
2L - DIMM 1-10V
3L - DALI
5L - on-off
6L - on-off / DALI
7L - ZHAGA D4i
PL - programmable |

<p>4. R7</p>	<ul style="list-style-type: none"> - CRI: R7 = 70-79 R8 = 80-89
<p>5. B40</p>	<ul style="list-style-type: none"> - Color temperature: B22 = 2200K B27 = 2700K B30 = 3000K B40 = 4000K B57 = 5700K B65 = 6500K
<p>6. S2470</p>	<ul style="list-style-type: none"> - Luminous flux (S2470 = 24700lm)
<p>7. 1 2</p>	<ul style="list-style-type: none"> - Safety Class I - Safety Class II
<p>8. 01</p>	<ul style="list-style-type: none"> - Optic type – for road lighting 01 to 99
<p>9. B.N.V.P.K.O</p>	<ul style="list-style-type: none"> - Additional equipment A - additional corrosion protection B - Tool-free access to the LED Driver N - NEMA Socket Z - ZHAGA Socket T - NTC Sensor W - Twilight Sensor V - Surge Device Protector 10kV Y - Surge Device Protector 20kV P- Anti pressure vent I- iBloc (“URBAN” smart city system) K- Knife switch connector C - RAL Color
<p>After review of technical documentation, model series, characteristic of particular models, technical parameters, and components, etc., the luminaire 130752.5LR7B40S55.109.B, has been tested as the representative of all models of luminaires.</p>	

EN 62262			
Clause	Requirement + Test	Result - Remark	Verdict
4.	DESTIGNATION		P
4.1	Arrangement of the IK code		P
	Codes letters (international mechanical protection) ——— IK ——— 05 Characteristic group numeral (0 to 10) ———	IK10	P
4.2	Characteristic group numerals of the IK code and their meanings	Each characteristic group numeral, represents an impact energy value as shown in Table1. See table 1 of EN62262, IK10 Impact energy: 20 J	P
4.3	Application of the IK code		N/A
	In general the degree of protection applies to the complete enclosure. If parts of the enclosure have differing degrees of protection, the latter shall be separately indicated		N/A
4.4	Marking		P
	In case where the relevant product committee decides that marking of the IK-code shall be required, the marking requirements shall be detailed in the relevant product standard		P
	Where appropriate, such a standard should also specify the method of marking which is to be used when:		N/A
	— one part of an enclosure has different degree of protection to that of another part of the same enclosure;		N/A
	— the mounting position has an influence on the degree of protection		N/A
5.	GENERAL REQUIREMENTS FOR TESTS		P
5.1	Atmospheric conditions for tests		P
	Unless otherwise specified in the relevant product standard, the test shall be carried out under the standard atmospheric conditions for tests described in IEC60068-1 as:		
	Temperature range 15°C to 35°C	23°C	P
	Air pressure 86 kPa to 106 kPa (860mbar to 1060 mbar)	100,2 kPa	P
	When the altitude at which the test is performed is higher than 2000 m the height of fall shall be adjusted where necessary to result in the specified impact energy.		N/A
5.2	Enclosures under test		P
	each enclosure under test shall be in a clean and new condition, complete with all their parts in place unless otherwise specified in the relevant product standard		P
5.3	Specifications to be given in the relevant product standard		P
	The relevant product standard shall specify:		P

EN 62262			
Clause	Requirement + Test	Result - Remark	Verdict
	— the definition of “enclosure” as it applies to the particular type of equipment;		P
	— the test equipment (e.g. pendulum hammer, spring hammer or vertical hammer, see Clause7);		P
	— the number of samples to be tested;		P
	— the conditions for mounting, assembling and positioning the samples, e.g. by the use of an artificial surface(ceiling, floor or wall), in order to stimulate intended service conditions as far as possible;		P
	— the pre-conditioning, if any, which is to be used;		P
	— whether to be tested energized; No energized		P
	— whether to be tested with any moving parts in motion; No moving parts	No moving parts	P
	— the number of impacts and their points of application (see 6.3).		P
	In the absence of such specifications in the relevant product standard, conditions of this standard shall apply.		P
XXX	IEC TR 62696 Requirements		P
XXX 3	Conditions of testing (IEC TR 62696)		P
XXX 3.1	In general, testing is conducted in accordance with IEG 62262, having regard to the general test conditions specified by IEG 60598-1, Subclause 4.13, and the following conditions which are specific for the 1K testing and rating of luminaires, (IEC TR 62696)		P
XXX3.2	Impacts should not be applied through openings in the luminaire enclosure with an area less than 64 cm ² . NOTE For example, no impact should be applied through the individual openings in optical controls (louvers) if their size is less than 64 cm ² . (IEC TR 62696)		P
XXX3.3	Luminaires should be tested fully assembled and installed for use. (IEC TR 62696)		P
	Luminaires for ceiling or wall mounting should be mounted on a rigid wooden board. (IEC TR 62696)		N/A
	Suspended luminaires should be tested as in normal use, with the minimum suspension length detailed by the manufacturer’s instructions. (IEC TR 62696)		N/A

EN 62262			
Clause	Requirement + Test	Result - Remark	Verdict
	Luminaires to be installed on a pole, with or without a mast arm, should be installed on a rigid portion of the pole. (IEC TR 62696)		P
	Floor mounted luminaires should be tested in a suitable rigid structure to simulate normal use. (IEC TR 62696)		N/A
XXX3.4	Luminaires should not be energised during test and no preconditioning of the luminaire sample is required. (IEC TR 62696)		P
XXX3.5	Testing should be conducted on a single luminaire sample unless the results of impact testing of other areas of the luminaire could influence assessment of the result. Three impact blows should be applied to the point(s) of the luminaire considered to be the weakest. (IEC TR 62696)		P
XXX3.6	Impact testing should be conducted using striking elements with head radius and material type as specified by IEC 60068-2-75. Spring hammer apparatus should be used for ratings up to and including 1K06. For ratings IK07 and above, the use of pendulum or vertical hammer apparatus is acceptable, as most appropriate for the luminaire design and its intended installation (IEC TR 62696)		P
XXX3.7	Impact testing should be conducted with the luminaire in its intended mounting orientation whenever this is possible, and when this could affect the outcome of the test (e.g. for assessment of mounting surface fixing security). (IEC TR 62696)		P
	When impact testing of a ceiling-mounted luminaire is required from below the luminaire, and this is impractical, the luminaire may be rotated 90° (to a wall mounted position) for the purposes of this testing. (IEC TR 62696)		N/A
XXX3.8	In cases where it may be impossible to carry out the impact test due to the luminaire construction, it is acceptable to use a specially-prepared luminaire to perform the test- For this situation, the modification should not impair the mechanical strength characteristics of the luminaire. (IEC TR 62696)		N/A
6	TEST TO VERIFY THE PROTECTION AGAINST MECHANICAL IMPACTS		P
6.1	The tests specified in this standard are type tests		P

EN 62262			
Clause	Requirement + Test	Result - Remark	Verdict
	6.2 In order to verify the protection against mechanical impacts blows shall be applied to the enclosure to be tested. The device to be used for this test are described in Clause 7		P
6.3	During the test the enclosure shall be mounted, according to the manufacturer instructions for use, on a rigid support. A support is considered to be sufficiently rigid if its displacement is less than or equal to 0,1mm under the effect of an impact directly applied and whose energy corresponds to the degree of protection. Alternative mounting and support, suitable for the product, may be specified in the relevant product standard	Displacement is less than or equal to 0,1 mm	P
6.4	The number of impacts shall be five on each exposed face unless otherwise specified in the relevant product standard. The impacts shall be evenly distributed on the faces of the enclosure (s) under test. In no case shall more than three impacts be applied in the surroundings of the same 5 points	3 times per point	P
6.5	Test evaluation		P
	The relevant product standard shall specify the criteria upon which the acceptance or rejection of the enclosure is to be based on particularly:		P
	—admissible damages;		P
	—verification criteria relative to the continuity of the safety and reliability of the equipment		P
XXX4	Conditions of acceptance (IEC TR 62696)		P
XXX4.1	Safety of the luminaire is to be maintained as per the criteria given in IEG 60598-1, Subclause 4.13. Furthermore, the fixings of the luminaire to the mounting surface should remain secure. Non safety critical damage to the luminaire enclosure and optics is accepted, but no parts of the luminaire should become detached. Acceptance is checked by visual inspection, and test/measurement where required. (IEC TR 62696)		P
XXX4.2	Protection of the light source should be provided and basic functioning of the luminaire should be maintained. Acceptance is checked by visual inspection and by operation of the luminaire following the test. (IEC TR 62696)		P
7.	TEST APPARATUS		P
	The test shall be done by using one of the test apparatus as described in EN 60068-2-75		P

EN 62262			
Clause	Requirement + Test	Result - Remark	Verdict
	The striking surface shall be visually examined before each impact in order to ensure that there is no damage that might affect the result of the test		P
7.1	Test Ehc: Vertical hammer		P
7.2	The hammer consists basically of a striking element which falls freely from rest through a vertical height, selected from table2, on to the specimen surface held in a horizontal plane. The characteristics of the striking element shall comply with table 1. The fall of the striking element shall be along a guide way, for example a tube, with negligible braking. This guide way shall not rest on the specimen and the striking element shall be free of the guide way on striking the specimen. In order to reduce the friction, the length l of the striking element shall not be smaller than its diameter D, and a small gap (for example 1 mm) shall be provided between the striking element and the guide way.		P
7.3	Height of fall		P
	The height of fall shall be as given in table2, the equivalent mass stated therein being equal to the actual mass of the striking element		P

Note (XXX – requirements of IEC/TR 62696:2011)

TABLE: Critical components information					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ¹⁾
see the list of components in the TR B10-123/B/22 dated 2022-09-20 and TR B10-3/124/B/22 dated 2022-09-21					
Supplementary information: ¹⁾ Provided evidence ensures the agreed level of compliance. See OD-CB2039.					

List of test equipment used:

A completed list of used test equipment shall be provided in the Test Reports when a Manufacturer Testing Laboratory according to TMP/CTF stage 1 or TMP/CTF stage 2 procedure has been used.

Note: This page may be removed when CTF stage 1 CTF stage 2 are not used.

Clause	Measurement / testing	Testing / measuring equipment / material used, (Equipment ID)	Range used	Last Calibration date	Calibration due date

Photos 130752.5LR7B40S55.109.B







AB 003



**TEST REPORT
IEC CISPR15**

Limits and methods of measurement of radio disturbance characteristics of electrical lighting and similar equipment

Report Number..... : B10-4/076/EMC/22

Date of issue : 2022-08-03

Total number of pages : 63

Name of Testing Laboratory preparing the Report : Łukasiewicz - IMiF PREDOM Division
02-255 Warszawa, ul. Krakowiaków 53, Poland

Applicant's name : LUG Light Factory Sp. z o.o.
Address : 65-127 Zielona Góra, ul. Gorzowska 11, Poland

Test specification:

Standard : PN-EN IEC 55015:2019-11+A11:2020-07, PN-EN 61547:2009,
PN-EN IEC 61000-3-2:2019-04+A1:2021-08
PN-EN 61000-3-3:2013-10+A1:2019-10
EN IEC 55015:2019+A11:2020, EN 61547:2009,
EN IEC 61000-3-2:2019+A1:2021, EN 61000-3-3:2013+A1:2019,
CISPR 15:2018, IEC 61547:2009,
IEC 61000-3-2:2018+AMD1:2020, IEC 61000-3-3:2013+AMD1:2017

Test procedure..... : EMC

Non-standard test method..... : N/A

Test Report Form No. : PREDOM IEC CISPR15_ IEC 61547/21

Test Report Form(s) Originator.... : Łukasiewicz - IMiF PREDOM Division
02-255 Warszawa, ul. Krakowiaków 53, Poland

Master TRF : Dated 2022-01



Copyright © 2019 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.
This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

Test item description	Street luminaire	
Trade Mark(s)		
Original Product/Equipment Manufacturer	LUG Light Factory Sp. z o.o. 65-127 Zielona Góra, ul. Gorzowska 11, Poland	
Branding Manufacturer(s)	LUG	
Model/Type reference	URBINO IK10 LED ED D4i 18850lm/730 IP66 O5 szary I kl.	
Ratings	220-240 V 50/60 Hz 1 x max 117 W IP66 cl. I	
Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
<input checked="" type="checkbox"/>	Testing Laboratory:	Łukasiewicz - IMiF PREDOM Division
Testing location/ address		02-255 Warszawa, ul. Krakowiaków 53, Poland
Tested by (name, function, signature)		Marek Gabryszewski 
Approved by (name, function, signature) ..		Tomasz Małyska 
Supervised by (name, function, signature):		Filip Walczak 
<input type="checkbox"/>	Testing procedure: CTF Stage 1:	
Testing location/ address		
Tested by (name, function, signature)		
Approved by (name, function, signature) ..		
<input type="checkbox"/>	Testing procedure: CTF Stage 2:	
Testing location/ address		
Tested by (name + signature)		
Witnessed by (name, function, signature) . :		
Approved by (name, function, signature) ..		
<input type="checkbox"/>	Testing procedure: CTF Stage 3:	
<input type="checkbox"/>	Testing procedure: CTF Stage 4:	

Testing location/ address :	
Tested by (name, function, signature) :	
Witnessed by (name, function, signature) . :	
Approved by (name, function, signature) .. :	
Supervised by (name, function, signature) :	

List of Attachments (including a total number of pages in each attachment): N/A	
Summary of testing: Tests results - Positive	
<i>According to ISO / IEC Guide 98-4 for the assessment of compliance of the measurement result with the requirements, criterion B was chosen. 50% risk of incorrect assessment decision belongs to the customer and 50% risk of incorrect assessment belongs to the laboratory.</i>	
Tests performed (name of test and test clause): Conducted EMISSIONS (4.3) Radiated electromagnetic disturbances (4.5.2) Radiated EMISSIONS (4.5.3) Harmonic Currents (7) Voltage Fluctuations and Flicker (5) Electrostatic Discharges (5.2) RF Electromagnetic Fields (5.3) Power frequency magnetic fields (5.4) Electrical Fast Transients (5.5) Conducted Disturbances Induced by RF Fields (5.6) Surge (5.7) Voltage Dips and short Interruptions (5.8)	Testing location: Łukasiewicz - IMiF PREDOM Division 02-255 Warszawa, ul. Krakowiaków 53, Poland
Summary of compliance with National Differences (List of countries addressed): N/A	
Statement concerning the uncertainty of the measurement systems used for the tests no required (N/A)	
<input checked="" type="checkbox"/> Internal procedure used for type testing through which traceability of the measuring uncertainty has been established: Procedure number, issue date and title: General concept of methodologies for determining uncertainty of measurement, dated: October 2013 Calculations leading to the reported values are on file with the NCB and testing laboratory that conducted the testing.	
<input type="checkbox"/> Statement not required by the standard used for type testing	

Copy of marking plate:




Test item particulars : For test item particulars refer to item 1	
Classification of installation and use : Street luminaire	
Supply Connection : Power connector	
Possible test case verdicts: - test case does not apply to the test object..... : N/A - test object does meet the requirement..... : P (Pass) - test object does not meet the requirement..... : F (Fail)	
Testing: Date of receipt of test item : 2022-07-11 Date (s) of performance of tests : 2022-07-11 ÷ 2022-07-15	
General remarks: "(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Throughout this report a <input type="checkbox"/> comma / <input checked="" type="checkbox"/> point is used as the decimal separator.	
Manufacturer's Declaration per sub-clause 4.2.5 of IEC 61010-1:	
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> Not applicable
When differences exist; they shall be identified in the General product information section.	
Name and address of factory (ies) : LUG Light Factory Sp. z o.o. 65-127 Zielona Góra, ul. Gorzowska 11, Poland	
General product information (GPI) and other remarks: The results in this report reflect the results for that specific model and serial number. It is the responsibility of the manufacturer to ensure that all production models meet the requirements detailed in this report. According to the information from our Applicant, the tests were done on 230 V / 50 Hz supply.	

Table of Contents:

1	General description of test item(s).....	7
1.1	Description of test item(s) according to CISPR 15.....	9
1.2	Photos of the test item.....	11
2	Verdict summary section.....	14
3	Test conditions.....	15
3.1	General.....	15
3.2	Specific test conditions for CISPR 15.....	15
4	Emission.....	16
4.1	Conducted disturbances.....	16
4.2	Radiated electromagnetic disturbances (9 kHz to 30 MHz).....	21
4.3	Radiated electromagnetic disturbances(30 MHz to 1000 MHz).....	26
5	Harmonic current emissions according to IEC 61000-3-2.....	33
6	Voltage changes, voltage fluctuations and flicker according to IEC 61000-3-3.....	37
7	Immunity.....	39
7.1	General information.....	39
7.2	Electrostatic discharges.....	40
7.3	Radio-frequency electromagnetic fields.....	44
7.4	Power frequency magnetic fields.....	48
7.5	Fast transients.....	50
7.6	Injected currents (radio-frequency common mode).....	52
7.7	Surges.....	54
7.8	Voltage dips and short interruptions.....	56
8	List of test equipment.....	59
9	Measurement instrumentation uncertainties.....	60
10	Annex.....	61
10.1	Annex A:.....	61
10.2	Annex B:.....	61

1 General description of test item(s)

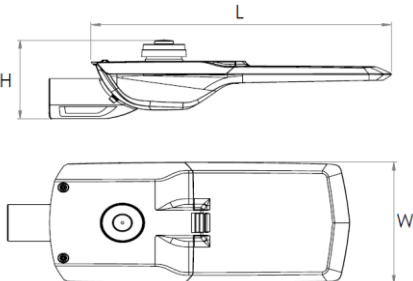Description	Street luminaire				
Model number	130822.7L151.050.001 URBINO IK10 LED				
Serial number	N/A				
Brand name	LUG				
Ports	Port name and description	Cable			
		Specified length [m]	Attached during test	Shielded	
Local wired ports	Mains, Supply Connection: power cord 3 x 2.5 mm ²	0.8	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>	
Wired network ports.....	N/A		<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>	
Supplemental information to the ports.....	N/A				
Rated power supply.....		Voltage and frequency	1 ph/ PE	2 ph/N/PE	3 ph/N/PE
	<input checked="" type="checkbox"/>	AC: 230 V / 50 Hz	<input checked="" type="checkbox"/> / <input checked="" type="checkbox"/>	<input type="checkbox"/> / <input type="checkbox"/> / <input type="checkbox"/>	<input type="checkbox"/> / <input type="checkbox"/> / <input type="checkbox"/>
	<input type="checkbox"/>	DC:			
Rated power	1 x max 117 W				
Protection class	cl. I				
Clock frequencies	No available data for these selection criteria				
Other parameters	See page 4				
Software version.....	of 07_2022				
Hardware version	of 07_2022				
Dimensions in mm (L x W x H):	550 x 250 x 130				
					
Mounting position.....	<input type="checkbox"/>	Table top equipment			
	<input type="checkbox"/>	Wall/Ceiling mounted equipment			
	<input type="checkbox"/>	Floor standing equipment			
	<input type="checkbox"/>	Hand-held equipment			
	<input checked="" type="checkbox"/>	Other: In accordance with the manufacturer's instructions			

Modules / parts	Module / parts of test item	Type	Manufacturer
	See section Annex A Supplementary information: See section Annex B		

Operating modes	No.	Operating mode of test item	Applied for testing	
			Emission	Immunity
	1	Powered by 230 VAC 50 Hz, in accordance with the manufacturer's instructions	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
	2	Powered by 120 VAC 60 Hz, in accordance with the manufacturer's instructions	<input type="checkbox"/>	<input type="checkbox"/>
	3	EUT with battery power Powered by ...VDC (built-in battery), in accordance with the manufacturer's instructions	<input type="checkbox"/>	<input type="checkbox"/>
Supplemental information to the operating modes	N/A			
Accessories (not part of the test item)	Accessory	Type	Manufacturer	
	N/A	N/A	N/A	
	AE			
Documents as provided by the applicant	Description	File name	Issue date	
	N/A	N/A	N/A	
Modifications to the test item during testing	N/A			

1.1 Description of test item(s) according to CISPR 15 and IEC 61000-3-2

Description of the test item	<input checked="" type="checkbox"/>	Luminaire
	<input type="checkbox"/>	Rope light (6.3)
	<input type="checkbox"/>	Internal Module (6.4.3)
	<input type="checkbox"/>	External module (6.4.4)
	<input type="checkbox"/>	Module having multiple applications (6.4.2)
	<input type="checkbox"/>	Single capped self-ballasted lamp (6.4.5)
	<input type="checkbox"/>	Double-capped self-ballasted lamps, double-capped lamp adapters, double-capped semi-luminaires and double-capped retrofit lamps used in fluorescent lamp luminaires (6.4.6)
	<input type="checkbox"/>	ELV lamps (6.4.7)
	<input type="checkbox"/>	Single-capped semi-luminaires (6.4.8)
	<input type="checkbox"/>	Independent igniter (6.4.9)
	<input type="checkbox"/>	Replaceable starters for fluorescent lamps (6.4.10)
	<input type="checkbox"/>	Others: LED converter
Lamp technology used	<input checked="" type="checkbox"/>	Light emitting diode (LED/OLED)
	<input type="checkbox"/>	High pressure discharge lamp (HID)
	<input type="checkbox"/>	Fluorescent lamp
	<input type="checkbox"/>	Tungsten halogen lamp
	<input type="checkbox"/>	Incandescent lamp
	<input type="checkbox"/>	Others: ---
Control Gear	<input checked="" type="checkbox"/>	Electronic control gear
	<input type="checkbox"/>	Magnetic control gear / transformer
	<input type="checkbox"/>	Others: ---

Dimming..... :	<input checked="" type="checkbox"/>	Test item has NO dimming functions
	<input type="checkbox"/>	Test item includes dimming functions other than phase control
	<input type="checkbox"/>	Test item has phase control dimming functions with the following characteristic(s):
	<input type="checkbox"/>	rated power less than or equal to 1 kW when operating incandescent lamps
	<input type="checkbox"/>	rated power less than or equal to 200 W for trailing edge dimmers, and universal phase control dimmers with the default mode set to trailing edge, when operating lighting equipment other than incandescent lamps
	<input type="checkbox"/>	rated power less than or equal to 100 W for leading edge dimmers, and universal phase control dimmers without default mode set to trailing edge, when operating lighting equipment other than incandescent lamps
	<input type="checkbox"/>	Other: ---

Type of equipment..... :	<input checked="" type="checkbox"/>	Not for professional use
	<input type="checkbox"/>	For professional use
	<input type="checkbox"/>	Others: Supply power

1.2 Photos of the test item

Photo of test item:



Photo of test item:

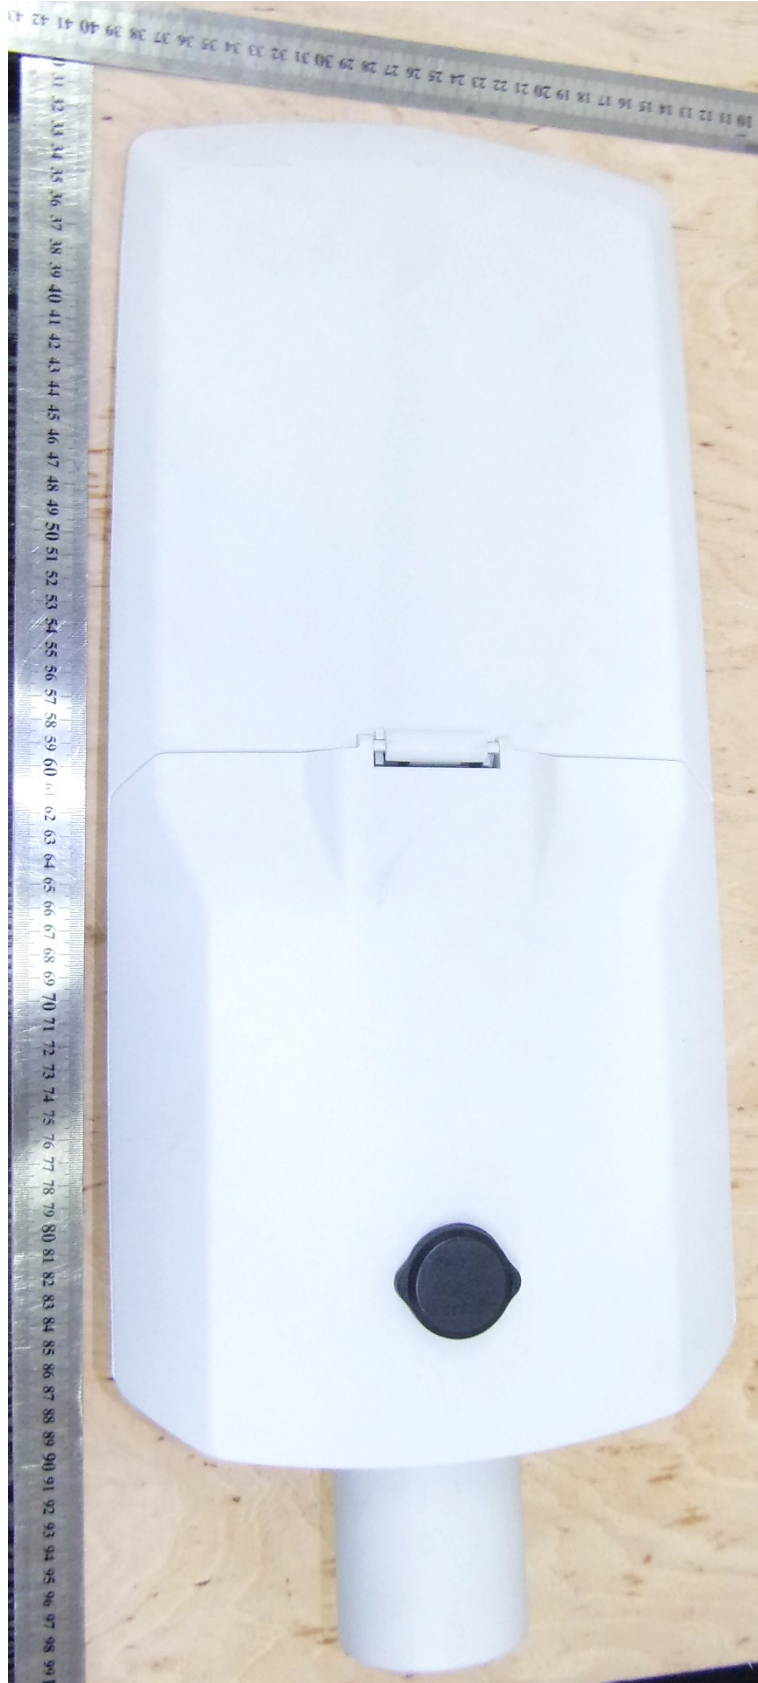


Photo of test item:



2 Verdict summary section

CISPR15			
Clause	Requirement – Test case	Basic standard	Verdict
4.3	Assessment of wired network ports Table 1, Table 2, Table 3	CISPR 16-1-1:2019 CISPR 16-1-2:2014+AMD1:2017	Pass
4.4	Assessment of local wired ports Table 4, Table 5, Table 6	CISPR 16-2-1:2014+AMD1:2017 CISPR 32:2015+AMD1:2019	N/A
4.5	Assessment of the enclosure port	---	---
4.5.2	Frequency range 9 kHz to 30 MHz Table 8, Table 9	CISPR 16-1-4:2019+AMD1:2020 CISPR 15:2018	Pass
4.5.3	Frequency range 30 MHz to 1 GHz Table 10	CISPR 16-2-3:2016+AMD1:2019	Pass
IEC 61000-3-2			
Clause	Requirement – Test case	Basic standard	Verdict
6.2 6.3	Harmonic current emissions	IEC 61000-3-2:2018+AMD1:2020 IEC 61000-4-7:2002+AMD1:2008	Pass
IEC 61000-3-3			
Clause	Requirement – Test case	Basic standard	Verdict
4	Voltage changes, voltage fluctuations and flicker	IEC 61000-3-3:2013+AMD1:2017 IEC 61000-4-15:2010	Pass
IEC 61547			
Clause	Requirement – Test case	Basic standard	Verdict
5.2	Electrostatic discharge	IEC 61000-4-2:2008	Pass
5.3	Radio-frequency electromagnetic fields	IEC 61000-4-3:2020	Pass
5.4	Power frequency magnetic fields	IEC 61000-4-8:2009	Pass
5.5	Fast transients	IEC 61000-4-4:2012	Pass
5.6	Injected currents (radio-frequency common mode)	IEC 61000-4-6:2013	Pass
5.7	Surges	IEC 61000-4-5:2014+AMD1:2017	Pass
5.8	Voltage dips and short interruptions	IEC 61000-4-11:2020	Pass
Supplementary information:			
According to ISO / IEC Guide 98-4 for the assessment of compliance of the measurement result with the requirements, criterion B was chosen. 50% risk of incorrect assessment decision belongs to the customer and 50% risk of incorrect assessment belongs to the laboratory.			

3 Test conditions

3.1 General

Environmental reference conditions	The climatic conditions during the tests are within the limits specified by the manufacturer for the operation of the EUT and the test equipment. The climatic conditions during the tests were within the following limits:		
	Temperature	Humidity	Atmospheric pressure
	15°C – 35°C	30% – 60%	860 hPa – 1060 hPa
	If explicitly required in the basic standard or applied product standard the climatic values are recorded and documented separately in this test report.		
Measurement uncertainties	For all measurements where guidance for the calculation of the instrumentation uncertainty of a measurement is specified in CISPR 16-4-2 , IEC 61000-4 series or a product standard, the measurement instrumentation uncertainty has been calculated an applied in accordance with these standards. In all cases if the test laboratory uncertainty is larger than the value for UCISPR given in CISPR 16-4-2 the uncertainty are included in the test report annex. In case the standards in the IEC 61000-4 series or the product standard requires the indication of the uncertainty in the report these uncertainty values are included in the annex.		

3.2 Specific test conditions for CISPR 15

Test set up	<input checked="" type="checkbox"/>	CISPR 15
	<input type="checkbox"/>	CISPR 30 technical report applied for built-in appliances
Type of test item (Clause 6.2 of CISPR 15).....	<input checked="" type="checkbox"/>	Active EUT
	<input type="checkbox"/>	Passive EUT (Deemed to comply without further testing)
	<input type="checkbox"/>	Others: ---
Maximum clock frequency (Clause 3.2.2)..... *No available data for these selection criteria	<input type="checkbox"/>	≤ 30 MHz → Measurement of radiated emissions up to 300 MHz is sufficient.
	<input checked="" type="checkbox"/>	> 30 MHz → Measurement of radiated emissions up to 1000 MHz is required.

4 Emission

4.1 Conducted disturbances

Tested by	Marek Gabryszewski	
Test date	2022-07-12	
Test Location (stand)	Disturbance voltage stand Faraday Cage U-11	
Test set-up description	<input type="checkbox"/>	Set-up Type A (40 cm distance to vertical ground plane, 80 cm o ground plane)
	<input checked="" type="checkbox"/>	Set-up Type B (40 cm distance to horizontal ground plane)
	<input type="checkbox"/>	Floor standing equipment set-up (10 cm over ground plane)
	<input type="checkbox"/>	Other: ---
	<input type="checkbox"/>	Artificial hand applied (See photo)
Supplementary Test set-up description	Operating mode: 1	
Test method applied	<input checked="" type="checkbox"/>	Voltage disturbance measurement (Table 1, Table 2, Table 4, Table 5)
	<input type="checkbox"/>	Current disturbance measurement (Table 3, Table 6)
	<input type="checkbox"/>	Other: ---
Supplementary information.....	---	

Test set-up photo:




IMiF PREDOM Division Disturbance Voltage Measurement

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Phase L1
 File name: _55015_.RES
 Date: 12. Jul 22 09:03

Overview Scan Settings (2 Ranges)

----- Frequencies -----			----- Receiver Settings -----					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	
9k	150k	61.0Hz	200Hz	PK+AV	10ms	60dB LN	OFF	
150k	30M	3.9k	9k	PK+AV	10ms	15dB LN	OFF	

Final Measurement: x QP / + AV
 Meas Time: 1 s
 Subranges: 25
 Acc Margin: 25dB

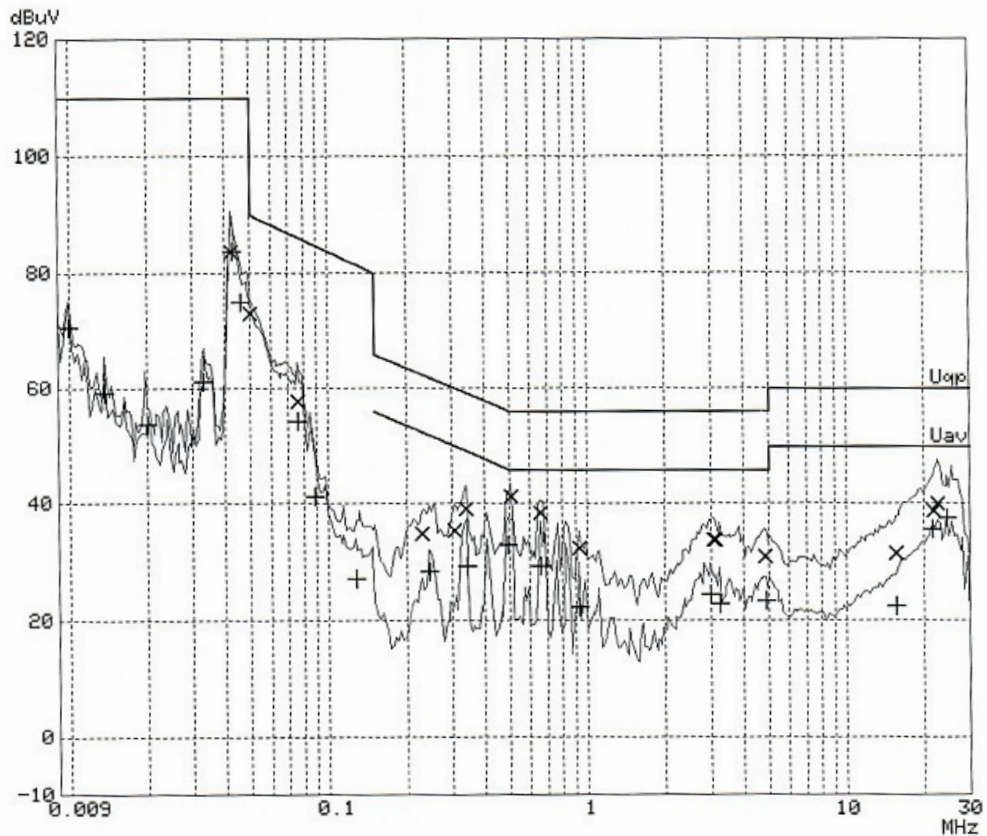

IMiF PREDOM Division Disturbance Voltage Measurement

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Phase L1
 File name: _55015_.RES
 Date: 12. Jul 22 09:03

Final Measurement Results:

Indicated Phase/PE shows Configuration of max. Emission

Frequency MHz	QP Level dBuV	Delta Limit dB	Phase -	PE -
0.0422031	83.7	-26.2	L1	gnd
0.05014	72.9	-17.0	N	gnd
0.07571	57.8	-28.3	N	gnd
0.22813	34.8	-27.7	L1	gnd
0.30625	35.3	-24.8	L1	gnd
0.33750	39.2	-20.1	L1	gnd
0.50547	41.2	-14.7	L1	gnd
0.65391	38.4	-17.5	L1	gnd
0.92734	32.2	-23.7	L1	gnd
3.07578	33.8	-22.1	N	gnd
3.11094	33.7	-22.2	N	gnd
4.82578	30.9	-25.0	N	gnd
15.54063	31.5	-28.4	N	gnd
21.68516	38.8	-21.1	L1	gnd
22.59141	40.1	-19.9	L1	gnd

Frequency MHz	AV Level dBuV	Delta Limit dB	Phase -	PE -
0.0099155	70.6		N	gnd
0.0135776	59.2		L1	gnd
0.0199253	53.9		N	gnd
0.0329258	61.3		L1	gnd
0.0425083	83.8		N	gnd
0.0457432	74.9		N	gnd
0.07571	54.4		L1	gnd
0.08786	41.4		L1	gnd
0.12637	27.1		L1	gnd
0.24375	28.3	-23.7	L1	gnd
0.34141	29.3	-19.9	N	gnd
0.48984	32.8	-13.3	N	gnd
0.65391	29.3	-16.6	N	gnd
0.92344	22.2	-23.7	N	gnd
2.98203	24.4	-21.5	L1	gnd
3.24766	22.8	-23.1	N	gnd
4.89609	23.2	-22.7	N	gnd
15.48203	22.5	-27.4	L1	gnd
21.50547	35.6	-14.4	L1	gnd
24.57578	37.5	-12.5	L1	gnd

* limit exceeded


IMiF PREDOM Division Disturbance Voltage Measurement

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Phase N
 File name: _55015_.RES
 Date: 12. Jul 22 09:23

Overview Scan Settings (2 Ranges)

----- Frequencies -----			----- Receiver Settings -----				
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp
9k	150k	61.0Hz	200Hz	PK+AV	10ms	60dBLN	OFF
150k	30M	3.9k	9k	PK+AV	10ms	15dBLN	OFF

Final Measurement: x QP / + AV
 Meas Time: 1 s
 Subranges: 25
 Acc Margin: 25dB

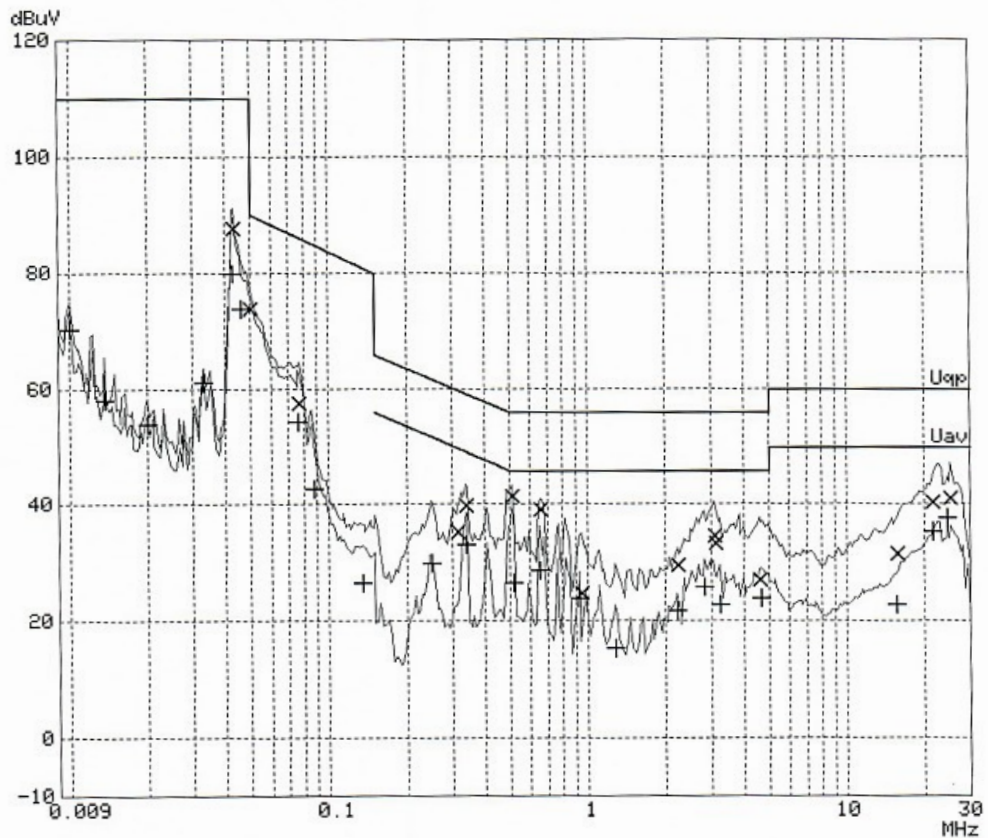

IMiF PREDOM Division Disturbance Voltage Measurement

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Phase N
 File name: _55015_.RES
 Date: 12. Jul 22 09:23

Final Measurement Results:

Indicated Phase/PE shows Configuration of max. Emission

Frequency MHz	QP Level dBuV	Delta Limit dB	Phase -	PE -
0.0429966	87.7	-22.2	L1	gnd
0.05002	73.9	-16.0	N	gnd
0.07644	57.7	-28.4	N	gnd
0.31406	35.4	-24.4	L1	gnd
0.33750	39.8	-19.5	L1	gnd
0.50938	41.4	-14.5	L1	gnd
0.65391	39.1	-16.8	N	gnd
0.94297	24.7	-31.2	N	gnd
2.22422	29.6	-26.3	N	gnd
3.08750	34.7	-21.2	L1	gnd
3.11875	33.4	-22.5	N	gnd
4.61094	27.1	-28.8	N	gnd
15.66172	31.5	-28.4	N	gnd
21.50156	40.4	-19.6	L1	gnd
25.22813	41.1	-18.8	L1	gnd

Frequency MHz	AV Level dBuV	Delta Limit dB	Phase -	PE -
0.0099766	70.5		N	gnd
0.0135776	58.2		L1	gnd
0.0199863	54.1		N	gnd
0.0329258	61.3		L1	gnd
0.0425693	79.9		N	gnd
0.0458652	73.8		L1	gnd
0.07614	54.4		L1	gnd
0.08737	42.7		L1	gnd
0.13424	26.6		N	gnd
0.24766	29.9	-21.9	L1	gnd
0.33750	33.2	-16.1	L1	gnd
0.51328	26.6	-19.3	N	gnd
0.65000	28.8	-17.1	L1	gnd
0.92734	23.8	-22.1	L1	gnd
1.27500	15.3	-30.6	N	gnd
2.20078	21.7	-24.2	N	gnd
2.80234	25.8	-20.1	N	gnd
3.23984	22.8	-23.1	N	gnd
4.64609	23.8	-22.1	L1	gnd
15.60703	22.8	-27.1	N	gnd
21.50547	35.3	-14.6	L1	gnd
24.57578	37.6	-12.3	L1	gnd

* limit exceeded

4.2 Radiated electromagnetic disturbances (9 kHz to 30 MHz)

Tested by	Marek Gabryszewski	
Test date	2022-07-13	
Test Location (stand)	Radiated electromagnetic disturbances (9 kHz to 30 MHz) stand	
Applied Limit for antenna measurement (Table 9)	<input type="checkbox"/>	Loop antenna radiated disturbance limit 9 kHz – 30 MHz for equipment with a dimension > 1.6 m
Applied limit according to LLAS diameter (Table 8)	<input checked="" type="checkbox"/>	2 m for equipment length not exceeding 1.6 m
	<input type="checkbox"/>	3 m for equipment length between 1.6 m and 2.6 m
	<input type="checkbox"/>	4 m for equipment length between 2.6 m and 3.6 m
Test set-up description	<input checked="" type="checkbox"/>	Equipment placed in the centre of the LLAS
	<input type="checkbox"/>	Equipment on a table 80 cm height
	<input type="checkbox"/>	Equipment on the floor (isolated from ground plane)
	<input type="checkbox"/>	Other: ---
Supplementary test set-up description	Position: Vertical and Horizontal Operating mode: 1	
Supplementary information.....	---	

Test set-up photo:




IMiF PREDOM Division Measurement of Radiation Disturbances

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Vertical
 File name: 55015_V.RES
 Date: 13. Jul 22 10:31

Overview Scan Settings (2 Ranges)

Frequencies			Receiver Settings					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	
9k	150k	61.0Hz	200Hz	PK	10ms	35dB LN	OFF	
150k	30M	3.9k	9k	PK	10ms	5dB LN	OFF	

Final Measurement: x Hor-Max / + Vert-Max
 Meas Time: 1 s
 Subranges: 25
 Acc Margin: 25dB

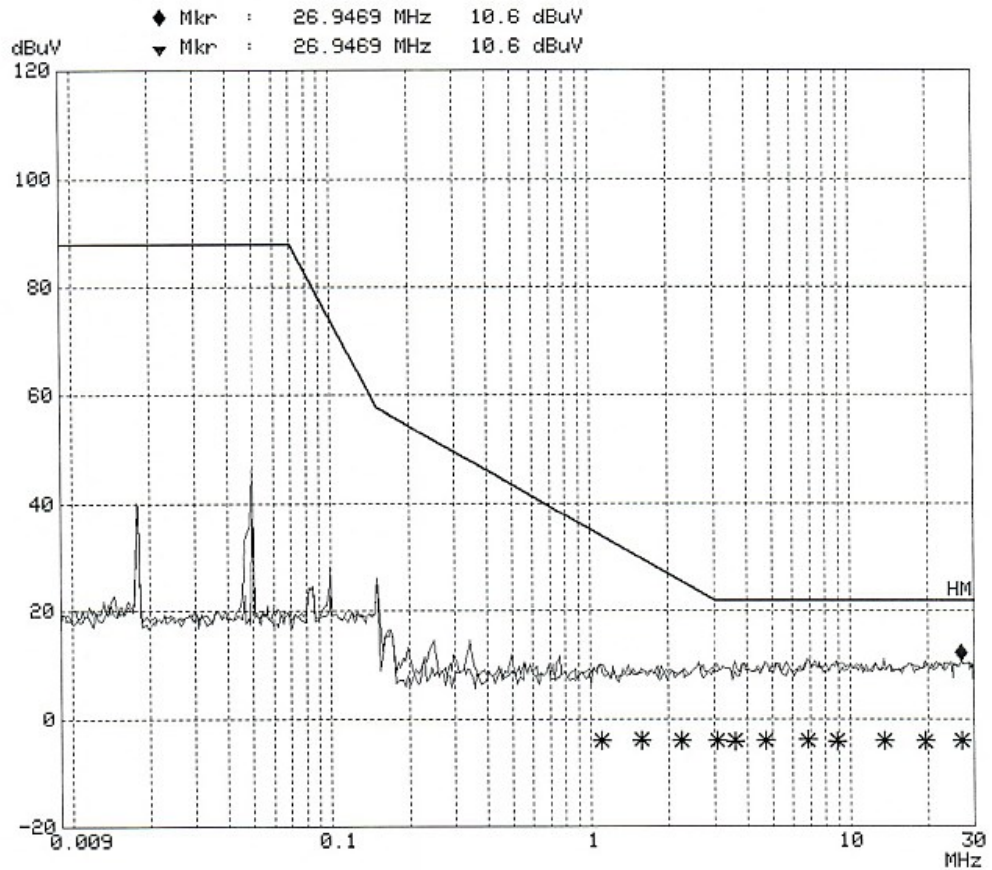

IMiF PREDOM Division Measurement of Radiation Disturbances

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Vertical
 File name: 55015_V.RES
 Date: 13. Jul 22 10:31

Final Measurement Results:

Frequency MHz	QP Level hor. dBuV	QP Level vert. dBuV	Delta Limit dB
1.09141	-3.7	-3.7	-38.0
1.56406	-3.7	-3.8	-33.6
2.22031	-3.8	-3.8	-29.5
3.05234	-3.7	-3.7	-25.7
3.59922	-3.8	-4.0	-25.8
4.69297	-3.7	-3.8	-25.7
6.81406	-3.8	-3.6	-25.6
8.85313	-3.8	-3.9	-25.8
13.47813	-3.8	-3.8	-25.8
19.40000	-3.9	-3.7	-25.7
26.94688	-3.8	-3.8	-25.8

* limit exceeded


IMiF PREDOM Division Measurement of Radiation Disturbances

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Horizontal
 File name: 55015_H.RES
 Date: 13. Jul 22 11:52

Overview Scan Settings (2 Ranges)

Frequencies			Receiver Settings				
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp
9k	150k	61.0Hz	200Hz	PK	10ms	35dBLN	OFF
150k	30M	3.9k	9k	PK	10ms	10dBLN	OFF

Final Measurement: x QP / + AV
 Meas Time: 1 s
 Subranges: 25
 Acc Margin: 25dB

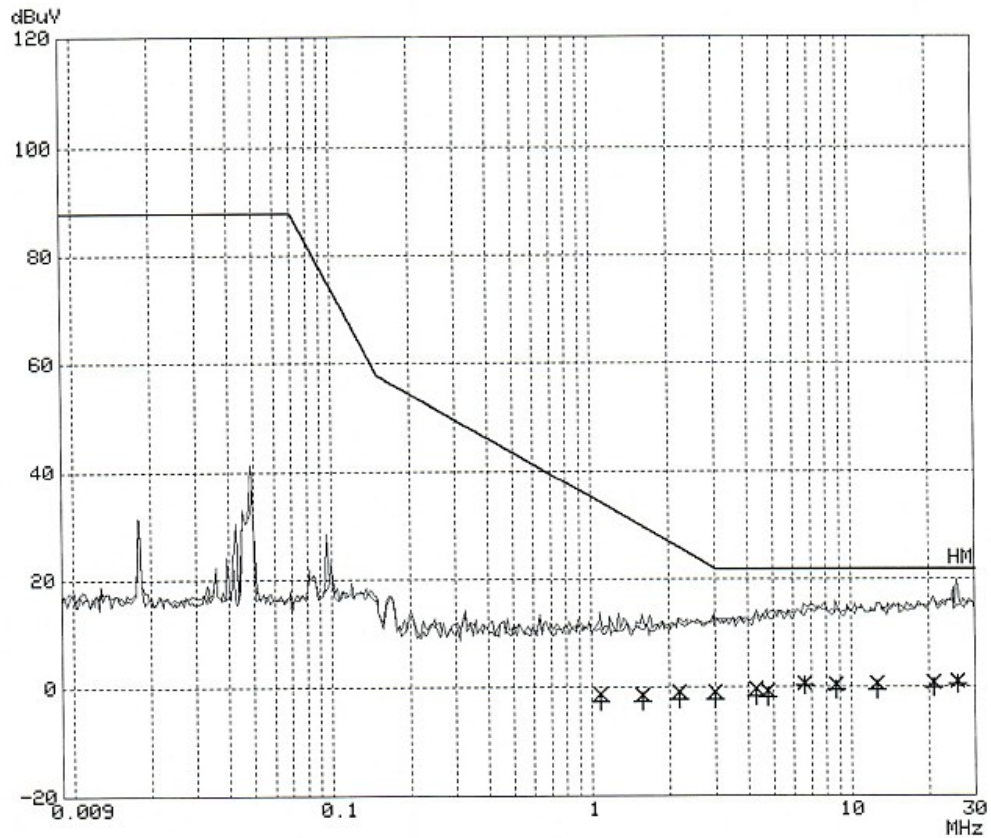

IMiF PREDOM Division Measurement of Radiation Disturbances

EUT: URBINO IK10 LED
 Manuf: LUG Light Factory sp. z o.o.
 Test Spec: EN 55015
 Comment: Horizontal
 File name: 55015_H.RES
 Date: 13. Jul 22 11:52

Final Measurement Results:

Frequency MHz	QP Level dBuV	Delta Limit dB
1.07969	-1.1	-35.4
1.56797	-1.4	-31.3
2.16172	-0.7	-26.7
2.97031	-0.8	-23.1
4.27891	-0.2	-22.2
4.72813	-0.4	-22.4
6.55625	0.7	-21.2
8.73203	0.6	-21.3
12.57969	0.8	-21.1
20.71641	1.0	-20.9
25.74375	1.2	-20.7

Frequency MHz	AV Level dBuV	Delta Limit dB
1.07969	-2.4	
1.56797	-2.4	
2.16172	-2.0	
2.97031	-2.0	
4.27891	-1.5	
4.72813	-1.6	
6.55625	0.4	
8.73203	-0.3	
12.57969	-0.3	
20.71641	0.0	
25.74375	0.5	

* limit exceeded

4.3 Radiated electromagnetic disturbances (30 MHz to 1000 MHz)

Tested by	Marek Gabryszewski	
Test date	2022-07-11	
Test Location (stand)	Radiated electromagnetic disturbances stand Semi- anechoic chamber U-86	
Applied limit class	<input checked="" type="checkbox"/>	Table 10 Radiated disturbance limits
	<input type="checkbox"/>	Other: ---
Test set-up description	<input checked="" type="checkbox"/>	Equipment on a table of 80 cm height
	<input type="checkbox"/>	Equipment on the floor (insulated from ground plane)
	<input type="checkbox"/>	Equipment located approximately in the middle of the validated test volume (FAR)
	<input type="checkbox"/>	Equipment on a 10 cm support over the ground plane according CDNE-Method
	<input type="checkbox"/>	Other: ---
Supplementary test set-up description	Operating mode: 1	
Test method applied	<input type="checkbox"/>	CDN(E)
	<input checked="" type="checkbox"/>	OATS or SAC with measurement distance [m]: 10
	<input type="checkbox"/>	FAR with measurement distance [m]: ---
	<input type="checkbox"/>	TEM Waveguide (test item without cables and max. 300 mm dimension)
	<input type="checkbox"/>	Other: ---
Supplementary information	---	

Test set-up photo:



EMC32 Report

EMI Auto Test Template: 55015 EMI Test Auto 30MHz-1000MHz - 10m

Hardware Setup: HL562 EMI
Measurement Type: Open-Area-Test-Site
Frequency Range: 30 MHz - 1 GHz
Graphics Level Range: 0 dB μ V/m - 60 dB μ V/m


Preview Measurements:
Scan Test Template: EMI Prescan auto

Frequency Zoom:
Zoom Scan Template: EMI Zoom auto

Maximization Measurements:
Template for Single Meas.: EMI Prescan auto

Final Measurements:
Template for Single Meas.: EMI Final auto


EMC32 Report 0deg

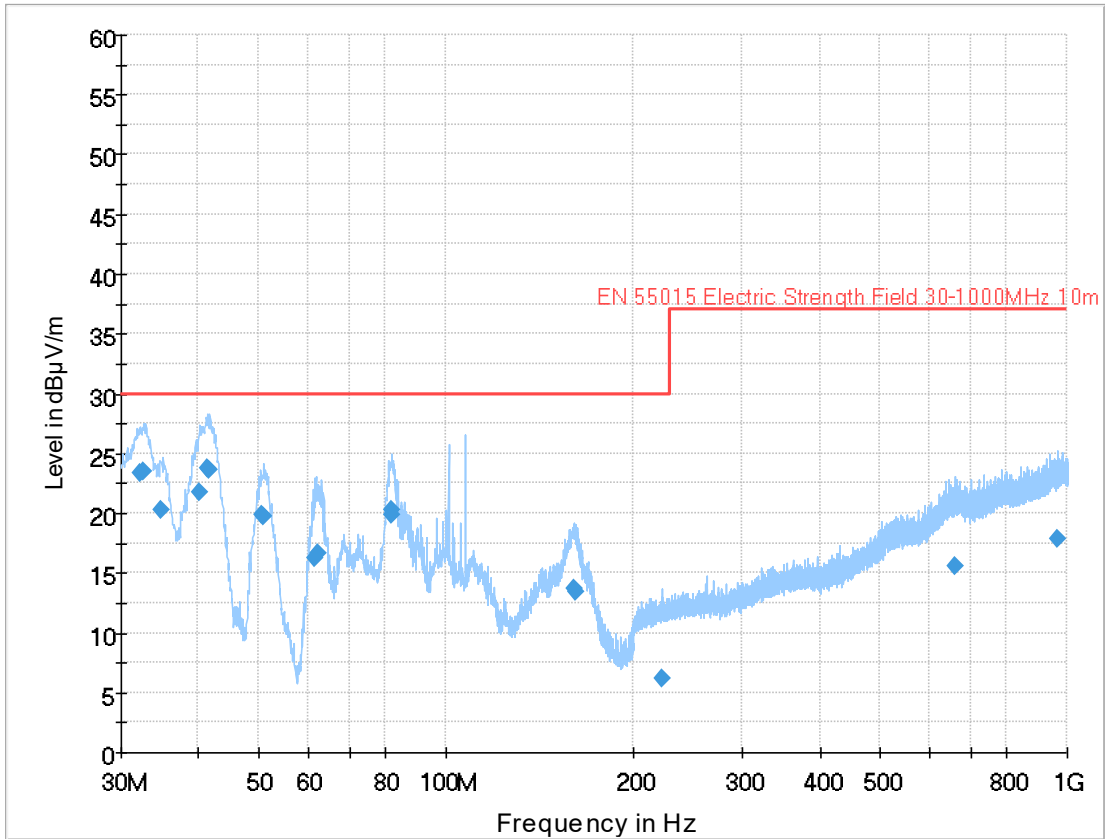

Final Result

Frequency (MHz)	QuasiPeak (dBµV/m)	Limit (dBµV/m)	Margin (dB)	Meas. Time (ms)	Bandwidth (kHz)	Height (cm)	Pol	Azimuth (deg)	Corr. (dB/m)
32.160000	23.35	30.00	6.65	1000.0	120.000	300.0	H	0.0	21
32.606500	23.51	30.00	6.49	1000.0	120.000	300.0	H	0.0	21
34.860000	20.28	30.00	9.72	1000.0	120.000	100.0	V	0.0	20
40.140000	21.68	30.00	8.32	1000.0	120.000	100.0	V	0.0	17
41.402100	23.71	30.00	6.29	1000.0	120.000	100.0	V	0.0	16
41.580000	23.63	30.00	6.37	1000.0	120.000	100.0	V	0.0	16
50.605900	19.87	30.00	10.13	1000.0	120.000	100.0	V	0.0	11
50.940000	19.76	30.00	10.24	1000.0	120.000	100.0	V	0.0	11
61.561300	16.19	30.00	13.81	1000.0	120.000	200.0	V	0.0	8
62.220000	16.60	30.00	13.40	1000.0	120.000	200.0	V	0.0	9
81.720000	20.33	30.00	9.67	1000.0	120.000	300.0	V	0.0	12
81.961400	19.90	30.00	10.10	1000.0	120.000	200.0	V	0.0	12
160.620000	13.68	30.00	16.32	1000.0	120.000	200.0	V	0.0	11
161.595500	13.41	30.00	16.59	1000.0	120.000	100.0	V	0.0	11
222.225500	6.13	30.00	23.87	1000.0	120.000	100.0	H	0.0	12
658.500000	15.53	37.00	21.47	1000.0	120.000	400.0	H	0.0	22
963.444500	17.87	37.00	19.13	1000.0	120.000	100.0	H	0.0	26


EMC32 Report 90deg

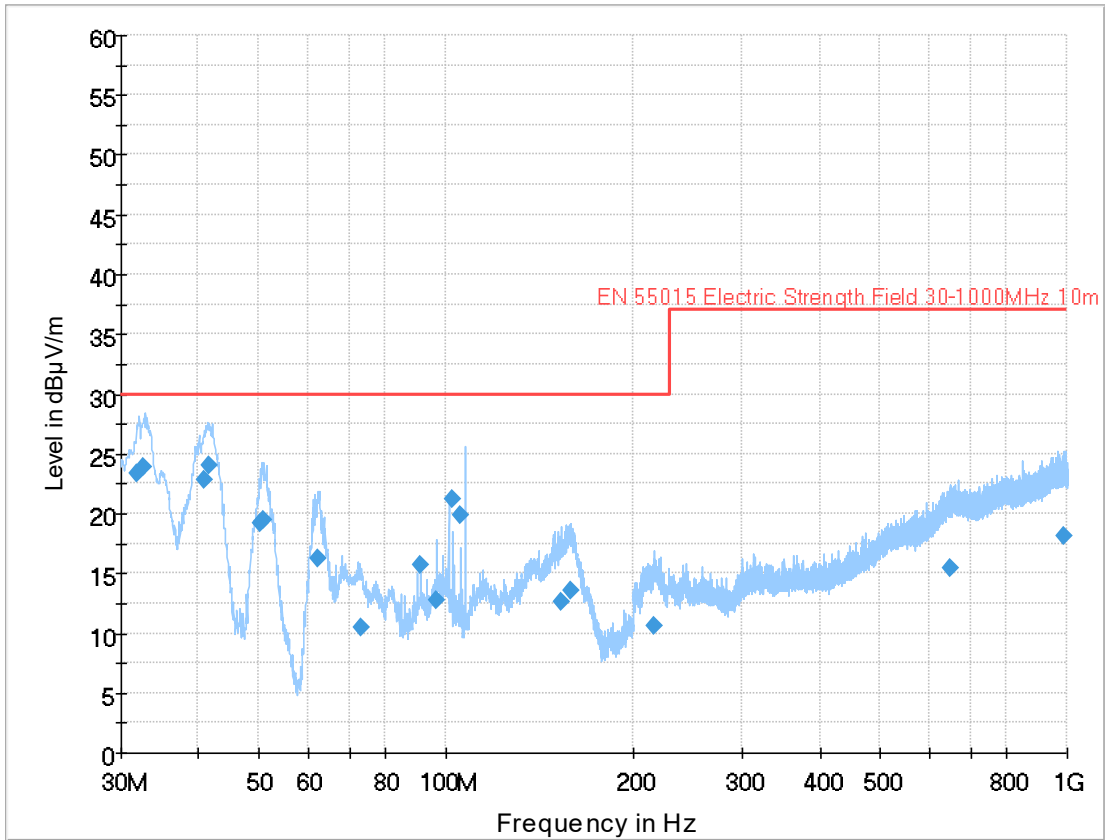

Final Result

Frequency (MHz)	QuasiPeak (dBµV/m)	Limit (dBµV/m)	Margin (dB)	Meas. Time (ms)	Bandwidth (kHz)	Height (cm)	Pol	Azimuth (deg)	Corr. (dB/m)
31.920000	23.29	30.00	6.71	1000.0	120.000	300.0	H	90.0	21
32.636500	23.93	30.00	6.07	1000.0	120.000	300.0	H	90.0	21
40.740000	22.86	30.00	7.14	1000.0	120.000	100.0	V	90.0	16
41.523000	24.00	30.00	6.00	1000.0	120.000	100.0	V	90.0	16
50.280000	19.22	30.00	10.78	1000.0	120.000	100.0	V	90.0	11
50.805000	19.43	30.00	10.57	1000.0	120.000	100.0	V	90.0	11
62.358300	16.26	30.00	13.74	1000.0	120.000	100.0	V	90.0	9
72.900000	10.51	30.00	19.49	1000.0	120.000	400.0	V	90.0	11
91.020000	15.68	30.00	14.32	1000.0	120.000	100.0	V	90.0	11
96.480000	12.82	30.00	17.18	1000.0	120.000	400.0	V	90.0	11
102.448000	21.25	30.00	8.75	1000.0	120.000	200.0	V	90.0	11
105.621500	19.81	30.00	10.19	1000.0	120.000	200.0	V	90.0	11
153.120000	12.62	30.00	17.38	1000.0	120.000	200.0	V	90.0	11
159.175500	13.60	30.00	16.40	1000.0	120.000	200.0	V	90.0	11
216.796000	10.58	30.00	19.42	1000.0	120.000	400.0	H	90.0	12
647.280000	15.44	37.00	21.56	1000.0	120.000	100.0	V	90.0	21
990.813500	18.17	37.00	18.83	1000.0	120.000	400.0	H	90.0	26


EMC32 Report 180deg

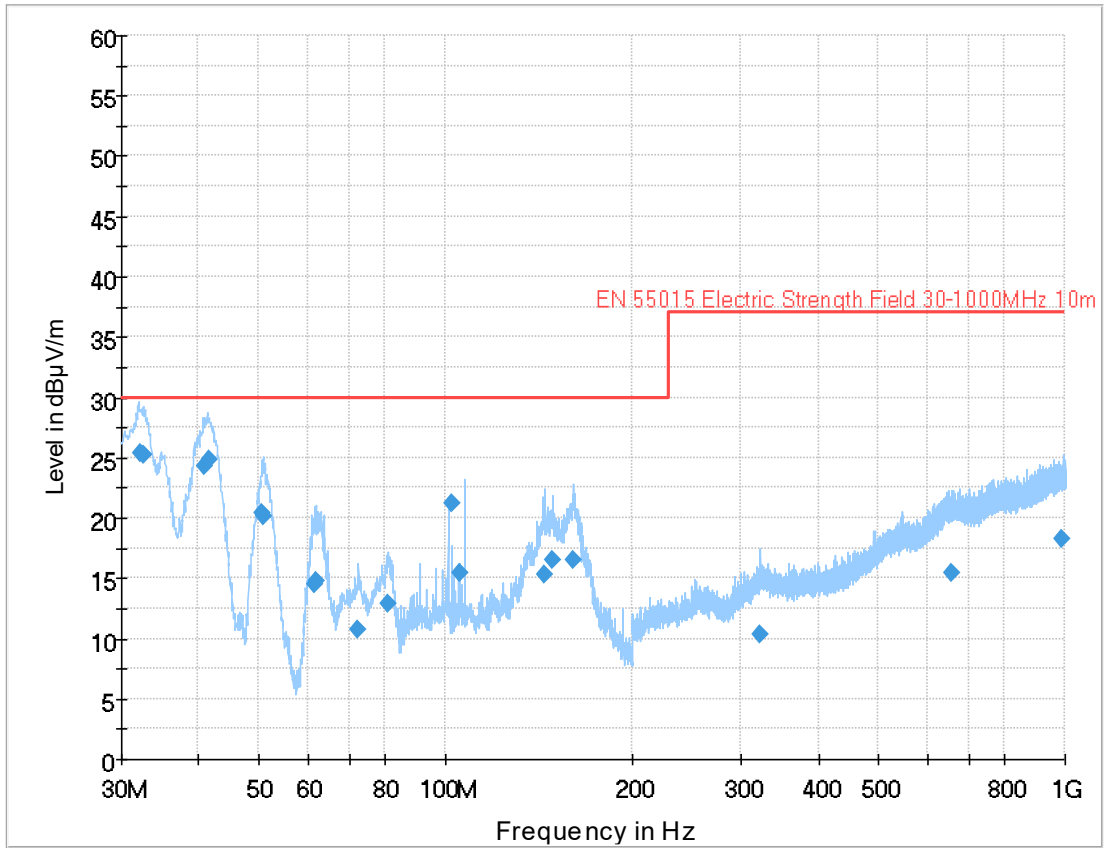

Final Result

Frequency (MHz)	QuasiPeak (dBµV/m)	Limit (dBµV/m)	Margin (dB)	Meas. Time (ms)	Bandwidth (kHz)	Height (cm)	Pol	Azimuth (deg)	Corr. (dB/m)
32.130100	25.33	30.00	4.67	1000.0	120.000	300.0	H	180.0	21
32.520000	25.22	30.00	4.78	1000.0	120.000	300.0	H	180.0	21
40.860000	24.29	30.00	5.71	1000.0	120.000	100.0	V	180.0	16
41.513300	24.86	30.00	5.14	1000.0	120.000	100.0	V	180.0	16
50.716200	20.36	30.00	9.64	1000.0	120.000	100.0	V	180.0	11
50.760000	20.08	30.00	9.92	1000.0	120.000	100.0	V	180.0	11
61.620000	14.44	30.00	15.56	1000.0	120.000	200.0	V	180.0	8
61.751300	14.71	30.00	15.29	1000.0	120.000	100.0	V	180.0	9
72.360000	10.77	30.00	19.23	1000.0	120.000	300.0	V	180.0	11
80.935300	12.91	30.00	17.09	1000.0	120.000	300.0	V	180.0	12
102.428000	21.25	30.00	8.75	1000.0	120.000	200.0	V	180.0	11
105.600000	15.43	30.00	14.57	1000.0	120.000	300.0	V	180.0	11
144.600000	15.36	30.00	14.64	1000.0	120.000	200.0	V	180.0	11
148.800000	16.52	30.00	13.48	1000.0	120.000	200.0	V	180.0	11
161.234000	16.53	30.00	13.47	1000.0	120.000	100.0	V	180.0	11
321.240000	10.35	37.00	26.66	1000.0	120.000	100.0	V	180.0	14
657.180000	15.50	37.00	21.50	1000.0	120.000	100.0	H	180.0	22
987.976000	18.24	37.00	18.76	1000.0	120.000	200.0	H	180.0	26

EMC32 Report 270deg

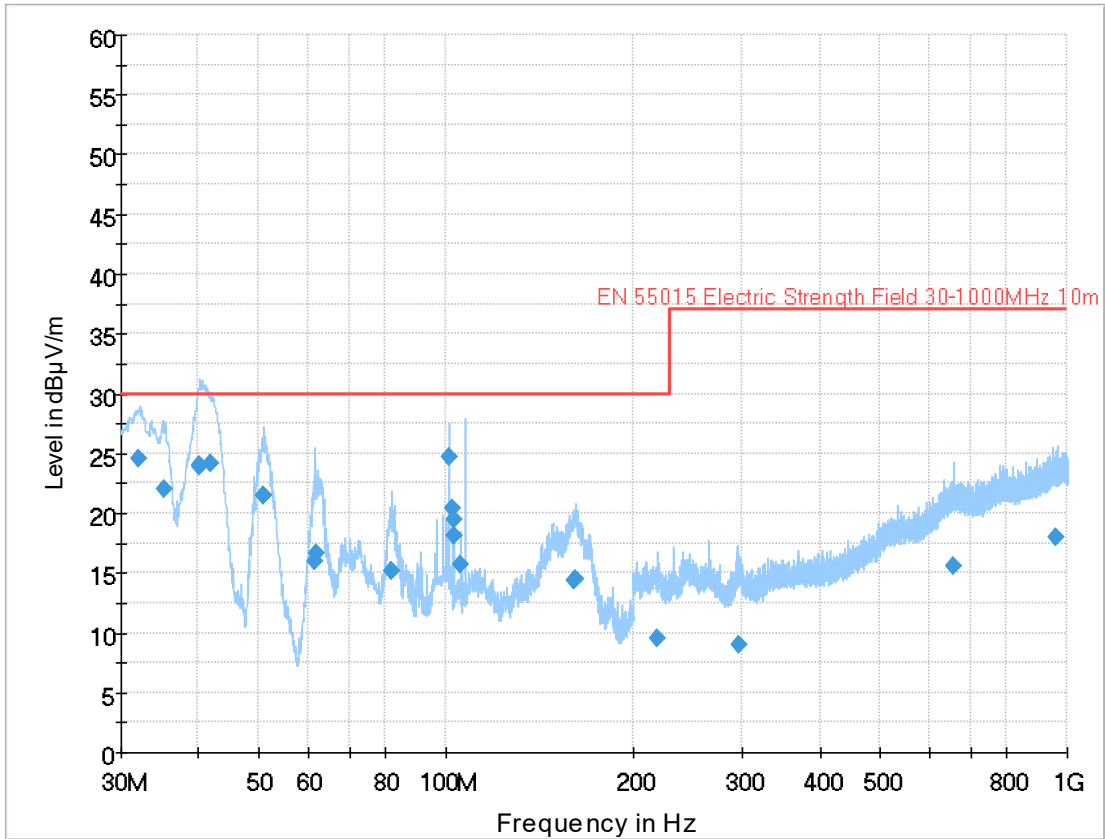

Final Result

Frequency (MHz)	QuasiPeak (dBµV/m)	Limit (dBµV/m)	Margin (dB)	Meas. Time (ms)	Bandwidth (kHz)	Height (cm)	Pol	Azimuth (deg)	Corr. (dB/m)
32.009200	24.58	30.00	5.42	1000.0	120.000	300.0	H	270.0	21
35.220000	22.01	30.00	7.99	1000.0	120.000	100.0	V	270.0	19
40.109000	23.89	30.00	6.11	1000.0	120.000	100.0	V	270.0	17
40.200000	24.08	30.00	5.92	1000.0	120.000	100.0	V	270.0	17
41.820000	24.12	30.00	5.88	1000.0	120.000	100.0	V	270.0	16
50.820000	21.43	30.00	8.57	1000.0	120.000	100.0	V	270.0	11
50.895900	21.52	30.00	8.48	1000.0	120.000	100.0	V	270.0	11
61.380000	15.98	30.00	14.02	1000.0	120.000	200.0	V	270.0	8
61.761600	16.62	30.00	13.38	1000.0	120.000	200.0	V	270.0	9
81.711400	15.15	30.00	14.85	1000.0	120.000	200.0	V	270.0	12
81.720000	15.15	30.00	14.85	1000.0	120.000	200.0	V	270.0	12
101.035000	24.68	30.00	5.32	1000.0	120.000	200.0	V	270.0	11
102.438000	20.44	30.00	9.56	1000.0	120.000	200.0	V	270.0	11
103.025000	19.48	30.00	10.52	1000.0	120.000	200.0	V	270.0	11
103.080000	18.07	30.00	11.93	1000.0	120.000	100.0	V	270.0	11
105.612000	15.66	30.00	14.34	1000.0	120.000	300.0	V	270.0	11
161.182500	14.30	30.00	15.70	1000.0	120.000	100.0	V	270.0	11
161.520000	14.48	30.00	15.52	1000.0	120.000	100.0	V	270.0	11
219.547500	9.55	30.00	20.45	1000.0	120.000	400.0	H	270.0	12
296.160000	9.02	37.00	27.98	1000.0	120.000	100.0	V	270.0	14
656.160000	15.61	37.00	21.39	1000.0	120.000	200.0	V	270.0	22
961.037000	17.94	37.00	19.06	1000.0	120.000	400.0	H	270.0	26

5 Harmonic current emissions according to IEC 61000-3-2

Tested by	Marek Gabryszewski		
Test date	2022-07-13		
Test Location (stand)	U-84		
Version of measurement instrument standard used IEC 61000-4-7 (Clause 7)	<input type="checkbox"/>	IEC 61000-4-7:1991	
	<input checked="" type="checkbox"/>	IEC 61000-4-7:2002 + AMD1:2008	
Test set-up description	---		
Operating modes of EUT	1		
Limit classification in accordance with the standard	<input type="checkbox"/>	Class A	
	<input type="checkbox"/>	Class B	
	<input checked="" type="checkbox"/>	Class C with rated power > 25 W (Table 2)	
	<input type="checkbox"/>	Class C with rated power ≥ 5 and ≤ 25 W (First requirement, Table 3 column 2)	
		<input type="checkbox"/>	Table 3, column 2 (Power related limits)
	<input type="checkbox"/>	3 rd harmonic ≤ 86 %, 5 th harmonic ≤ 61 % and waveform conditions	
	<input type="checkbox"/>	THD ≤ 70 %, Harmonics: 3 rd ≤ 35 %, 5 th ≤ 25 %, 7 th ≤ 30 %, 9 th and 11 th ≤ 20 %, 2 nd ≤ 5 %	
	<input type="checkbox"/>	Other: Lighting equipment having a rated power-less to 5 W - test not required.	
<input type="checkbox"/>	Class D		
Observation period	Description		
	<input checked="" type="checkbox"/>	Quasi stationary	
	<input type="checkbox"/>	Short cyclic	
	<input type="checkbox"/>	Random	
	<input type="checkbox"/>	Long cyclic	
		Period selected T_{obs}	
		2.5 min	
		$T_{obs} \geq 10$ cycles =	
		$T_{obs} =$	
		Full program cycle or 2.5 min. with highest THC $T_{obs} =$	
Control method used in the sample according clause 6.2 of the standard	<input checked="" type="checkbox"/>	The EUT does not utilize half-wave rectification or any other method to control the active input power. Such equipment is in conformity with the standard if the measured values comply with the applicable limit.	
	<input type="checkbox"/>	The EUT uses half-wave rectification directly on the mains supply, or it uses symmetrical or asymmetrical methods to control the active input power. Such equipment is permitted under conditions only. An evaluation on the control method is required. However, the equipment shall still comply with the harmonic requirements of the standard.	
Supplementary information	---		

Test set-up photo:



Tabulated/Graphical Results for Harmonic Current Emissions:

Name:		Serial no:	
Department:		Operating modes:	
Company:	IMiF PREDOM Division	Comment1:	
Test report no:	B10-4/076/EMC/22	Comment2:	
Device:	Street Luminaire	Comment3:	
Specimen:		Comment4:	
Manufacturer:	LUG Light Factory	Date:	13.07.2022
Type:	URBINO IK10 LED	Test date:	13.07.2022

Maximum RMS current and corresponding values in timewindow 1:

Voltage:	230.31 Vrms	THD=0.01 %	THV=0.012 V	POHV=0.005 V	PWHD=0.02 %
Current:	0.514 Arms	-0.741 Apk	THD=5.52 %	THC=0.028 A	POHC=0.006 A
Power:	117.1 W	P1=117.1 W	118.4 VA		
Power factor:	0.989	CosPhi1: 0.991			

Test conditions EN IEC 61000-3-2:2019/FprA1:2020, f=50 Hz, Phase=L1, Range=0.80 A
 Time window=16, Grouping (>2nd harm.)=off, Rated I1=3.0 A
 No Ztest selected
 Time window=16, Grouping (>2nd harm.)=off, Rated I1=3.0 A

HARMONIC ANALYSIS: Test PASS


Tobs = worst 2.5 min: tw 1.469; POHC (C.2): avg=0.01 A, limit=0.05 A
 Iavg=0.514 Arms; Rated I1 exceeded, changed to 0.513 A

Ha	Entire measurement (2.5 min = 469 time windows)						Worst 2.5 min		Worst 2.5 min avg		P A S S	F A I L
	Maximum	Window	ENG1000-3-2 Class C>25W	Margin in MaxWin	100 to 150%	Ex- ceeded	100 to 150%	Ex- ceeded	Value	Ex- ceeded		
DC	-0.0014 A	15	-----	-----	0	0	0	0	-0.0007 A	0	X	
1	0.5133 A	1	-----	-----	0	0	0	0	0.5127 A	0	X	
2	0.0005 A	1	0.0103 A	-95.4 %	0	0	0	0	0.0003 A	0	X	
3	0.0057 A	422	0.1386 A	-95.9 %	0	0	0	0	0.0056 A	0	X	
4	0.0002 A	1	-----	-----	0	0	0	0	0.0001 A	0	X	
5	0.0029 A	423	0.0513 A	-94.4 %	0	0	0	0	0.0028 A	0	X	
6	0.0001 A	32	-----	-----	0	0	0	0	0.0001 A	0	X	
7	0.0156 A	421	0.0359 A	-56.7 %	0	0	0	0	0.0155 A	0	X	
8	0.0001 A	311	-----	-----	0	0	0	0	0.0001 A	0	X	
9	0.0133 A	405	0.0257 A	-48.1 %	0	0	0	0	0.0133 A	0	X	
10	0.0001 A	213	-----	-----	0	0	0	0	0.0001 A	0	X	
11	0.0103 A	1	0.0154 A	-33.0 %	0	0	0	0	0.0103 A	0	X	
12	0.0001 A	311	-----	-----	0	0	0	0	0.0001 A	0	X	
13	0.0093 A	2	0.0154 A	-39.8 %	0	0	0	0	0.0092 A	0	X	
14	0.0001 A	213	-----	-----	0	0	0	0	0.0001 A	0	X	
15	0.0084 A	1	0.0154 A	-45.7 %	0	0	0	0	0.0083 A	0	X	
16	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
17	0.0066 A	19	0.0154 A	-56.8 %	0	0	0	0	0.0066 A	0	X	
18	0.0001 A	213	-----	-----	0	0	0	0	0.0001 A	0	X	
19	0.0022 A	311	0.0154 A	-85.6 %	0	0	0	0	0.0022 A	0	X	
20	0.0002 A	213	-----	-----	0	0	0	0	0.0001 A	0	X	
21	0.0036 A	1	0.0154 A	-76.5 %	0	0	0	0	0.0036 A	0	X	
22	0.0001 A	214	-----	-----	0	0	0	0	0.0000 A	0	X	
23	0.0015 A	460	0.0154 A	-90.2 %	0	0	0	0	0.0015 A	0	X	
24	0.0001 A	214	-----	-----	0	0	0	0	0.0000 A	0	X	
25	0.0023 A	230	0.0154 A	-84.9 %	0	0	0	0	0.0023 A	0	X	
26	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
27	0.0019 A	213	0.0154 A	-87.8 %	0	0	0	0	0.0018 A	0	X	
28	0.0001 A	160	-----	-----	0	0	0	0	0.0000 A	0	X	
29	0.0023 A	36	0.0154 A	-85.3 %	0	0	0	0	0.0022 A	0	X	
30	0.0001 A	311	-----	-----	0	0	0	0	0.0001 A	0	X	
31	0.0015 A	213	0.0154 A	-90.3 %	0	0	0	0	0.0014 A	0	X	
32	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
33	0.0007 A	439	0.0154 A	-95.7 %	0	0	0	0	0.0006 A	0	X	
34	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
35	0.0011 A	214	0.0154 A	-93.1 %	0	0	0	0	0.0010 A	0	X	
36	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
37	0.0011 A	213	0.0154 A	-92.6 %	0	0	0	0	0.0011 A	0	X	
38	0.0001 A	213	-----	-----	0	0	0	0	0.0000 A	0	X	
39	0.0003 A	3	0.0154 A	-98.2 %	0	0	0	0	0.0002 A	0	X	
40	0.0001 A	311	-----	-----	0	0	0	0	0.0000 A	0	X	

average value < 0.6 % of Iavg or < 5 mA

Tested with SPSEMC4.5.1 /PAS000 by Spitzberger & Spies GmbH & Co. KG, Schmidstr. 32-34, 94234 Viechtach, Germany, 13.07.2022

Graphical Harmonic Overview - EN61000-3-2 Class C<25W

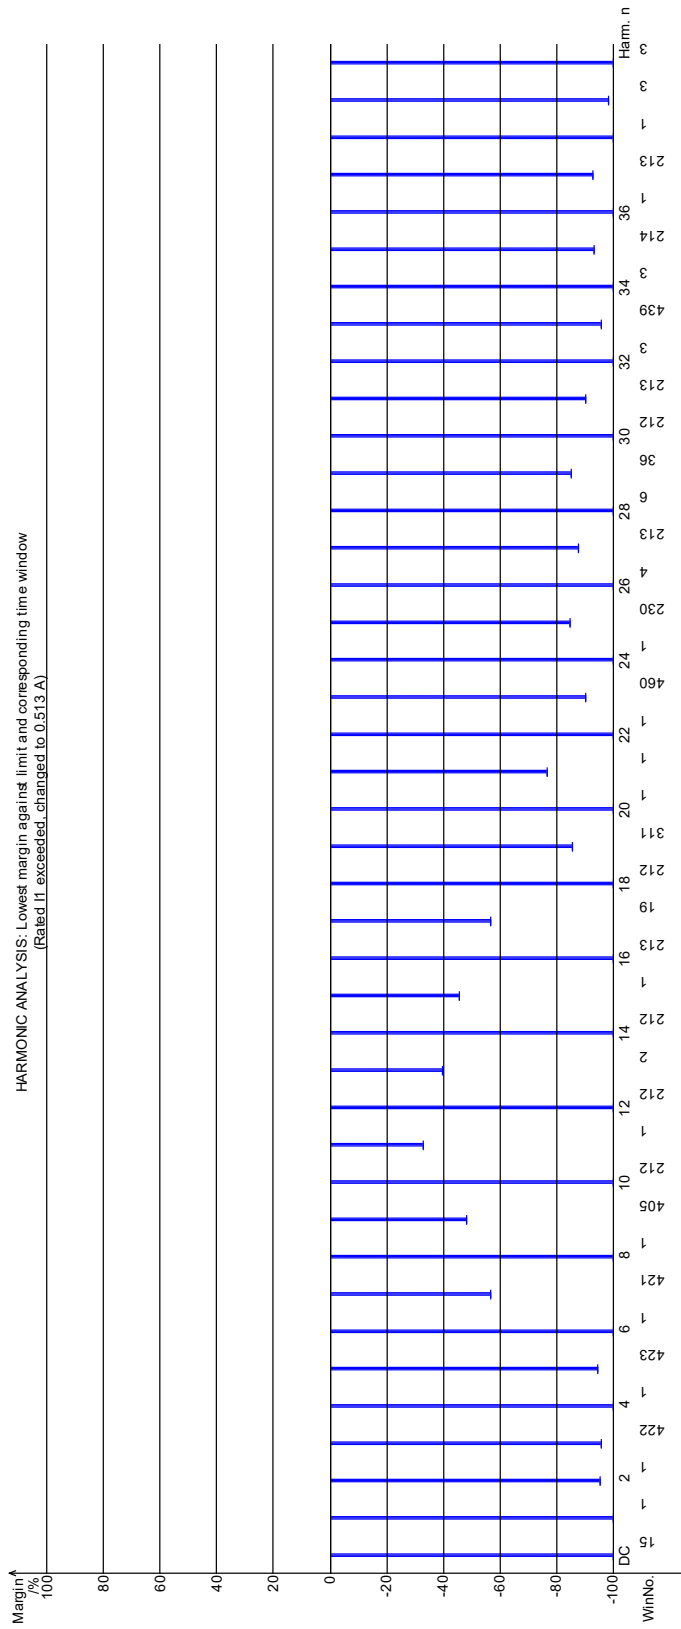

Tested with SPSSIMC V.5.1 (PRESD00) by: S&E electronic & Service GmbH & Co. KG, Schmalz 22-34, 94251 Weiching, Germany, 10.07.2022

6 Voltage changes, voltage fluctuations and flicker according to IEC 61000-3-3

Tested by	Marek Gabryszewski	
Test date	2022-07-13	
Test Location (stand)	U-84	
Test set-up description	---	
Test method	<input checked="" type="checkbox"/>	4.2.2 Flicker meter according IEC 61000-4-15
	<input type="checkbox"/>	4.2.3 Simulation
	<input type="checkbox"/>	4.2.4 Analytical method
	<input type="checkbox"/>	4.2.5 Use of $P_{st} = 1$ curve
Observation time selected	<input checked="" type="checkbox"/>	10 Minutes
	<input type="checkbox"/>	120 Minutes
	<input type="checkbox"/>	24 times switching according to Annex B
Limit for d_{max} applied	<input type="checkbox"/>	4 %
	<input checked="" type="checkbox"/>	6 %
	<input type="checkbox"/>	7 %
Supplementary information	---	

Test set-up photo:



Tabulated Results for Voltage Fluctuations and Flicker:

Name:		Serial no:	
Department:		Operating modes:	
Company:	IMiF PREDOM Division	Comment1:	
Test report no:	B10-4/076/EMC/22	Comment2:	
Device:	Street luminaire	Comment3:	
Specimen:		Comment4:	
Manufacturer:	LUG Light Factory	Date:	13.07.2022
Type:	URBINO IK10 LED	Test date:	13.07.2022

Test conditions EN 61000-3-3:2013 + A1:2019 / 230 V / 50 Hz / Phase L1
 EN 61000-4-15:2011 / d(t) = 3.3 % / Obs 1 x 10 min / Ztest (0.400+j0.250) Ohm
 Ra+jXa (0.2400+j0.1500) Ohm / Rn+jXn (0.1600+j0.1000) Ohm

FLICKER: Test PASS!

Time	Pmax	Pst	Sliding Plt	Tmax [s]	dmax [%]	dc [%]	PASS	FAIL
08:39:25	0.000	0.0090	0.0090	0.000	0.000	- . - - -	X	
Limits:		1.000	0.650	0.500	6.000	3.300		
Plt: 0.009000								
Evaluated: PST, dc, dmax, Tmax								

FLICKER: Source test PASS!

Time	Pmax	Pst	Sliding Plt	Tmax [s]	dmax [%]	dc [%]	PASS	FAIL
08:39:25	0.000	0.0080	- . - - - -	0.000	0.000	- . - - -	X	
Plt: 0.008000								
Evaluated: PST <= 0.4 dmax < 20 % dmax1								

Tested with SPSEMC4.5.1 / PAS5000 by Spitzenberger & Spies GmbH & Co. KG, Schmidstr. 32-34, 94234 Viechtach, Germany, 13.07.2022




7 Immunity

7.1 General information

Performance criteria as defined by the standard	
Criterion	Description from standard
A	During the test, no change of the luminous intensity shall be observed and the regulating control, if any shall operate during the test as intended.
B	During the test, the luminous intensity may change to any value. After the test, the luminous intensity shall be restored to its initial value within 1 min. Regulating controls need not function during the test, but after the test, the mode of the control shall be the same as before the test provided that during the test no mode changing commands were given.
C	During and after the test, any change of the luminous intensity is allowed and the lamp(s) may be extinguished. After the test, within 30 min, all functions shall return to normal, if necessary by temporary interruption of the mains supply and/or operating the regulating control. Additional requirement for lighting equipment incorporating a starting device: After the test, the lighting equipment is switched off. After half an hour, it is switched on again. The lighting equipment shall start and operate as intended.
Other:	---

Manufacturer defined performance criteria	Criterion	Description
	A	Manufacturer defined performance criteria- not specified.
	B	Apply performance criteria as defined by the standard.
	C	See above: Performance criteria as defined by the standard
D		
Monitoring during the tests	Radio-frequency electromagnetic fields: visual EUT observation using a camera.	
Mains voltage applied during the testing if not otherwise specified....	AC: 230 V / 50 Hz	

7.2 Electrostatic discharges

Tested by	Marek Gabryszewski	
Test date	2022-07-15	
Test Location(Stand)	ESD stand	
Test set-up	<input checked="" type="checkbox"/>	Table top equipment
	<input type="checkbox"/>	Floor standing equipment
	<input type="checkbox"/>	Wall or ceiling mounted equipment (Treated as table top)
Supplementary test set-up description	Operating mode: 1	
Size of horizontal coupling plate..	1.6 x 0.8 m	
Size of vertical coupling plate:	0.5 x 0.5 m	
Number of discharges for each test point	10 positive / 10 negative	
Discharge interval	1/s	
Performance criterion	B	
Supplementary information	---	
Symbols identifying discharge applied		Contact discharge
		Air discharge
		Air discharge, discharge did not occur

Test set-up photo:



Photo of selected test points Air



Photo of selected test points: Contact

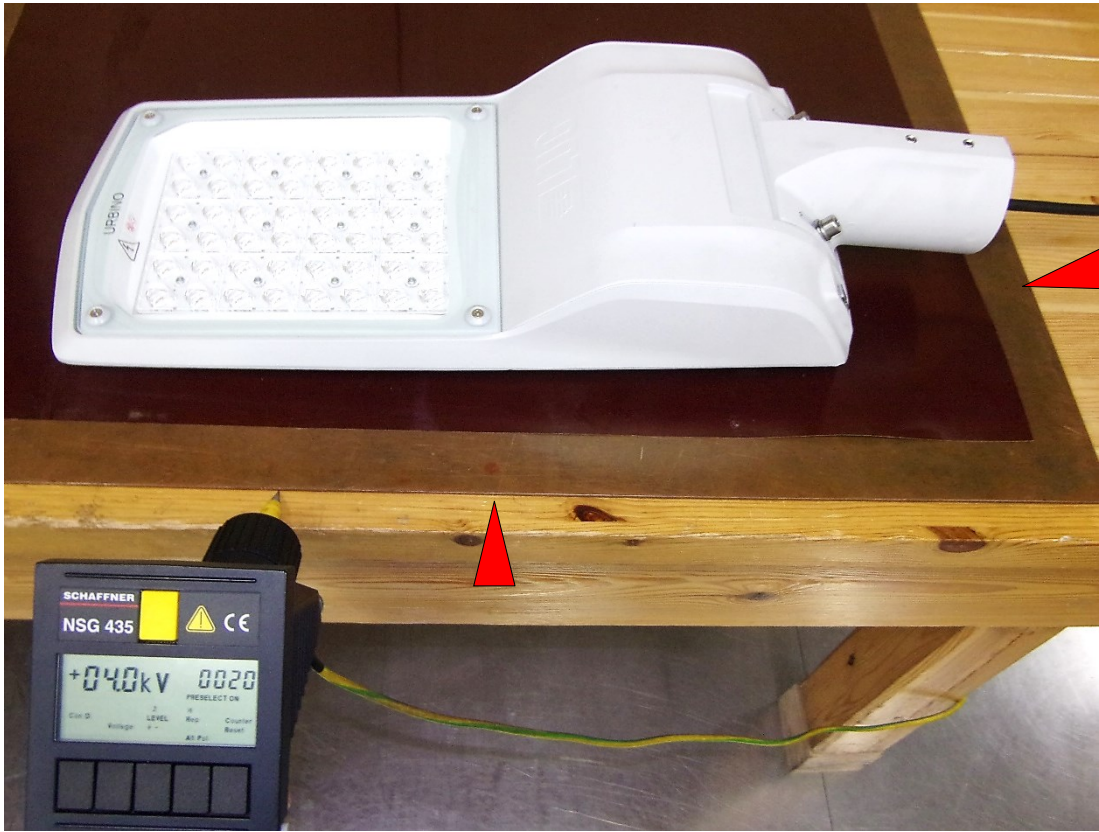


Photo of selected test points: Contact

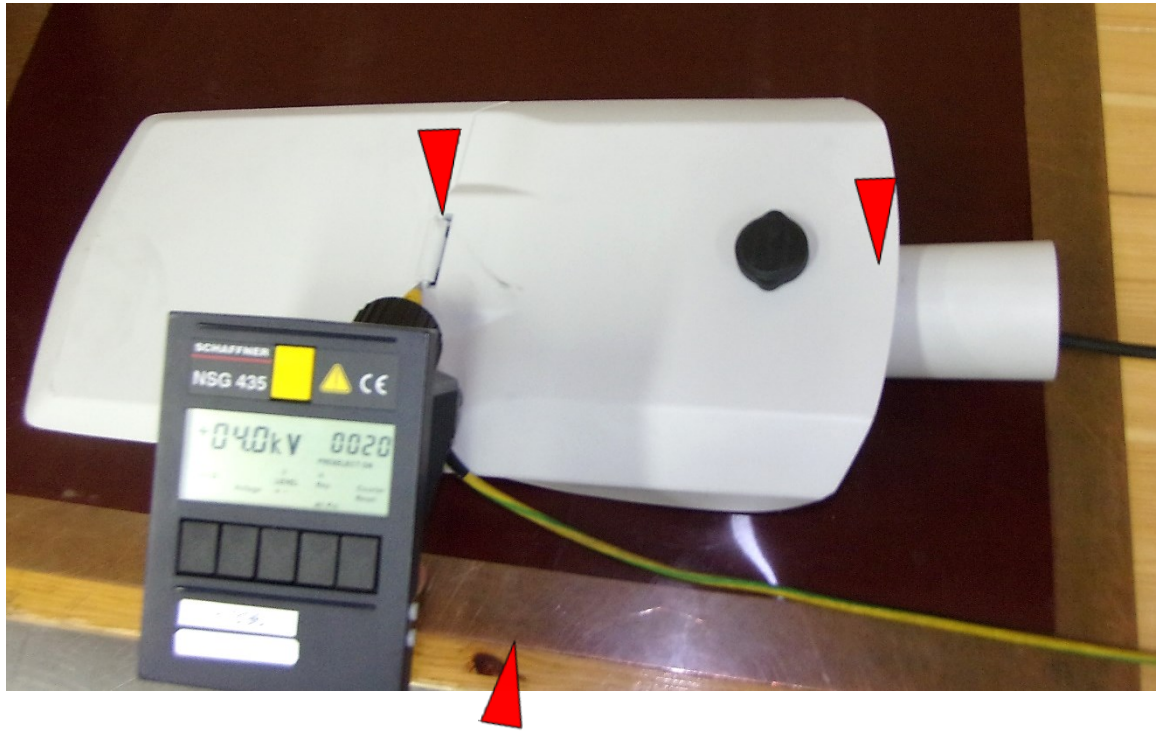


Table: Test results for electrostatic discharges

No.	Location of discharge	Polarity	Discharge	Number of discharges	Test level [kV]	Operating mode	Observations
1	HCP	P	C	10	4	1	Pass
2	VCP	P	C	10	4	1	Pass
3	Points on conductive surface as indicated in the picture above	P	C	10	4	1	Pass
4	Points on conductive surface as indicated in the picture above	N	C	10	4	1	Pass
5	Points on non-conductive surface as indicated in the picture above	P	A	10	8	1	Pass
6	Points on non-conductive surface as indicated in the picture above	N	A	10	8	1	Pass

HCP = Horizontal coupling plate
VCP = Vertical coupling plate


N = Negative
P = Positive

A = Air discharge
C = Contact discharge
X = Not performed nor required

Supplementary information: No observed response from EUT.

7.3 Radio-frequency electromagnetic fields

Tested by	Marek Gabryszewski		
Test date	2022-07-15		
Test location (stand)	Radio-frequency electromagnetic fields stand Semi-anechoic chamber U-86		
Test set-up	<input checked="" type="checkbox"/>	Equipment on the table (see photos below)	
	<input type="checkbox"/>	Equipment standing on floor (0.05 – 0.15 m height)	
Supplementary test set up description	Operating mode: 1		
Exposed side of EUT	<input checked="" type="checkbox"/>	0° (Front)	
	<input checked="" type="checkbox"/>	90 °	
	<input checked="" type="checkbox"/>	180 ° (Rear)	
	<input checked="" type="checkbox"/>	270 °	
	<input checked="" type="checkbox"/>	Top side	
	<input checked="" type="checkbox"/>	Bottom side	
Reason for not exposing a side ... :	As a result of the analysis, it was found that the EUT (front) side is the most susceptible to radiation, see below photos, next page.		
Distance Antenna to EUT	3 m		
Step size [%]	1		
Performance criterion	A		
Supplementary information	---		

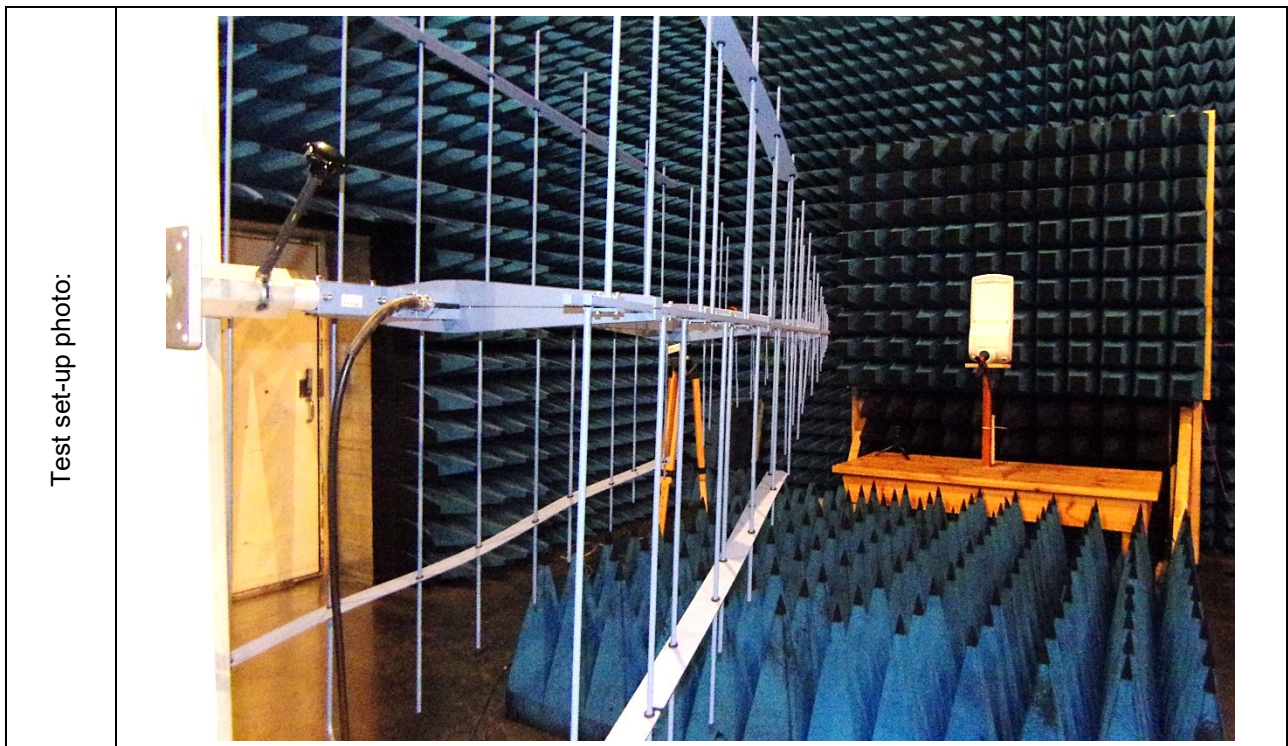

Test results for radiated electromagnetic field						
Frequency range	Test Level [V/m]	Polarization	Modulation	Operating mode	Dwell time [s]	Observations
80 MHz ÷ 1 GHz	3.0	V	AM: 80.0 %; 1.0 kHz	1	1.0	Pass
80 MHz ÷ 1 GHz	3.0	H	AM: 80.0 %; 1.0 kHz	1	1.0	Pass
H = Horizontal V = Vertical X = Not performed nor required						
Supplementary information: No observed response from EUT.						


EMC32 Report position antenna: V

EMS Scan Template: EMS Scan 3Vm 80-1000MHz [EMS Radiated]


Hardware Setup: EMS radiated\Copy of Hardware Setup 80-1000MHz
24.05.2017_SMBV100A
Level On: Substitution Method: EMS radiated\.Kalibracija pola
EMS\C28Vm_80-1000

Subrange	Step Width	Level	Modulation	Dwell Time
80MHz - 1GHz	1% LOG	3V/m	AM: 80.0%; 1.0kHz	1s

Imm Level

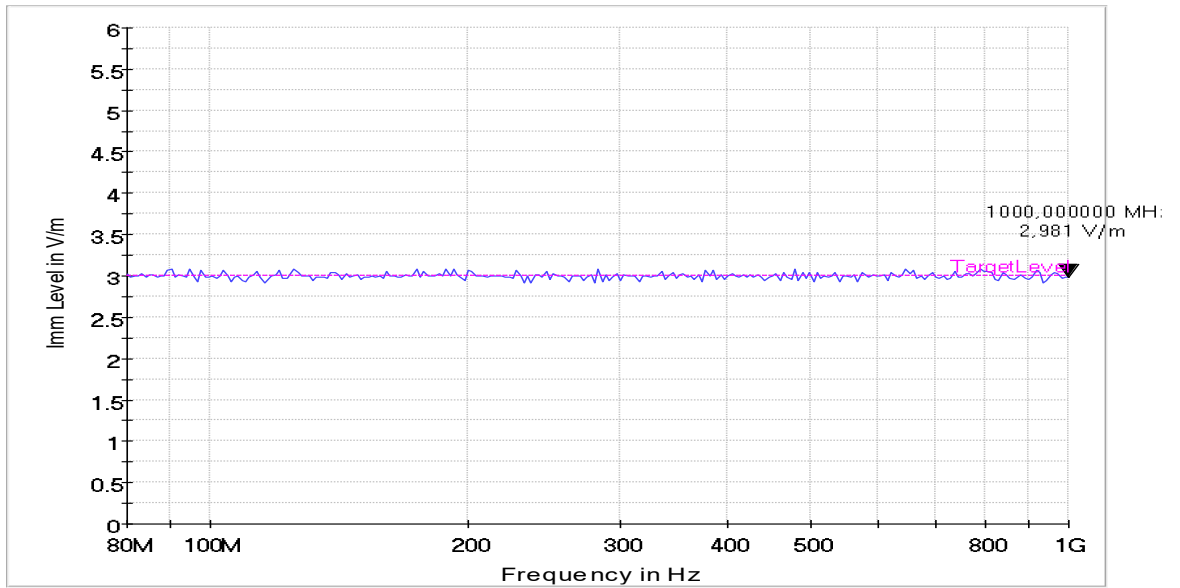

Ant In Fwd

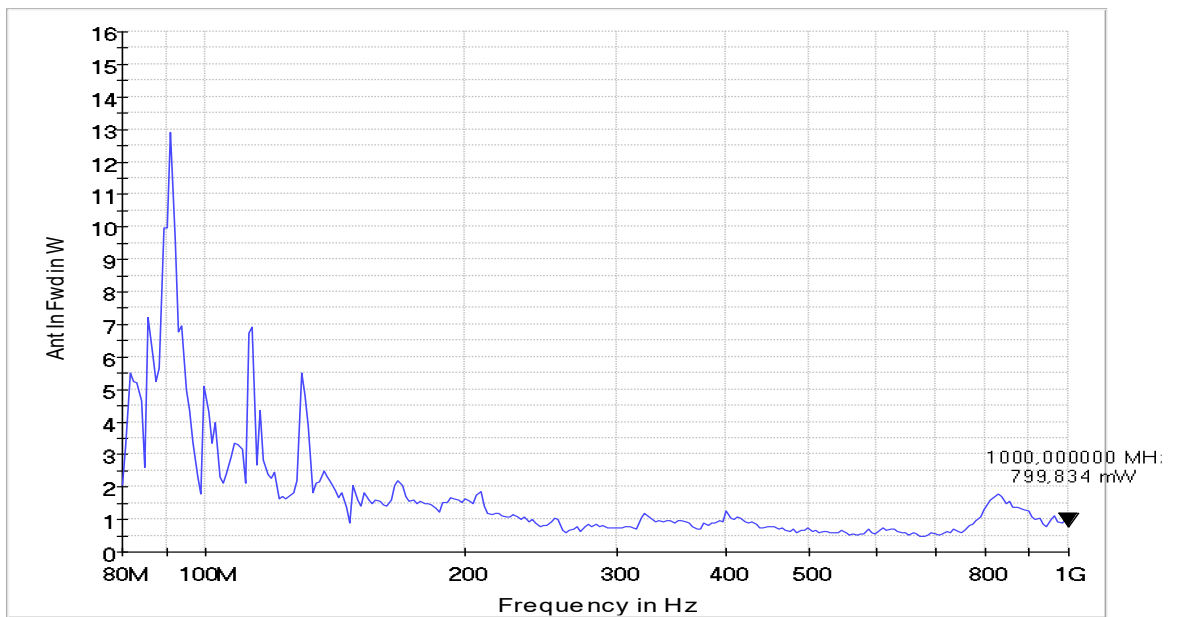


EMC32 Report position antenna: H

EMS Scan Template: EMS Scan 3Vm 80-1000MHz [EMS Radiated]


Hardware Setup: EMS radiated\Copy of Hardware Setup 80-1000MHz
 24.05.2017_SMBV100A
 Level On: Substitution Method: EMS radiated\.Kalibracija pola
 EMS\C28Vm_80-1000

Subrange	Step Width	Level	Modulation	Dwell Time
80MHz - 1GHz	1% LOG	3V/m	AM: 80.0%; 1.0kHz	1s

Imm Level

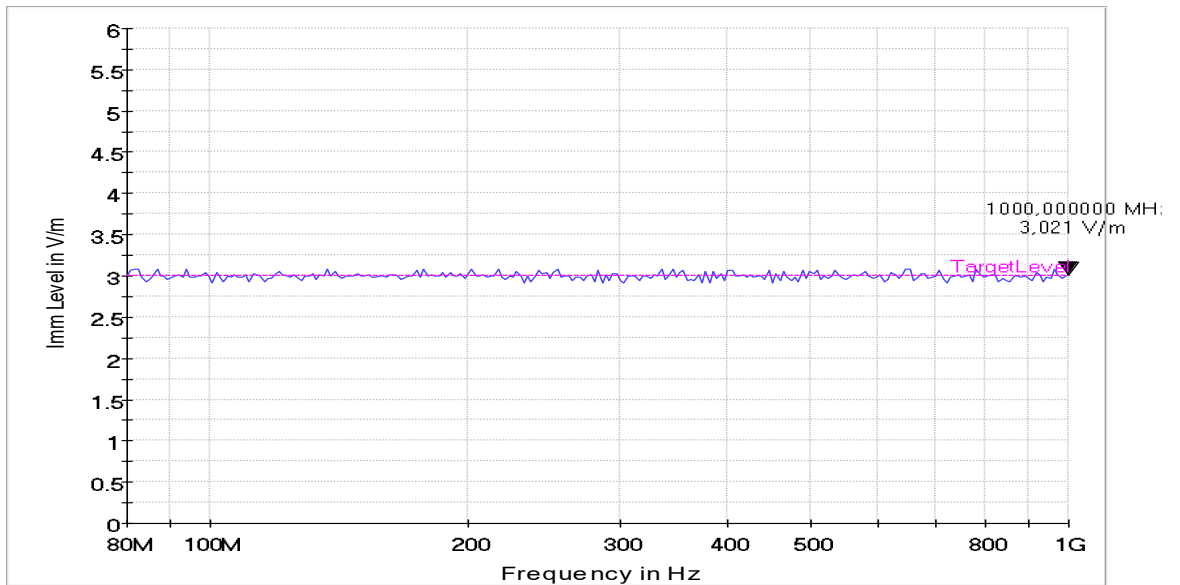


Ant In Fwd

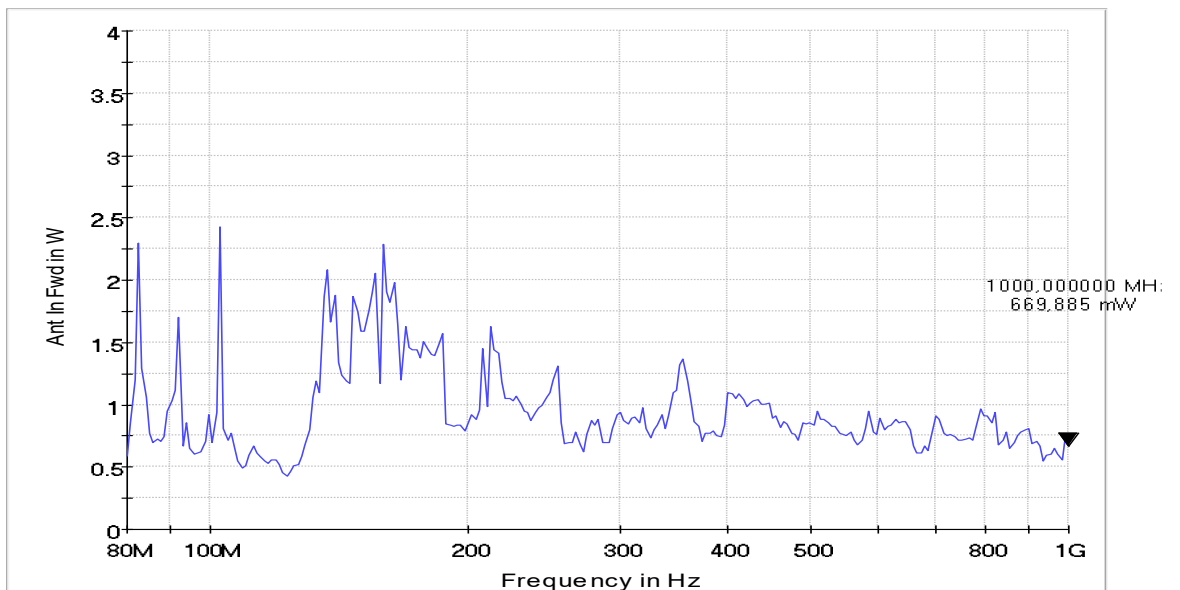

7.4 Power frequency magnetic fields

Tested by	Marek Gabryszewski	
Test date	2022-07-15	
Test location (Stand)	PMM 1008	
Applicability	<input checked="" type="checkbox"/>	The test was performed
	<input type="checkbox"/>	The test was not performed
		Reason: According to the manufacturers information there are no magnetic sensitive components in the product.
Test set-up	<input type="checkbox"/>	0.1 m above metal surface
	<input type="checkbox"/>	Homogeneous field (Helmholtz coil). Dimensions: ---
	<input checked="" type="checkbox"/>	Single Coil. Dimensions: 1 x 1 m
	<input type="checkbox"/>	Single Coil. Dimensions: 1 x 2.6 m
Performance criterion	A	
Supplementary information	---	

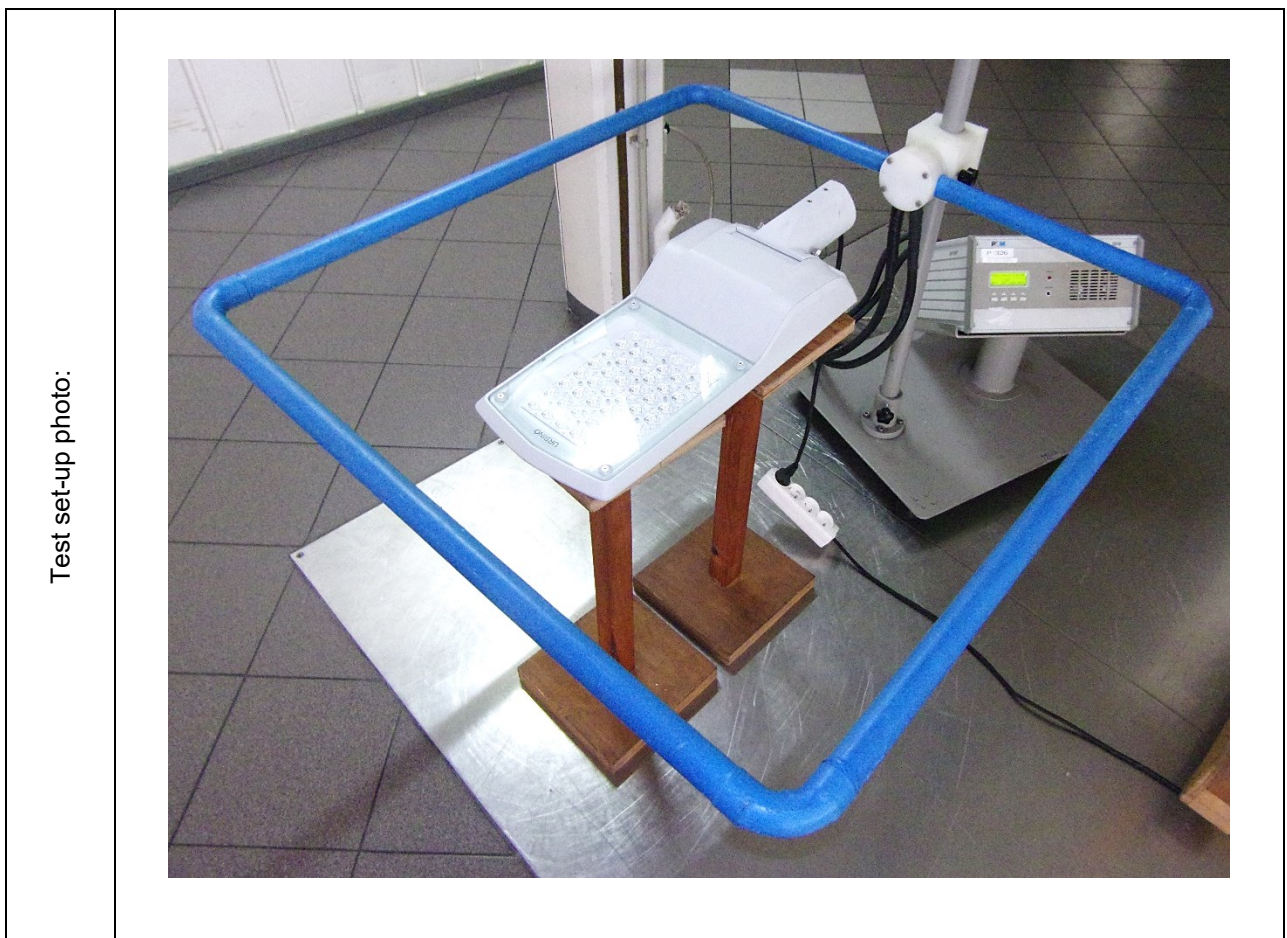


Test results for power frequency magnetic field immunity test							
Test frequency	Test Level [A/m]	Test time [s]	Coil size/type	Axis	Operating mode	Mains voltage/frequency (PMM)	Observations
50 Hz	3.0	180	1 m x 1 m	X	1	230 V / 50 Hz	Pass
50 Hz	3.0	180	1 m x 1 m	Y	1	230 V / 50 Hz	Pass
50 Hz	3.0	180	1 m x 1 m	Z	1	230 V / 50 Hz	Pass
X = Not performed nor required							
Supplementary information: No observed response from EUT.							

7.5 Fast transients

Tested by	Marek Gabryszewski
Test date	2022-07-14
Test location (stand)	Fast transient stand
Test set-up	<input checked="" type="checkbox"/> Equipment on the table (0.1 ± 0.01) m above ground plane
	<input type="checkbox"/> Equipment standing on floor at (0.1 ± 0.01) m above ground plane
	<input type="checkbox"/> Artificial hand applied. Location see photo.
Supplementary test set-up description	Operating mode: 1
Repetition frequency	5 kHz
Test time	4 min
Performance criterion	B
Supplementary information	---

Test set-up photo:

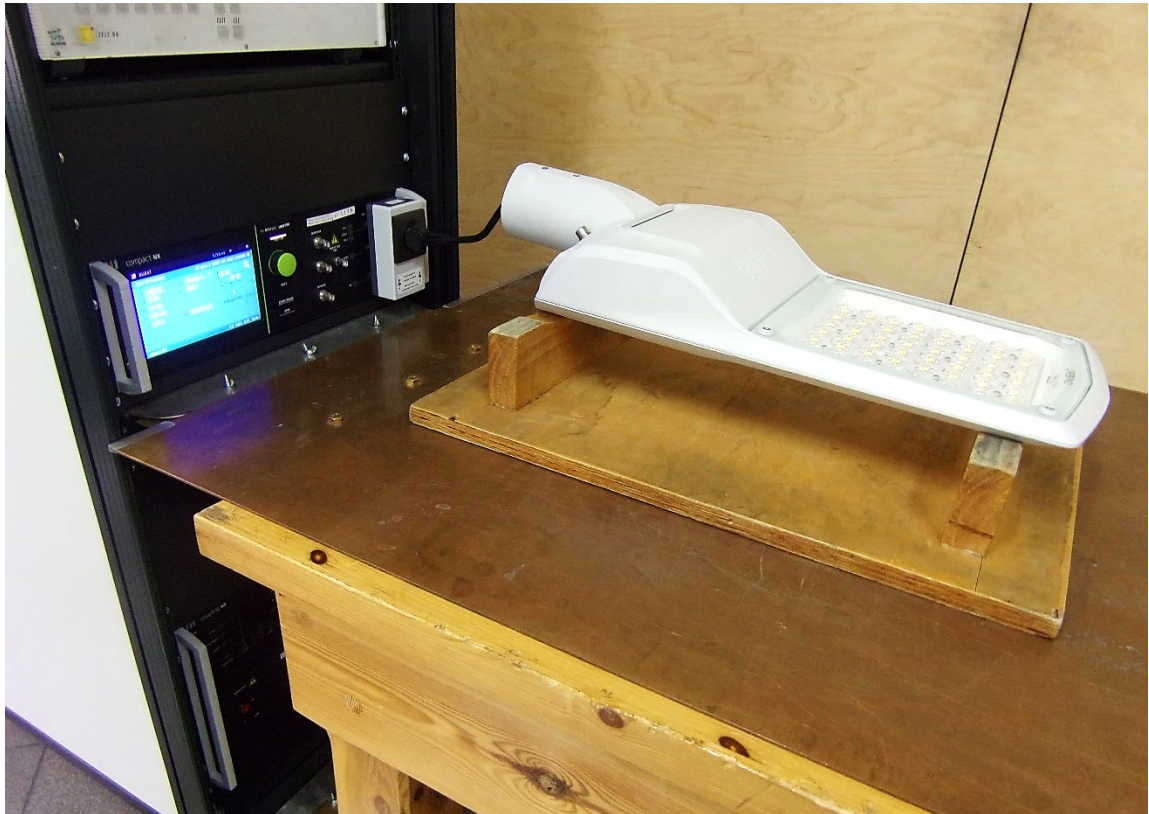


Test results fast transients						
Port	Coupling	Level [kV]	Polarity	Operating mode	Mains voltage/frequency	Observation
AC power port	L1 N	1	Positive	---	---	X
AC power port	L1 N	1	Negative	---	---	X
AC power port	L1 N PE	1	Positive	1	230 V / 50 Hz	Pass
AC power port	L1 N PE	1	Negative	1	230 V / 50 Hz	Pass
SIP/SOP	Clamp	0.5	Positive	---	---	X
SIP/SOP	Clamp	0.5	Negative	---	---	X
X = Not performed nor required						
Supplementary information: No observed response from EUT.						

7.6 Injected currents (radio-frequency common mode)

Tested by	Marek Gabryszewski	
Test date	2022-07-14	
Test location (Stand)	Injected currents stand	
Test set-up	<input checked="" type="checkbox"/>	Equipment located (0.1 ± 0.05) m above ground plane
	<input type="checkbox"/>	Elevated ground plane according to Annex F
	<input type="checkbox"/>	Artificial hand applied. Location see photo
Supplementary test set-up description	Operating mode: 1	
Modulation	<input checked="" type="checkbox"/>	80 % AM with 1 kHz
	<input type="checkbox"/>	Other: ---
Step size	1 %	
Performance criterion	A	
Supplementary information.....	---	

Test set-up photo:

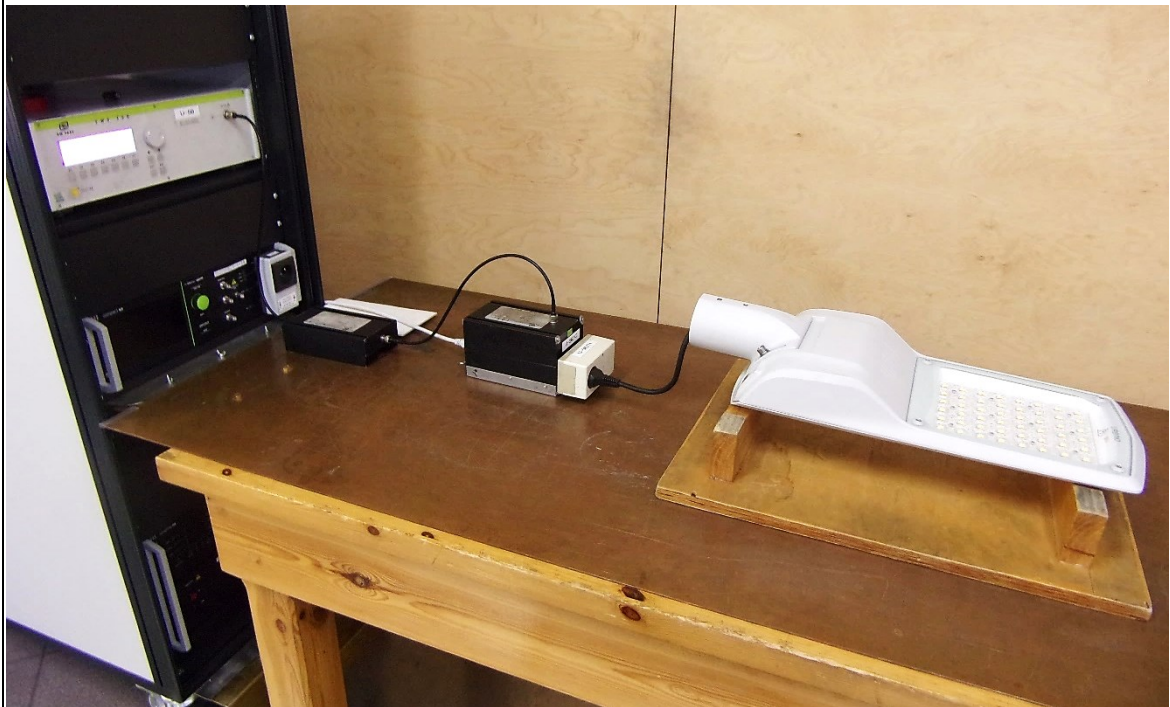

Test results for conducted disturbances, induced by radio-frequency fields							
Frequency range	Test Level [V]	Port under test	CDN type	Port with terminated CDN	Operating mode	Dwell time [s]	Observations
0.15 ÷ 80 MHz	3.0	AC power port	CDN-M2	---	---	---	X
0.15 ÷ 80 MHz	3.0	AC power port	CDN-M3	ATT 6	1	1.0	Pass
0.15 ÷ 80 MHz	3.0	AC power port	CDN-M5	---	---	---	X
X = Not performed nor required							
Supplementary information: No observed response from EUT.							

7.7 Surges

Tested by	Marek Gabryszewski
Test date	2022-07-14
Test location(Stand)	Surge stand
Test set-up description	Operating mode: 1
Repetition rate	1 / min
Number of pulses for each coupling	5
Performance criterion	B
Supplementary information.....	---

Test set-up photo:



Test results for surges								
Port	Coupling	CDN	Level [kV]	Polarity	Phase angles [°]	Operating mode	Mains voltage/frequency	Observation *
AC power port	L1-N	MCN	1	Positive	90	1	230 V / 50 Hz	Pass
AC power port	L1-N	MCN	1	Negative	270	1	230 V / 50 Hz	Pass
AC power port	N-PE	MCN	2	Positive	90	1	230 V / 50 Hz	Pass
AC power port	N-PE	MCN	2	Negative	270	1	230 V / 50 Hz	Pass
AC power port	L1-PE	MCN	2	Positive	90	1	230 V / 50 Hz	Pass
AC power port	L1-PE	MCN	2	Negative	270	1	230 V / 50 Hz	Pass
Lower test levels:			<input type="checkbox"/>	Tested				
			<input checked="" type="checkbox"/>	Not tested				
P = Positive N = Negative X = Not performed nor required				MCN = Mains Coupling Network ICN = Coupling Network for interconnection lines D = Direct Coupling (shielded lines)				
Supplementary information: *Observed response from EUT. During the test, the luminous intensity change, dimming, flashing light. Temporary loss of function or degradation of performance which ceases after the disturbance ceases, and from which the equipment under test recovers its normal performance, without operator intervention. Consistent with the evaluation criterion.								

7.8 Voltage dips and short interruptions

Tested by	Marek Gabryszewski
Test date	2022-07-13
Test Location (Stand)	U-84
Test set-up description	Operating mode: 1
Repetition rate	10 s
Number of dips or interruptions ... :	3
Performance criterion	B (Voltage dips) C (Short interruptions $U_N=0\%$)
Supplementary information.....	---

Test results voltage dips						
U_N [V]	Frequency in Hz	Test Level [% of U_N]	Phase angle	Duration [Cycles]	Operating mode	Observations*
230	50	70	0°	12	1	Pass
Supplementary information: *Observed response from EUT. During the test, the luminous intensity change, dimming, flashing light. Temporary loss of function or degradation of performance which ceases after the disturbance ceases, and from which the equipment under test recovers its normal performance, without operator intervention. Consistent with the evaluation criterion.						

Test results voltage interruptions						
U_N [V]	Frequency [Hz]	Test Level [% of U_N]	Phase angle	Duration [Cycles]	Operating mode	Observations*
230	50	0	0°	0.5	1	Pass
Supplementary information: *Observed response from EUT. During the test, the luminous intensity change, dimming, flashing light. Temporary loss of function or degradation of performance which ceases after the disturbance ceases, and from which the equipment under test recovers its normal performance, without operator intervention. Consistent with the evaluation criterion.						

Test set-up photo:



Tabulated Results for Voltage Dips and Interruptions:

Name:		Serial no:	
Department:		Operating modes:	
Company:	IMiF PREDOM Division	Comment1:	
Test report no:	B10-4/076/EMC/22	Comment2:	
Device:	Street luminaire	Comment3:	
Specimen:		Comment4:	
Manufacturer:	LUG Light Factory	Date:	13.07.2022
Type:	URBINO IK10 LED	Test date:	13.07.2022

Test conditions: EN 61000-4-11 voltage dips, short interruptions and variations test

Voltage / frequency:	230.0 V / 50.0 Hz
Test phase:	Single phase / L1-N
Executed test:	61547 dips
Test description:	--
Disturbances per step:	3 (per phase angle) / 10.5 sec delay between

Step	Disturbance	Test level	Duration	Phase angle(s) (Ref. L1)
1	Voltage dip / short interruption	70 %	10 periods	0° L1

Test results:

- Normal performance within limits specified by manufacturer, requestor or purchaser
- Temporary loss of function or degradation of performance which ceases after the disturbance ceases and from which the equipment under test recovers its normal performance, without operator intervention
- Temporary loss of function or degradation of performance, the correction of which requires operator intervention
- Loss of function or degradation of performance which is not recoverable, owing to damage to hardware or software, or loss of data

Comments:

Pass, in accordance with the criterion

Tested with SPSEMC 4.1.3 / PAS5000 by Spitzenberger & Spies GmbH & Co. KG, Schmidstr. 32-34, 94234 Weichtsch, Germany, 13.07.2022

Name:		Serial no:	
Department:		Operating modes:	
Company:	IMiF PREDOM Division	Comment1:	
Test report no:	B10-4/076/EMC/22	Comment2:	
Device:	Street luminaire	Comment3:	
Specimen:		Comment4:	
Manufacturer:	LUG Light Factory	Date:	13.07.2022
Type:	URBINO IK10 LED	Test date:	13.07.2022

Test conditions: EN 61000-4-11 voltage dips, short interruptions and variations test

Voltage / frequency:	230.0 V / 50.0 Hz
Test phase:	Single phase / L1-N
Executed test:	61547 short
Test description:	--
Disturbances per step:	3 (per phase angle) / 10.5 sec delay between

Step	Disturbance	Test level	Duration	Phase angle(s) (Ref. L1)
1	Voltage dip / short interruption	0 %	0.5 periods	0° L1

Test results:

- Normal performance within limits specified by manufacturer, requestor or purchaser
- Temporary loss of function or degradation of performance which ceases after the disturbance ceases and from which the equipment under test recovers its normal performance, without operator intervention
- Temporary loss of function or degradation of performance, the correction of which requires operator intervention
- Loss of function or degradation of performance which is not recoverable, owing to damage to hardware or software, or loss of data

Comments:

Pass, in accordance with the criterion

Tested with SPSEMC 4.1.3 / PAS5000 by Spitzenberger & Spies GmbH & Co. KG, Schmidstr. 32-34, 94234 Weichtsch, Germany, 13.07.2022

8 List of test equipment

Equipment	Type	Inventory number	Manufacturer
Test Stand:	Disturbance voltages		
EMI Test Receiver	ESCS 30	U-57	Rohde & Schwarz
Artificial Mains Network	ESH 2-Z5	U-57/A	Rohde & Schwarz
Artificial hand	RC	Pp-416	PREDOM-OBR
Faraday Cage	EK-1	U-11	Unitra Unima Olsztyn
Test Stand:	Disturbance powerstand		
EMI Test Receiver	ESCS 30	U-57	Rohde & Schwarz
Absorbing clamp	MDS-21	P-395/A	Rohde & Schwarz
Faraday Cage	EK-1	U-11	UnitraUnima Olsztyn
Test Stand:	Harmonic current emissions, Voltage changes, voltage fluctuations and flicker		
Test System	EMV D 15000/PAS	U-84	Spitzenberger+Spies GmbH
Test Stand:	Electrostatic discharges		
Simulator ESD	NSG 435	P-396	Schaffner
Test Stand:	Fast Transients / Surges		
Multifunctional Test Generator	COMPACT NX5	U-117A	EM TEST
Combined 3-Phase Coupling/ Decoupling Networks	COUPLING NX5	U-117B	EM TEST
Test Stand:	Conducted Disturbances Immunity		
Continuous Wave Simulator	CWS 500	U-56	EM TEST
Coupling-Decoupling Network	CDN-M5,M3,M2	U-56/D,C,B	EM TEST
Attenuator	ATT 6	U-56/F	EM TEST
Test Stand:	Radiated electromagnetic disturbances stand Semi-anechoic chamber U-86		
EMI Test Receiver	ESIB 26	P-377	Rohde & Schwarz
Antenna	HL 562	P-382	Rohde & Schwarz
Test Stand:	Radiated, radio-frequency, electromagnetic field stand Semi-anechoic chamber U-86		
Vector Signal Generator	SMBV100A	P-601	Rohde & Schwarz
Power Amplifier	BLWA 0810-250/75D	P-370	BONN Elektronik
Power Amplifier	BLMA 0830-40	P-369	BONN Elektronik
Power Amplifier	BLMA 4060-10	P-467	BONN Elektronik
Power Meter	NRVD	P-375	Rohde & Schwarz
Power Sensor	NRP-Z211	P-468/469	Rohde & Schwarz
Power Sensor	URV5-Z2	P-373/374	Rohde & Schwarz
Ultra log antenna	HL 046	P-434	Rohde & Schwarz
Horn antenna	HF 907	P-447	Rohde & Schwarz
Test Stand:	Power frequency magnetic fields		
Magnetic field generator	1008	P-326	PMM

9 Measurement instrumentation uncertainties

Type of disturbance test method	Used test equipment (only main instruments, no details)	Calculated uncertainty	U_{CISPR}
Disturbance voltage Mains terminals 9 kHz ... 150 kHz 150 kHz ... 30 MHz	EMI Test Receiver Artificial Mains Network	3.6 dB	4.0 dB 3.6 dB
Electric field strength Horiz. 30 MHz ... 200 MHz Horiz. 200 MHz ... 1000 MHz Vert. 30 MHz ... 130 MHz Vert. 130 MHz ... 200 MHz Vert. 200 MHz ... 1000 MHz	EMI Test Receiver Antenna	Horiz. 30 MHz ... 200 MHz 4.9 dB Horiz. 200 MHz ... 300 MHz 5.2 dB Vert. 30 MHz ... 200 MHz 5.1 dB Vert. 30 MHz ... 200 MHz 5.2 dB Vert. 200 MHz ... 300 MHz 5.2 dB	5.2 dB

10 Annex


10.1 Annex A:

Critical components information			
Object	Manufacturer/ Trademark	Type/Model	Remark
Power supply	OSRAM	OPTOTRONIC OT DX 110/220-240/1A0 DIMA LT2 E	I_{rated}/U_{rated} 200-1050mA / 75-220V P_{rated} 110W, $\lambda \geq 0.98$ I_N/f_N 220-240V 50/60Hz



See Technical documentation and photos Annex B.

10.2 Annex B:


TABLE: Photography of the components	
Component/ Part No.	Photography

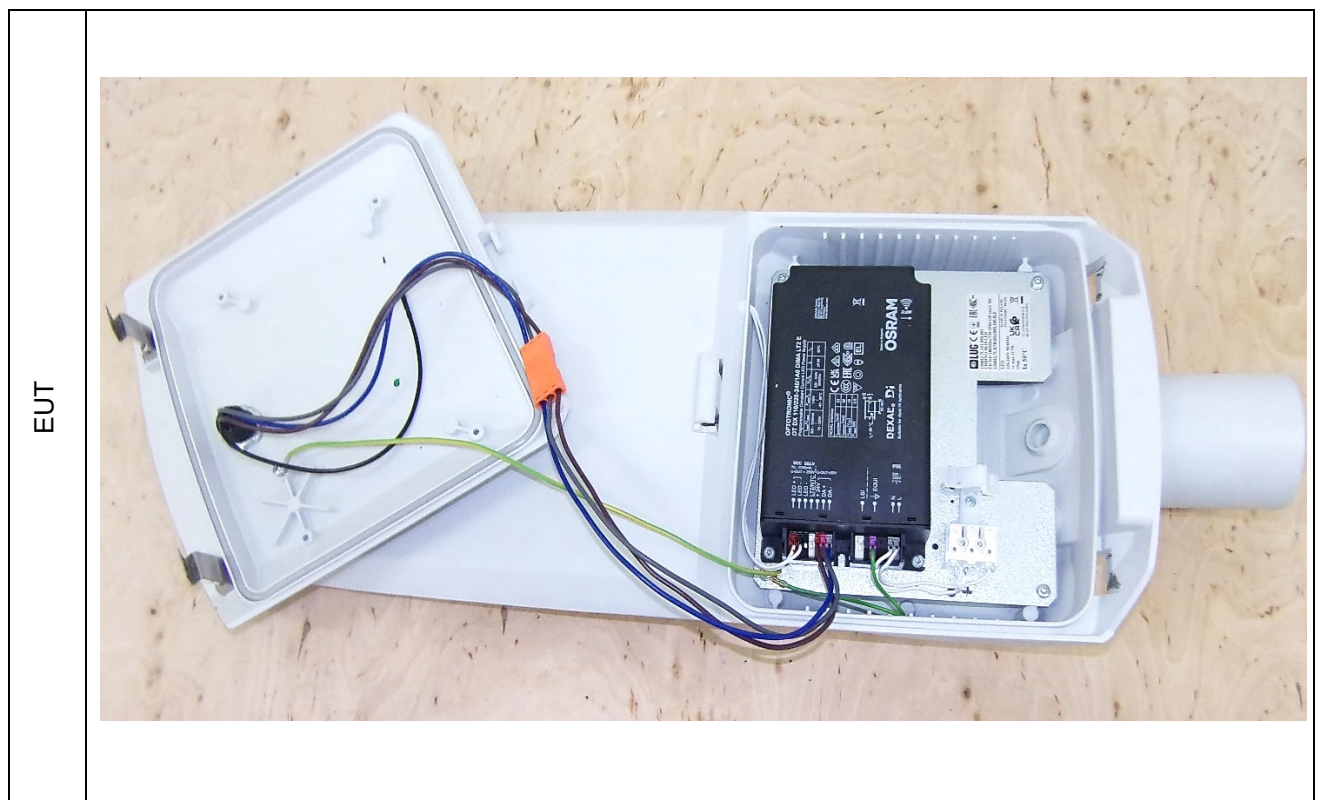

Power supply

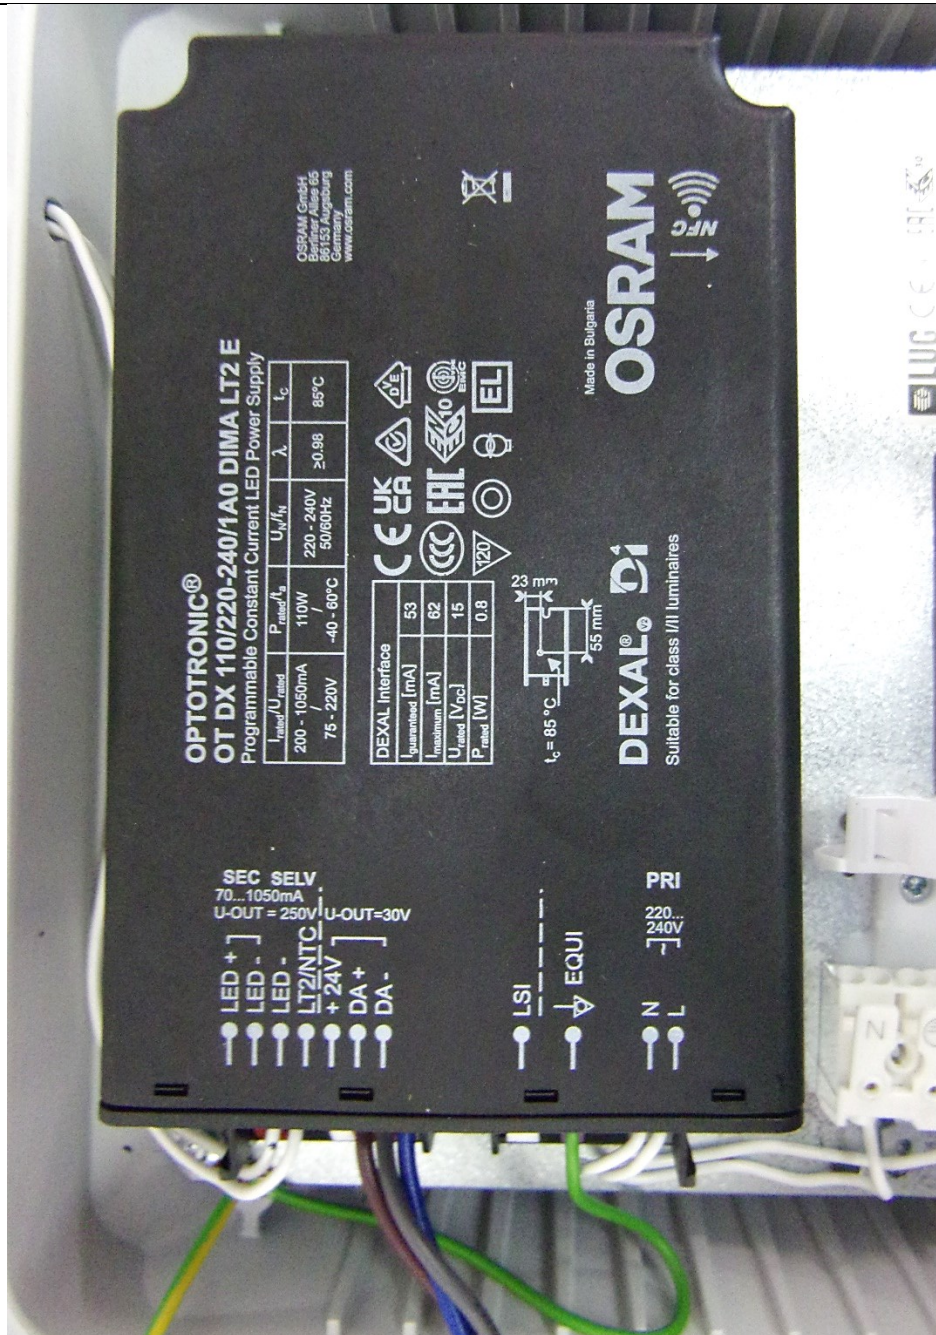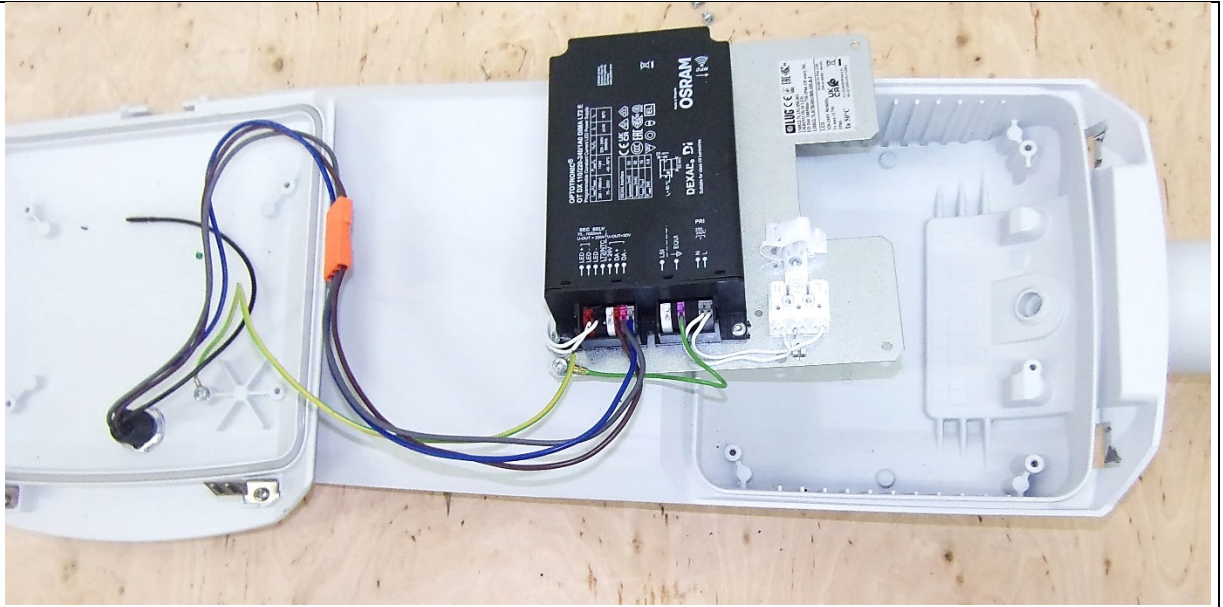

LED module

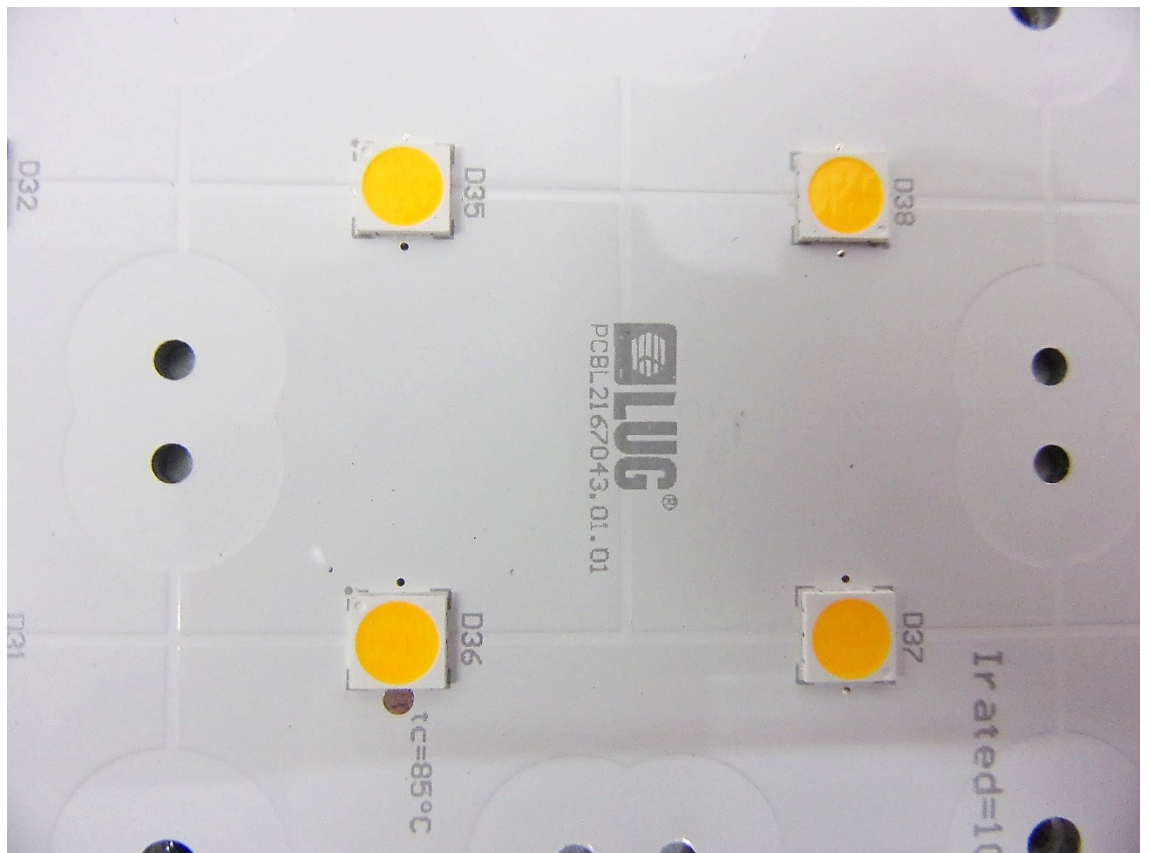

End of the Report



EU DECLARATION OF CONFORMITY

CLS/2024/03/134



We

LUG Light Factory Ltd.
Gorzowska 11
65-127 Zielona Góra, Poland

declare under our sole responsibility that the product

Name	URBINO LED IK10
Group	Infrastructural lighting
Factory number	Attachment

is in conformity with the provisions of the following acts:

Directive 2014/30/EU of the European Parliament and of the Council of 26 February 2014 on the harmonisation of the laws of the Member States relating to electromagnetic compatibility

Directive 2014/35/EU of the European Parliament and of the Council of 26 February 2014 on the harmonisation of the laws of the Member States relating to the making available on the market of electrical equipment designed for use within certain voltage limits

Directive 2011/65/EU of the European Parliament and of the Council of 8 June 2011 on the restriction of the use of certain hazardous substances in electrical and electronic equipment

Directive 2009/125/EC of the European Parliament and of the Council of 21 October 2009 establishing a framework for the setting of ecodesign requirements for energy-related products

Commission regulation (EU) 2019/2020 of 1 October 2019 laying down ecodesign requirements for light sources and separate control gears pursuant to Directive 2009/125/EC of the European Parliament and of the Council and repealing Commission Regulations (EC) No 244/2009, (EC) No 245/2009 and (EU) No 1194/2012

and the following harmonized standards:

- | | |
|---|---|
| PN-EN 60598-1:2015-04 | PN-EN 61000-3-3:2013-10/A1:2019-10 |
| PN-EN IEC 55015:2019-11 | PN-EN 62493:2015-11 |
| PN-EN IEC 55015:2019-11/A11:2020-07 | PN-EN IEC 63000:2019-01 |
| PN-EN 61547:2009 | PN-EN 62471:2010 |
| PN-EN IEC 61000-3-2:2019-04 | PN-EN 60598-2-3:2006/A1:2012 |
| PN-EN IEC 61000-3-2:2019-04/A1:2021-08 | PN-EN 60598-2-3:2006/A1:2012 |
| PN-EN 61000-3-3:2013-10 | |


 LUG Light Factory Sp. z o.o.
 Kierownik Laboratorium/Laboratory Manager
 mgr inż. Marcin Białas

Issued by

DYREKTOR
 DS. TECHNICZNYCH
 mgr inż. Mariusz Ejsmont



Authorized person signature



EU DECLARATION OF CONFORMITY

CLS/2024/03/134



ATTACHMENT

Factory number

130822.7L162.190.002

This declaration applies to all serial numbers produced under the given factory symbol.