



Apator S.A.
Polna 148
87-100 Toruń
Tel. (56) 654 49 00
<http://www.acontrol.com.pl>


Klient:

Project name: LOT.1 No.1
Project number:
Description: PE-03-6 (6meters)

Utworzono dnia 16.07.2024


		Signature	Data	Made for :	Made by: Apator S.A. Polna 148 87-100 Toruń		PE-03-6 (6meters)	=	+	
Design.			16.07.2024				LOT.1 No.1	Project	& TYT	Page 1/1
Check.							Strona tytułowa / Okładka	Schema number		

0	1	2	3	4	5	6	7	8	9
Basic parameters					Laquered, thermoset cabinet				
protection grade		IP44							
impact resistance		IK10							
flammability category		V0							
nominal insulation voltage		1000V AC / 1500V DC							
excessive heat resistance		960°C							
weather conditions resistance		UV test							
colour		RAL7035							
conformity		PN-EN 62208 : 2011							
dimention tolerance		±5mm							

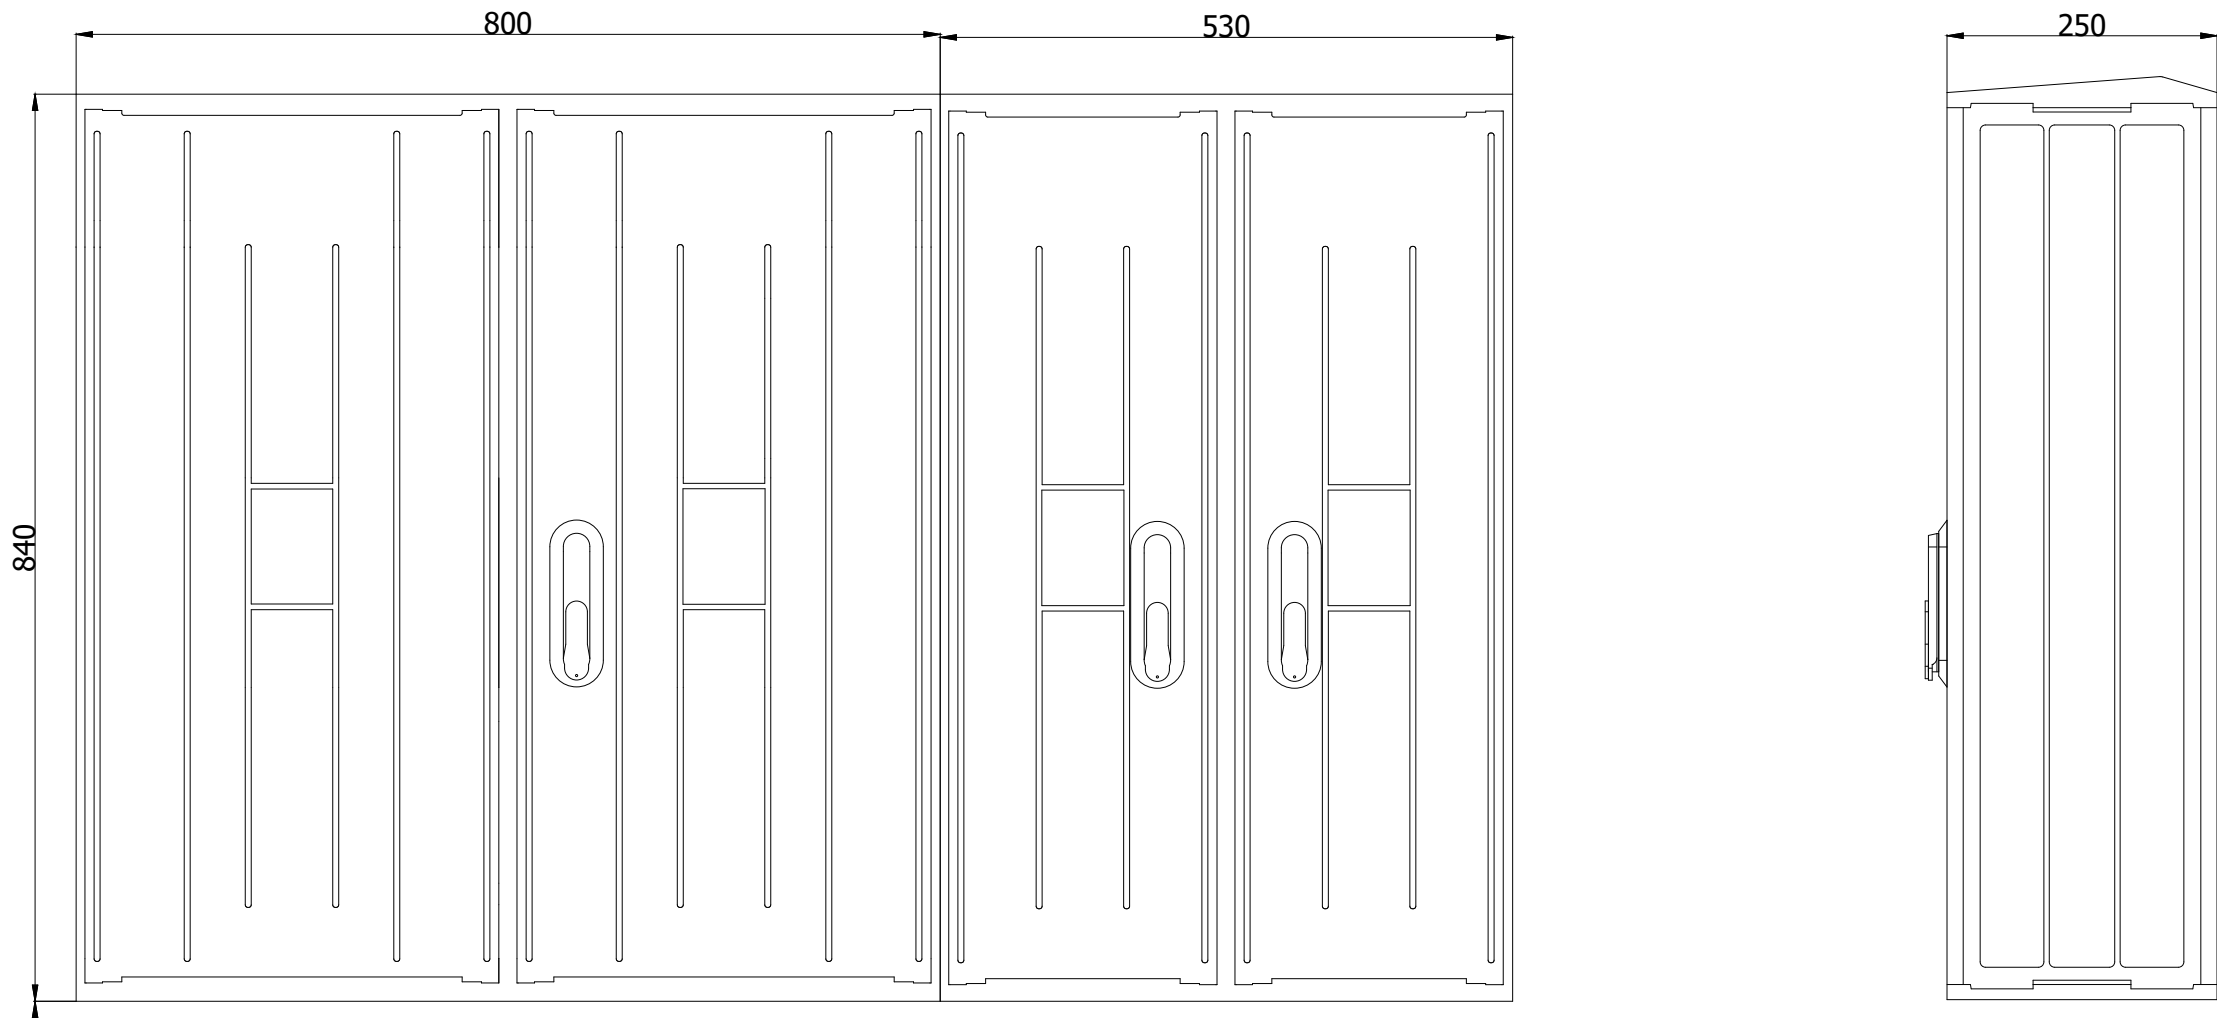


==&TYT/1

Skala 1:7		Signature	Data	Made for :	Made by: Apator S.A. Polna 148 87-100 Toruń		PE-03-6 (6meters)	= U	+ S	
Design.			16.07.2024				LOT.1 No.1	Project	& MECH	Page 1/3
Check.							External view	Schema number		

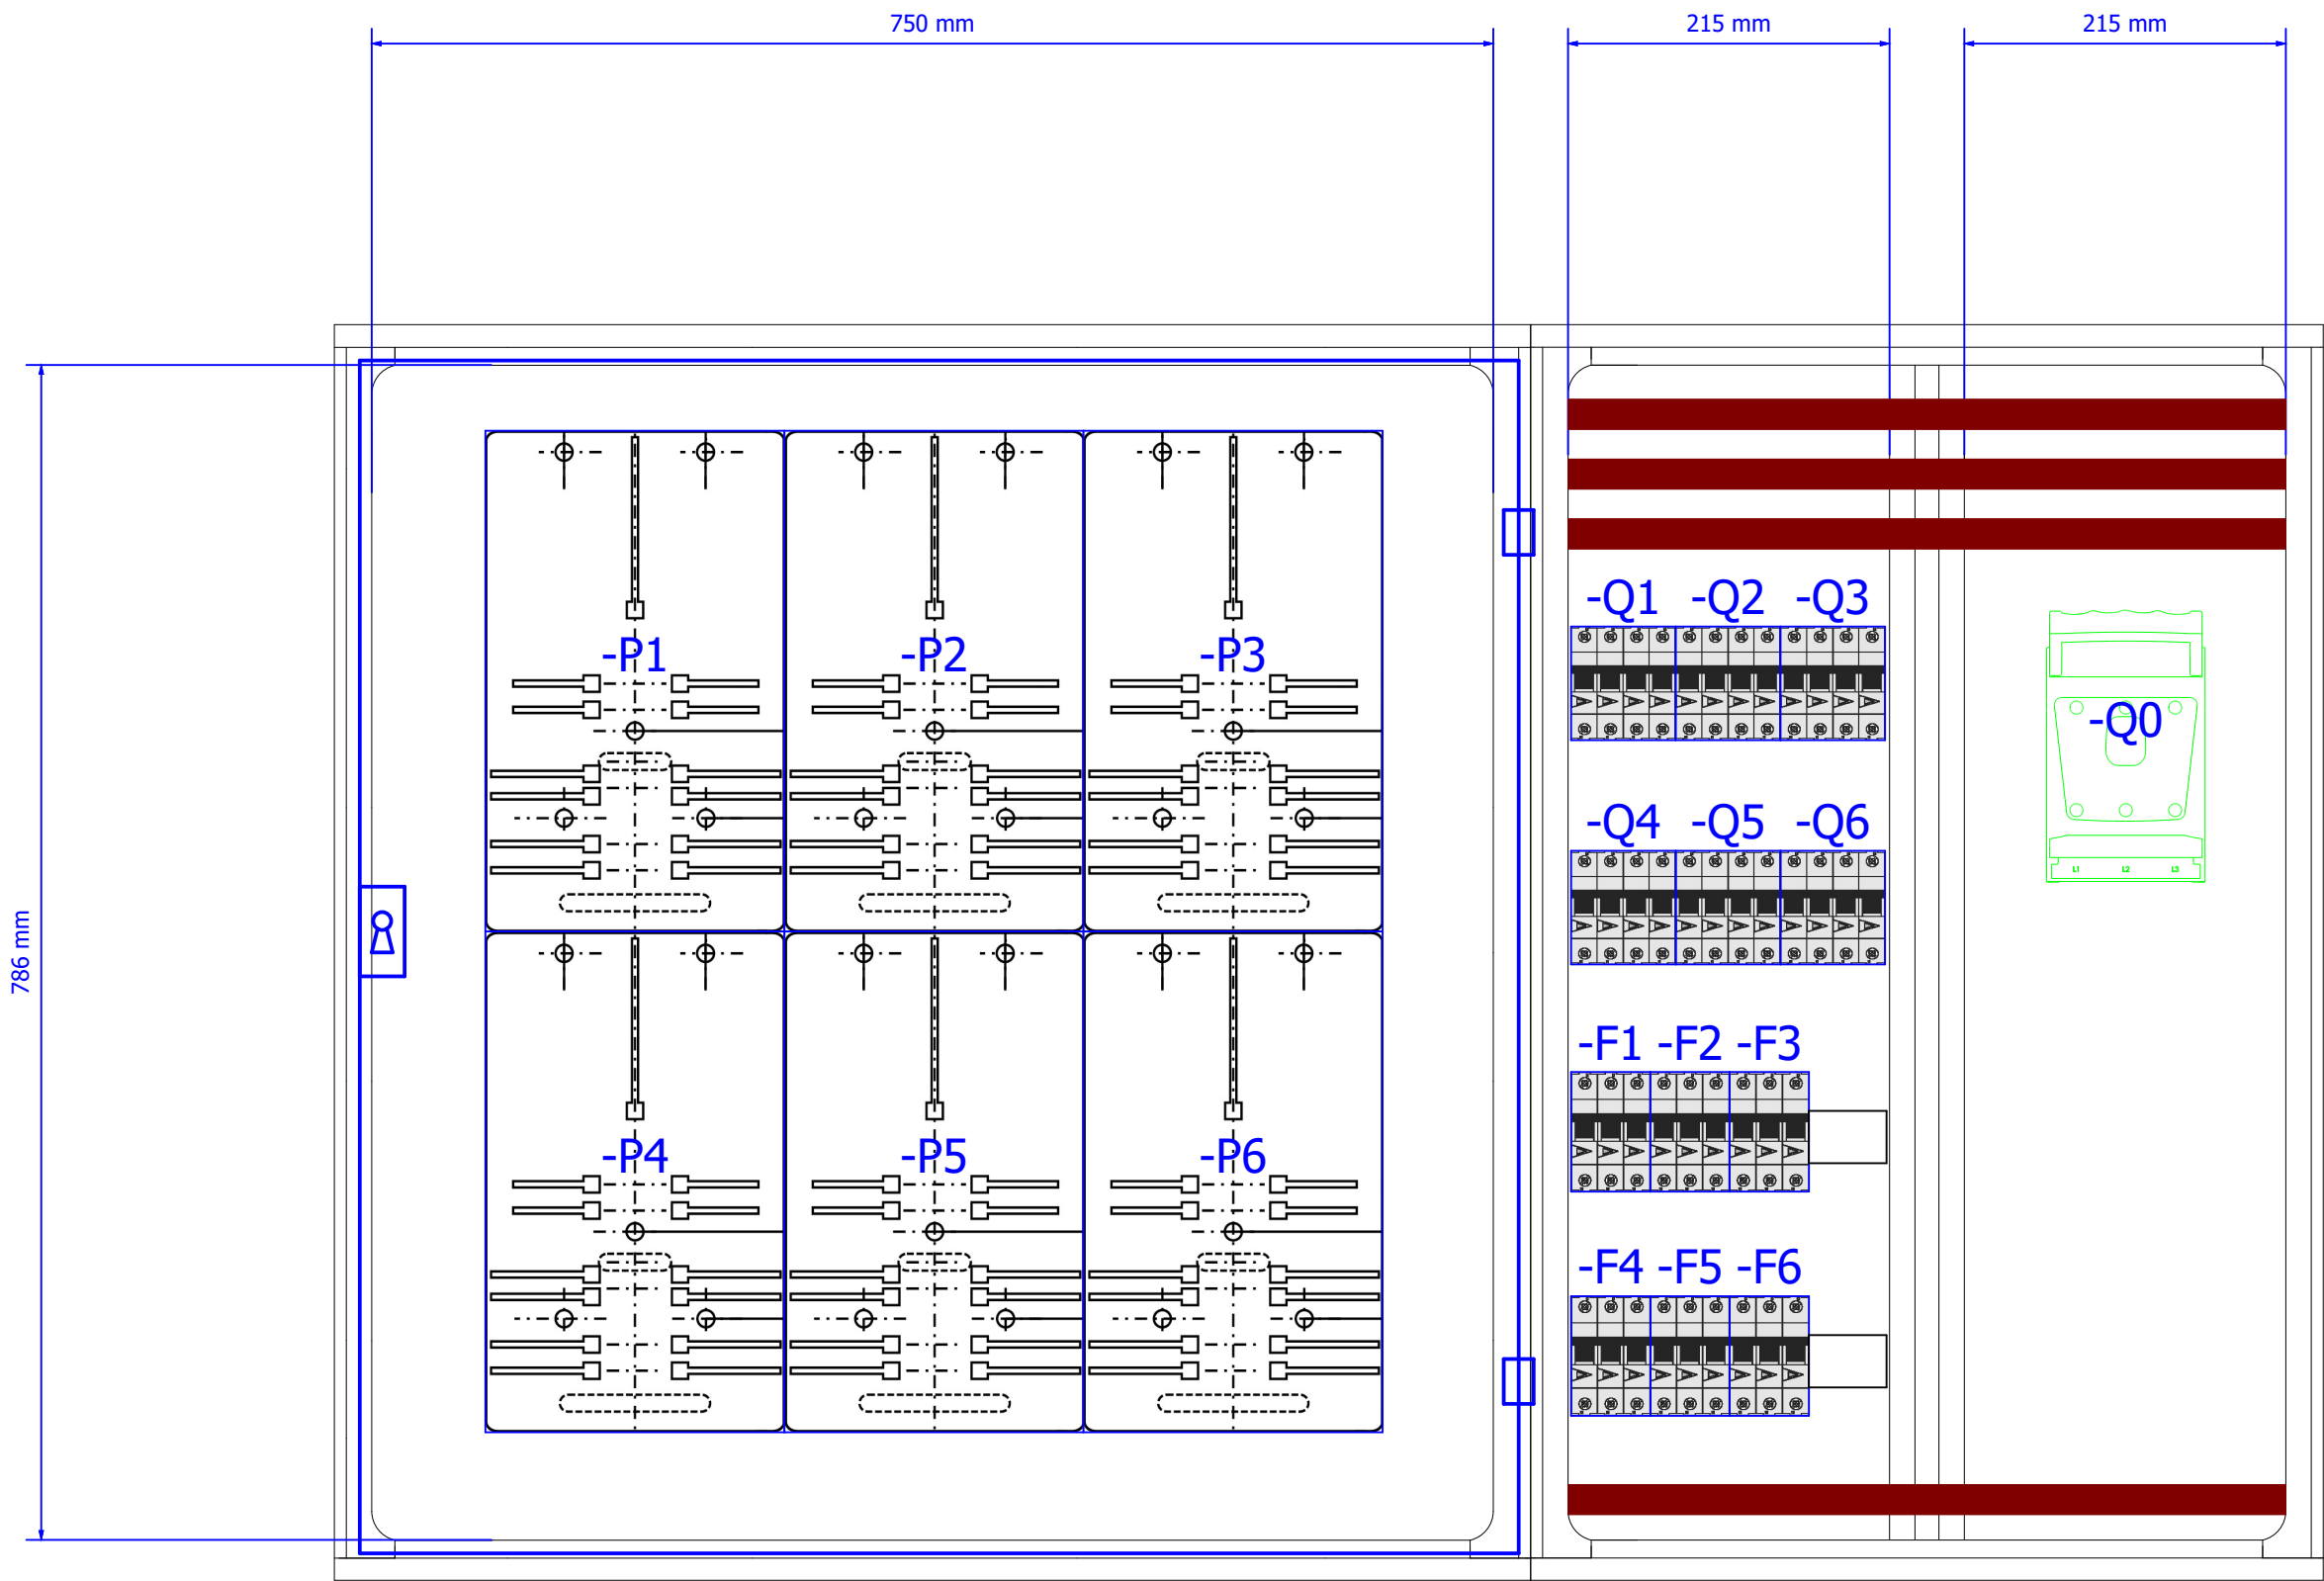


Meters' segment closed with
a additional, internal, plastic
and transparent door with
a lock (~775x800 mm)

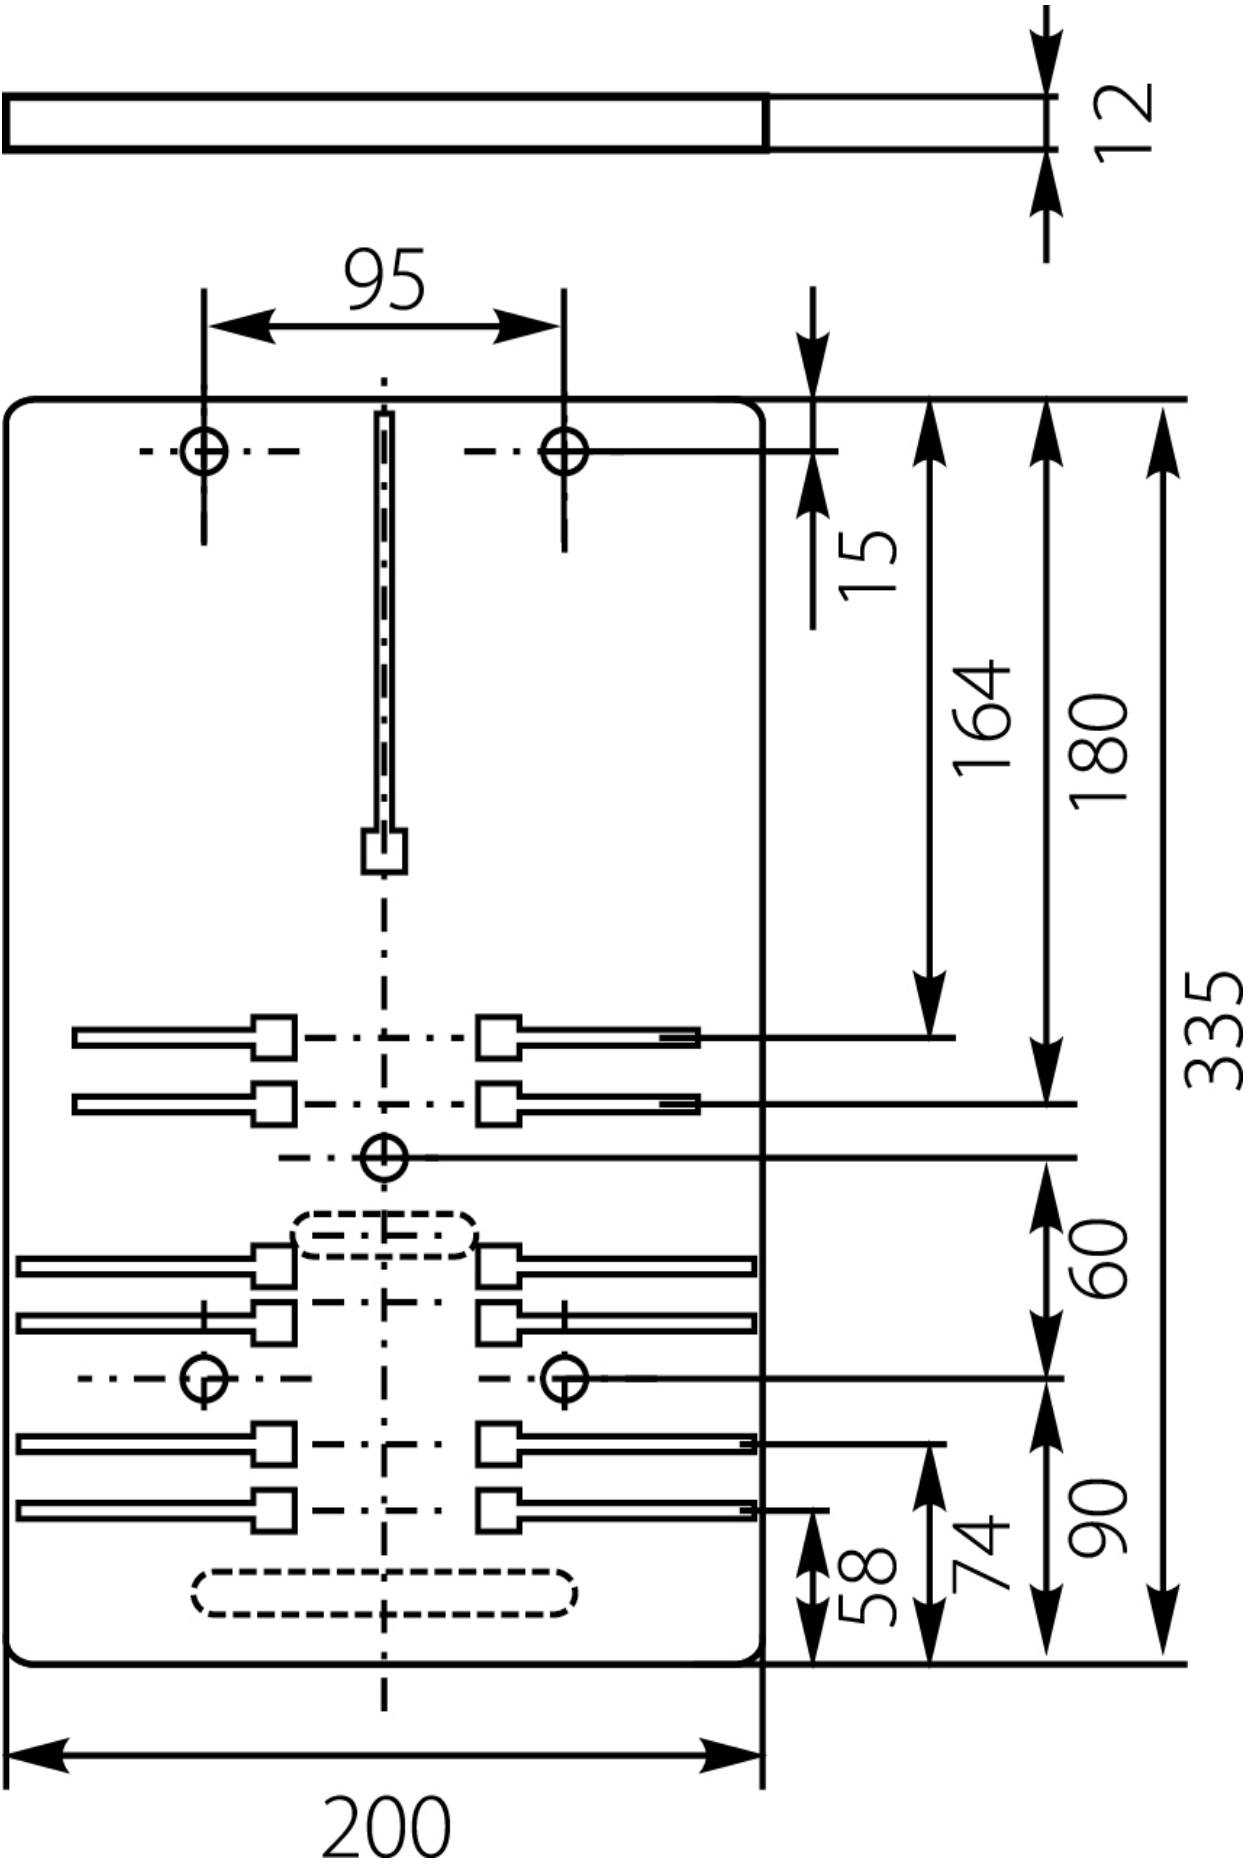

Meter board T-U 1F/3F-b/z-12 Universal, without protections, IP20

PE-03-6

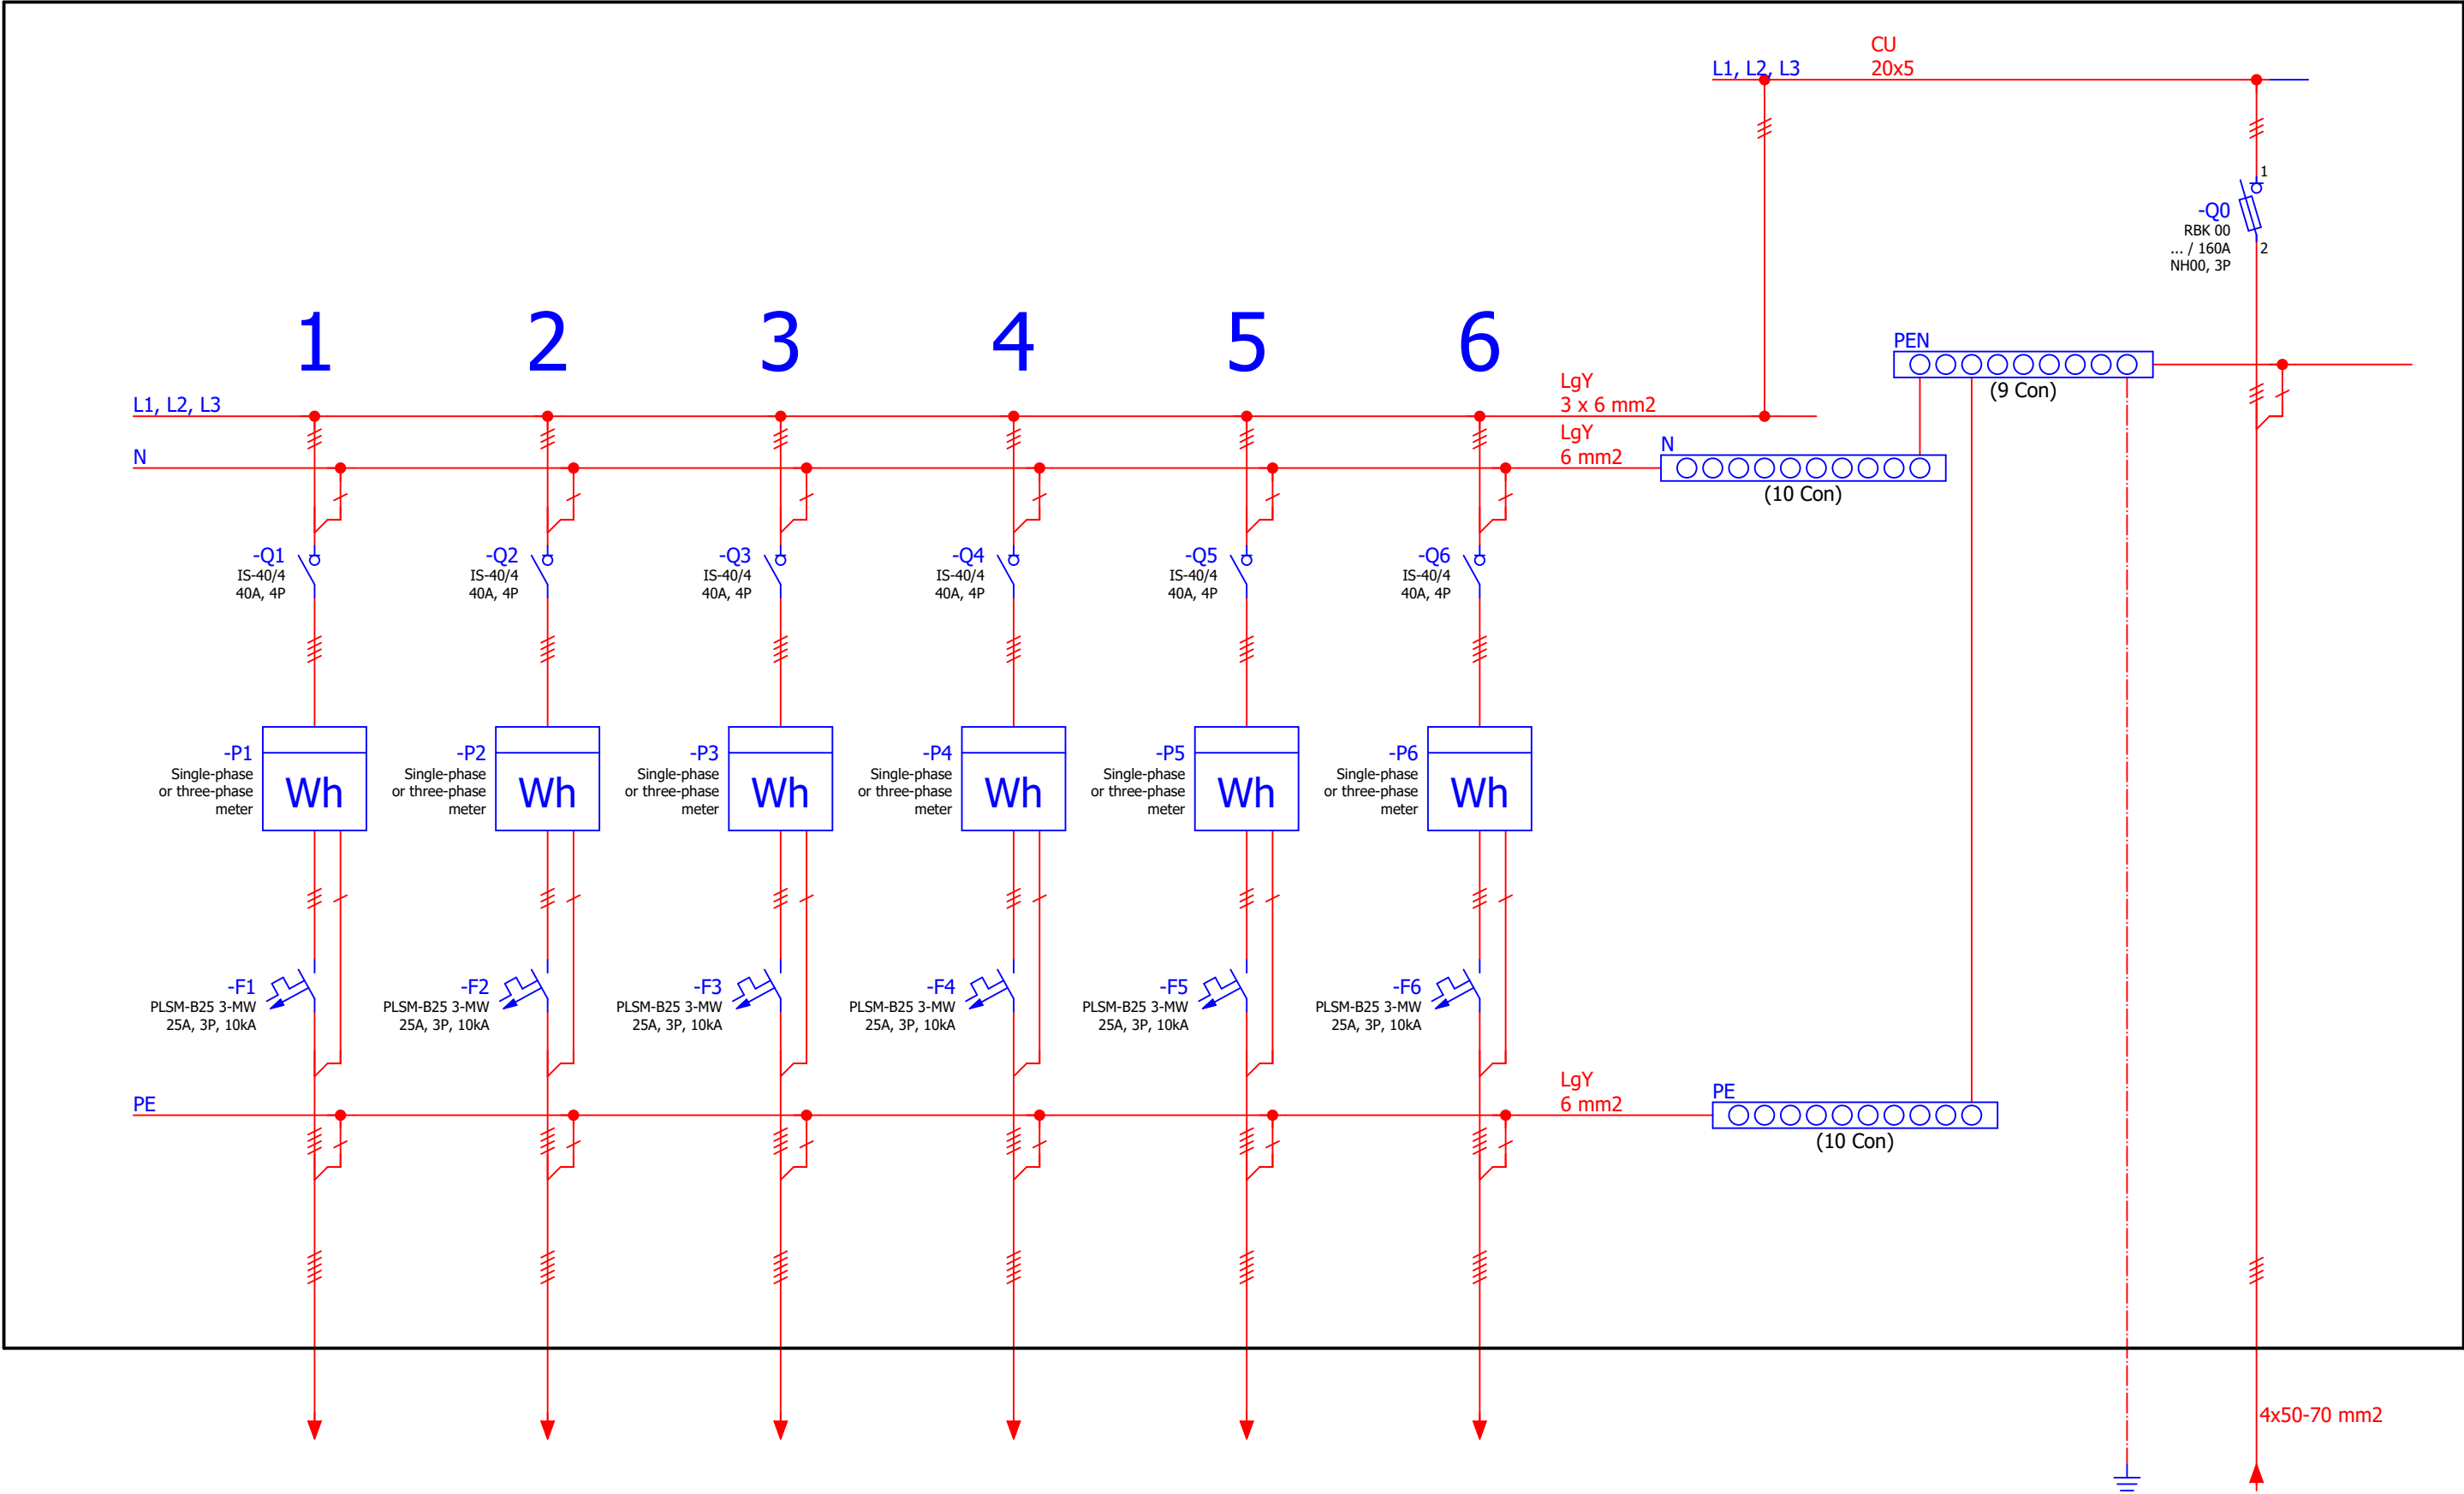

&MECH/3

&MAT/1

		Signature	Data	Made for :	Made by: Apator S.A. Polna 148 87-100 Toruń		PE-03-6 (6meters)	= U	+ S	
Design.			16.07.2024				LOT.1 No.1	Project	& SCH	Page 1/1
Check.							Electrical diagram	Schema number		

0	1	2	3	4	5	6	7	8	9
Material list = U + S									
No.	Index	Designation	Type number	Catalog number	Quantity		Designation in the schema	Producer	
1		Wyłącznik nadmiarowo-prądowy	PLSM-B25/3-MW	242450	6	sztu	-F1...-F6	ETN	
2			T-U 1F/3F-b/z-12		6		-P1...-P6		
3			Cabinet		1		-PM1		
4			LgY 6mm2		60		-PM1		
5			CU 20x5		1		-PM1		
6			IS-40/4	276273	6		-Q1...-Q6	ETN	
7	63-823256-121	Rozłącznik bezp.kasetowy RBK 00 pro-M	RBK 00		1	szt.	-Q0	APATOR	
8	ZM0000874	Szyna montażowa perforowana (1 m)	TS35		2	m	-PM1	Hurt	

&SCH/1

		Signature	Data	Made for :	Made by: Apator S.A. Polna 148 87-100 Toruń		PE-03-6 (6meters)	= U	+ S	
Design.			16.07.2024				LOT.1 No.1	Project	& MAT	Page 1/1
Check.							Całościowa lista artykułów : ETN.242450 - TS35	Schema number		