# TEST REPORT







#### INFORMATION SHEET

KERI(Korea Electrotechnology Research Institute) issues a Type Test Certificate and a Test Report as below.

1. Type Test Certificate

A Certificate contains a record of a series of type tests carried out strictly in accordance with IEC, and/or regional standard and national standard that are identical to IEC standard. The equipment tested has fulfilled the requirements of this standard and the relevant ratings assigned by the manufacturer are endorsed by KERI. The Certificate is applicable only to the equipment tested. KERI is responsible for the validity and the contents of the Certificate. The responsibility for conformity of any apparatus having the same designation as the one tested rests with the manufacturer. The certificate contains the essential drawings and a description of the equipment tested. Detailed rules are given in KERI's Type Test Certification Procedure.

#### 2. Test Report

#### 2.1 Type Test Report

A Type Test Report contains a record of a series of type tests carried out strictly in accordance with a standard recognized by KERI. The equipment tested has fulfilled the requirements of this standard and the relevant ratings assigned by the manufacturer are endorsed by KERI. The Type Test Report is applicable only to the equipment tested. KERI is responsible for the validity and the contents of the Type Test Report. The responsibility for conformity of any apparatus having the same designation as the one tested rests with the manufacturer. The Type Test Report contains the essential drawings and a description of the equipment tested. Detailed rules are given in KERI's Test Procedure.

#### 2.2 Performance Test Report

A Performance Test Report contains a record of one or more tests which have been carried out according to the client's instructions. These tests are not necessarily in accordance with a recognized standard. The test results do not verify ratings of the test object. Detailed rules are given in KERI's Test Procedure.

KERI issues three types of Performance Test Report.

2.2.1 The tests have been carried out strictly in accordance with a recognized standard. The apparatus has complied with the relevant requirements.

This sentence will appear on the front page of Performance Test Report if the tests have been performed in accordance with a recognized standard, but the series of tests does not completely fulfil the requirements for a Certificate of Compliance (for example, if the number of test series is not a complete series of type tests). The Report contains verified drawings and a description of the equipment tested. The condition of the test object after the tests is assessed and recorded in the Report.

2.2.2 The tests have been carried out in accordance with the client's instructions. Test procedure and test parameters were based on a recognized standard.

This sentence will appear on the front page of Performance Test Report if the number of test duties, the test procedure and the test parameters are based on a recognized standard and related to the ratings assigned by the manufacturer. Verification of the drawings (if submitted) and assessment of the condition after the tests is only done on the client's request.

2.2.3 The tests have been carried out according to the client's instructions.

This sentence will appear on the front page of Performance Test Report if the test shots, test procedure and/or test parameters are not in accordance with a recognized standard.

3 KERI is a member of STL(Short-circuit Testing Liaison) and the accredited testing laboratory under Clause 2 of Article 2 in "Guidelines on certified testing criteria and methods for electrical equipment" (Public Notice No. 2008–120, Ministry of Knowledge Economy, Korea).



CLASSIFICATION

Type Test

**APPARATUS** 

Heat shrinkable cable termination

DESIGNATION

THSY-1/4.0

0.6/1.0(1.2) kV 10 mm 4C Type I

RECEIPT No.

TRD13S00641 (February 18, 2013)

**APPLICANT** 

Shanghai Jiameng International Trading Co., Ltd.

No.346 Qinwan Road, Jinshanwei Town, Jinshan District, Shanghai, China

**MANUFACTURER** 

Jiangsu Jiameng Electrical Equipment Co., Ltd.

No.5 Zhongli Road, Binhai Industrial Zone, Qidong City, Jiangsu Province, China

DATE OF TESTS

May 09, 2013 ~ July 03, 2013

DATE OF ISSUE

August 09, 2013

The test object, constructed in accordance with the description, essential drawings and photographs incorporated in this Type Test Report has been subjected to the series of proving tests in accordance with

BS EN 50393:2006

This Type Test Report has been issued by KERI.

The results are shown in the record of Proving Tests and the oscillograms attached hereto. The values obtained and general performances are considered to comply with the above Standard and to justify the ratings assigned by manufacturer as listed on page No. 3.

The Type Test Report applies only to the test object. The responsibility for conformity of any apparatus having the same designations with that tested rests with the Manufacturer.

Only integral reproduction of this Report are permitted without written permission from KERI. Electronic copies in PDF-format or scanned version of this Report may be available and have the status "for information only". The sealed version of the Report is only the valid version.

TOTAL No. OF PAGES(14): records (8), photographs (1), circuit diagrams (0),

drawings & descriptions (1), attachments(2), oscillograms (2)



Prepared by

Kim . Ji-Hwan

Verified by -(Technical manager)

Ahn , Sang-Pil

alm Song-Pil

park manuk

Approved by

Power Apparatus Testing & Evaluation Division

KERI

KOREA ELECTROTECHNOLOGY RESEARCH INSTITUTE (ANSAN)

111, Hanggaul-ro, Sangnok-gu, Ansan-si, Gyeonggi-do, 426-910, Republic of Korea Tel: +(0)82-(0)31-8040-4114, Fax: +(0)82-(0)31-8040-4499, www.keri.re.kr

#### Table of contents

Items	Sheet No.
Table of contents	2/14
Ratings	3/14
List of the tests	4/14
Test results	5/14~8/14
Photographs	9/14
Circuit diagrams and parameters	-
Drawings	10/14
Attachments	11/14~12/14
Oscillograms	13/14~14/14

#### Tested by:

Kim Ji-hwan

**KERI** 

## Witnessed by :

Zhangjie Tang

Kristall Liu

SHANGHAI JIAMENG INTERNATIONAL TRADING Co., Ltd. JIANGSU JIAMENG ELECTRICAL EQUIPMENT Co., Ltd.

#### Drawings:

The manufacturer guarantees that the test object submitted is manufactured in accordance with the following drawings. KERI verified that these drawings adequately represented the test object.

The following drawing is included in this test report.

Reference No.	Drawing No.	Revision No.	Date
001	T1AUS10-56	B1	2013 05 14

#### Heat shrinkable cable termination

Applied standard

BS EN 50393:2006

Manufacturer

JIANGSU JIAMENG ELECTRICAL EQUIPMENT Co., Ltd.

Designation

THSY-1/4.0

Date of manufacture

May 1, 2013

### Ratings of the test object assigned by manufacturer and proved by tests :

Rated voltage U<sub>o</sub>/U(U<sub>m</sub>)

0.6/1.0(1.2) kV

Nominal cross-sectional area

10 mm<sup>2</sup>

Number of cores

4

Type of termination

#### Ratings of the test object assigned by manufacturer :

Cable used for testing

Conductor

Stranded circular copper

Insulation

**XLPE** 

Rated voltage U<sub>o</sub>/U(U<sub>m</sub>)

0.6/1.0(1.2) kV

Nominal cross-sectional area

10 mm<sup>2</sup>

Number of cores

## List of the tests

7	est items	Standard and clauses	Test date	Sheet No.
1	AC voltage withstand test in air	BS EN 50393 8.3	May 9, 2013	5/14
2	Insulation resistance test in air	BS EN 50393 8.4	May 9, 2013	5/14
3	Heating cycle test in air	BS EN 50393 8.6	May 15, 2013 ~June 5, 2013	6/14
4	Heating cycle test in water	BS EN 50393 8.6	June 7, 2013 ~ June 28, 2013	6/14
5	AC voltage withstand test in water	BS EN 50393 8.3	July 1, 2013	7/14
6	Insulation resistance test in water	BS EN 50393 8.4	July 1, 2013	7/14
7	Examination (for information only)	BS EN 50393 8.8	July 3, 2013	7/14
8	Description of tests		-	8/14

## 1 AC voltage withstand test in air

Fest voltage kV	Test frequency Hz	Test duration min	Requirement	Voltage applied to	Earth connected to	Test result	
4 kV 60 1 No		60 1 No failure			RYGB	Metallic sheath	No failure
			No failure	R	Y G B Metallic sheath	No failure	
	60			Y	R G B Metallic sheath	No failure	
		G	R Y B Metallic sheath	No failure			
				В	R Y G Metallic sheath	No failure	

\* Atmospheric condition: 22.3 °C, 59 % RH, 1 012 hPa

\* Phase conductor : R, Y, G

\* Neutral conductor : B

#### 2 Insulation resistance test in air

Test voltage kV	Test duration min	Requirement	Measi	uring points	Test result
DC 1 kV	kV 1 ≥ 50 MΩ	≥ 50 MΩ	RYGB	Metallic sheath	≥ 99.9 GΩ
			R	Y G B Metallic sheath	≥ 99.9 GΩ
			$\geq$ 50 M $\Omega$	Y	R G B Metallic sheath
		G	R Y B Metallic sheath	²≥ 99.9 GΩ	
	10,17		В	R Y G Metallic sheath	. ≥ 99.9 GΩ

\* Atmospheric condition: 22.3 °C, 59 % RH, 1 012 hPa

\* Phase conductor : R, Y, G

\* Neutral conductor : B

# 3 Heating cycle in air

Test method and requirement	Test result
The temperature of the phase conductor shall be raised to $(95 \sim 100)$ °C by heating the assembly, by passing current through the cables.	
A steady conductor temperature shall be maintained for not less than 2 h. After the 2 h minimum steady temperature period the current shall be switched off and the cable allowed to cool naturally to within 10 K of ambient within a period not less than 3 h.	Refer to the test results of 5 and 6
The test assembly shall be subjected to 63 cycles in air.	

# 4 Heating cycle in water

Test method	Test result
The cable cores shall be exposed at the entry to the joint by removing an oversheath together with any bedding or filling material of at least 50 mm length and between 50 mm and 150 mm from the exterior of the accessory. The exposure of cores shall be made on the side with the shorter sealing length between the sheath cut back and connectors.	
The assembly shall be placed in a water bath with a water height of 1 000 mm.	
During the heating cycle temperature of the water shall be (20 $\pm$ 15) $^{\circ}\mathbb{C}$ .	Refer to the
The temperature of the phase conductor shall be raised to $(95 \sim 100)$ °C by heating the assembly, by passing current through the cables.	test results of 5 and 6
A steady conductor temperature shall be maintained for not less than 2 h. After the 2 h minimum steady temperature period the current shall be switched off and the cable allowed to cool naturally to within 10 K of ambient within a period not less than 3 h.	
The test assembly shall be subjected to 63 cycles in water.	

## 5 AC voltage withstand test in water

Test voltage	Test frequency	Test duration	Requirement	Voltage applied to	Earth connected to	Test result
				RYGB	Metallic sheath & Water	No failure
				R	Y G B Metallic sheath & Water	No failure
4 kV	60 Hz 1 min	1 min	No failure	Y	R G B Metallic sheath & Water	No failure
				G	R Y B Metallic sheath & Water	No failure
				В	R Y G Metallic sheath & Water	No failure

<sup>\*</sup> Atmospheric condition: 27.8 °C, 58 % RH, 1 008 hPa

#### 6 Insulation resistance test in water

Test voltage	Test duration	Requirement	N	Measuring points	Test result
			RYGB	Metallic sheath & Water	≥ 99.9 GΩ
			R	Y G B Metallic sheath & Water	≥ 99.9 GΩ
DC 1 kV	1 min	$\geq$ 50 M $\Omega$	Υ	R G B Metallic sheath & Water	≥ 99.9 GΩ
			G	R Y B Metallic sheath & Water	≥ 99.9 GΩ
			В	R Y G Metallic sheath & Water	≥ 99.9 GΩ

<sup>\*</sup> Atmospheric condition: 27.8 °C, 58 % RH, 1 008 hPa

## 7 Examination (for information only)

Test method	Test result
After completing the test, the assembly shall be dismantled.  All components shall be examined for traces of moisture within water-proofing components.	No trace of moisture

<sup>\*</sup> Phase conductor : R, Y, G

<sup>\*</sup> Neutral conductor : B

<sup>+</sup> Phase conductor : R, Y, G

<sup>\*</sup> Neutral conductor : B

# 8 Description of tests


- 8.1 The above tests were carried out on the test objects submitted by the applicant in accordance with BS EN 50393:2006 (Test methods and requirements for accessories for use on distribution cables of rated voltage 0.6/1.0 (1.2) kV).
- 8.2 The above tests were carried out on one test sample in sequence. The end.



### Photographs



<Before assembling>

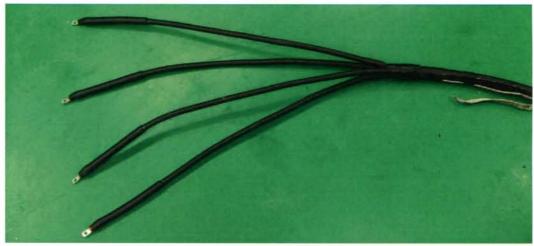

<After assembling>

Apparatus: Heat shrinkable cable termination


Designation: THSY-1/4.0

Ratings: 0.6/1.0(1.2) kV 10 mm2 4C Type I


Manufacturer: JIANGSU JIAMENG ELECTRICAL EQUIPMENT Co., Ltd.

Photo. ET01: Test object


### **Drawings**

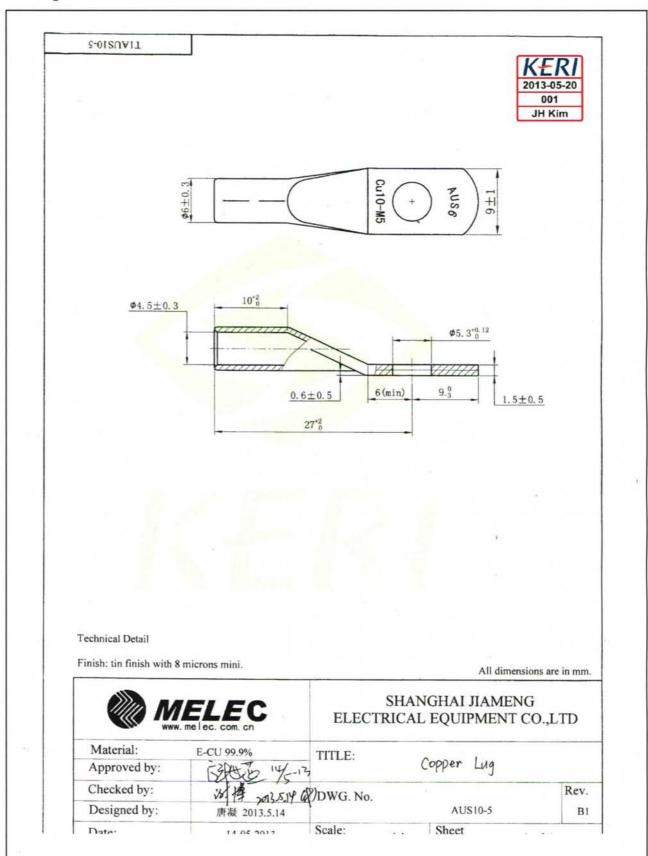

#### Attachments

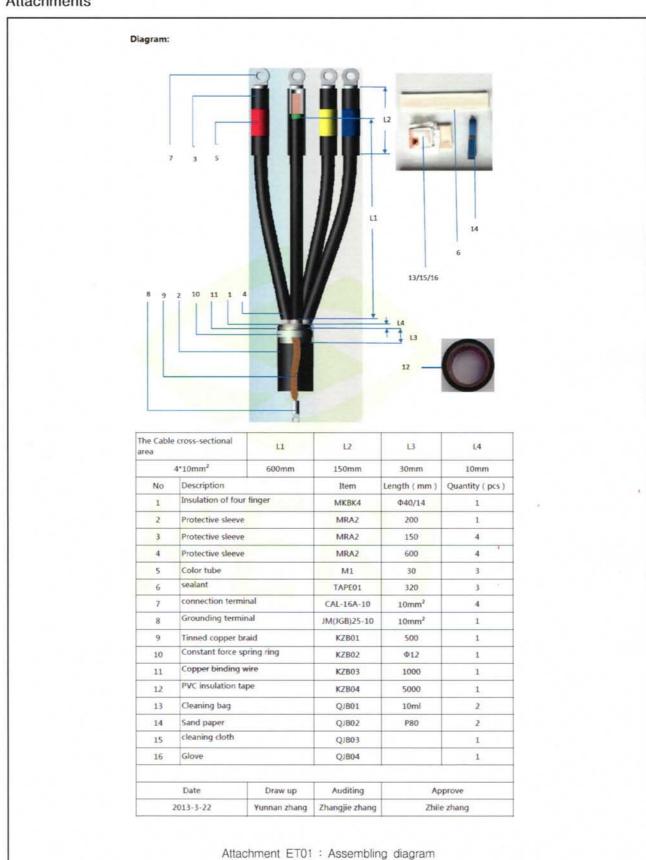

### Attachments




2N		STRUCTURE	UNIT	DATA
		nominal area	mm2	4x10
1 conductor	piece/single core diameter	NO. /mm	7/1.35	
		diameter	an.	4.00
		the max. resistance at 20℃	Ω/km	1.83
		material	X	LPE
2	insulation	nominal thickness	nn nn	0.7
	1	insulation diameter	nn.	5.4
		wrapping material	non-wove	n fabrics
3	laying up	layers/thickness	NO. /mm/mm	1/0.2
		laying up thickness	πn	13.90
4 bed	bedding	material		
	bedding	nominal thickness		L. 20
5	armour	material	galvanized	steel strip
	aracu.	layers/thickness	me.	2/0.2
		material	P	vc
5	sheath	nominal thickness	nn	1.8
	audu tu	cable diameter	nn.	21. 7
		approximately weight	kg/km	787.0

Attachment ET02: Construction of cable used for testing

Oscillograms

Osc. ET01

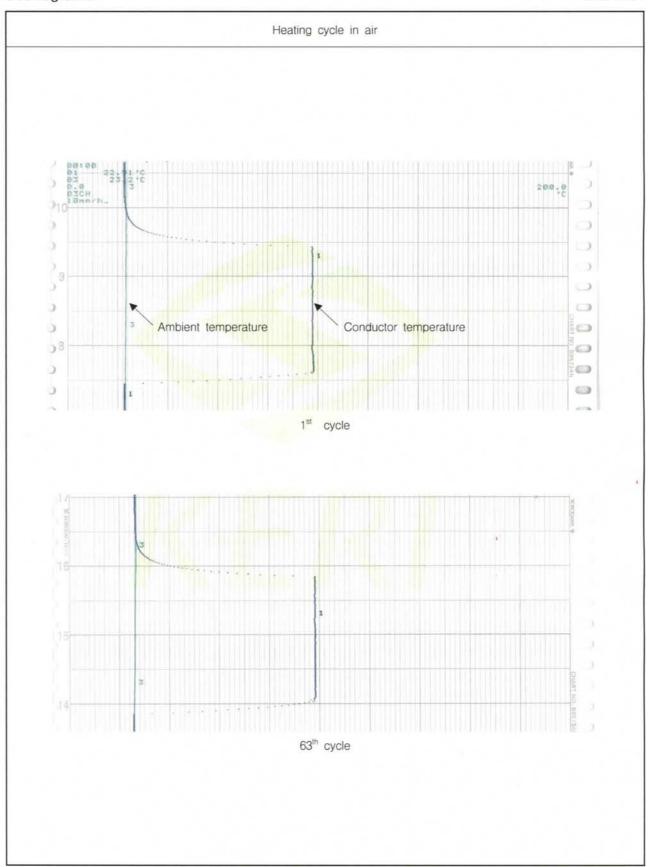

Oscillograms

Osc. ET02

