



MARK VIEW

A ANKARA
SERAMİK
IPU 10/1000-7,5 UHL1
MADE IN TURKIYE

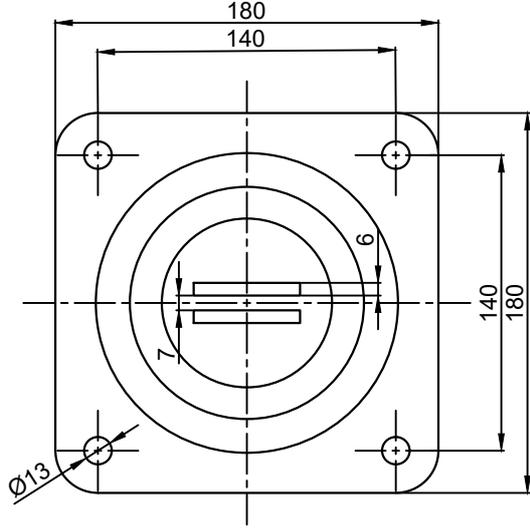

'X' Bakışı
View 'X'

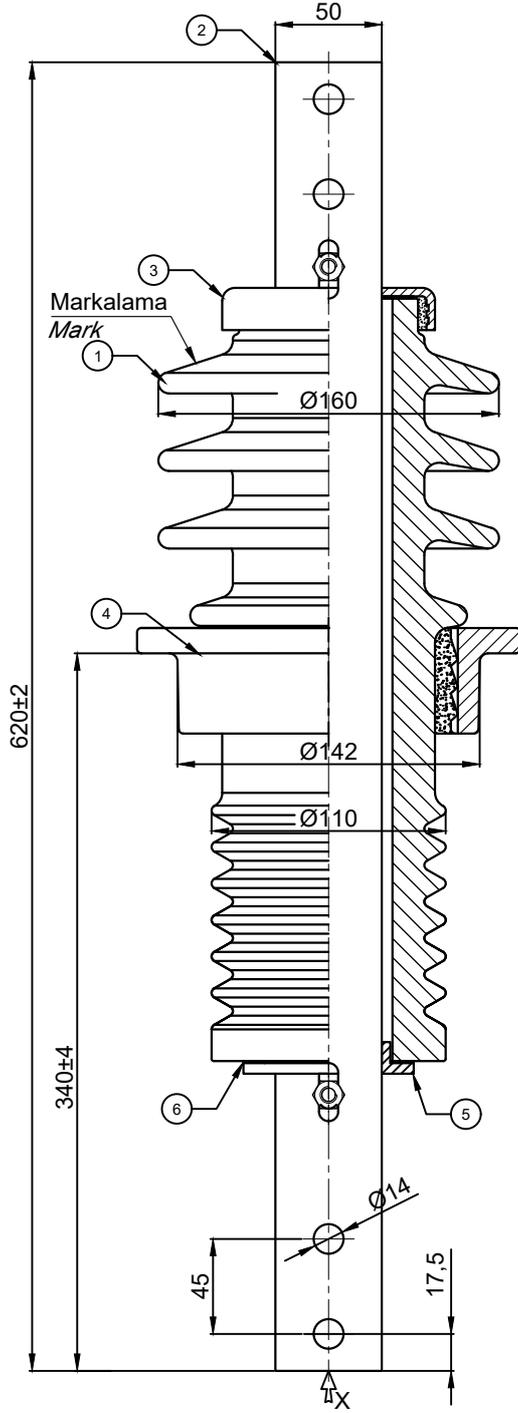

| ELEKTRİKSEL PERFORMANS ELECTRICAL PERFORMANCE | |
|--|--------|
| Anma Gerilimi (Rated Voltage) | 10 kV |
| Anma Akımı (Rated Current) | 1000 A |

| MEKANİKSEL PERFORMANS MECHANICAL PERFORMANCE (IEC 60383-1) | |
|---|--------|
| Eğilmede Minimum Kırılma Yüğü (Minimum Bending Failing Load) | 7,5 kN |

| DIELEKTRİK PARÇALAR (DIELECTRIC PARTS) | |
|---|----------------------|
| Malzeme (Material) IEC 60672-3 | Porselen (Porcelain) |
| Kaçak Mesafesi (Creepage Distance) | (Z-Z) min. 300 mm |
| Sır Rengi (Glaze Color) | Kahverengi (Brown) |
| Tolerans (General Tolerance) | GOST 13872-68 |
| Ağırlık (Weight) | ~10,5 kg |


| Poz. (Pos.) | Ürün No (Product No) | Bileşen Parçaları (Components Parts) | Adet (Pcs.) | Malzeme (Material) |
|----------------|-------------------------|--|----------------|--|
| 7 | - | Üst-Alt Bağlantı Seti (Top-Bottom Fixing Set) M8 | 2 | Çelik Civata-Somun- Pul (Steel Bolt-Nut) |
| 6 | 441000-917 | Üst-Alt Conta (Top-Bottom Gasket) | 2 | Mantar Conta (Cork Gasket) |
| 5 | 441000-958 | Alt Bağlantı Metali (Bottom Metal) | 1 | Alüminyum (Aluminium) |
| 4 | 441000-927 | Kare Orta Bağlantı Metali (Middle Metal) | 1 | Dökme Demir (Cast Iron) GGG 40 & C 1050 Sıcak Daldırma Galvaniz (Hot Dip Galvanized) 90-100 Mic.) |
| 3 | 441000-957 | Üst Bağlantı Metali (Top Metal) | 1 | Alüminyum (Aluminium) |
| 2 | 441000-959 | Orta Sac 6x620 (Middle Sheet Metal) | 2 | Alüminyum (Aluminium) |
| 1 | 9-441024-000 | Seramik Gövde (Ceramic Body) | 1 | Porselen (Porcelain) |

ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED

THIS DRAWING IS NOT TO BE COPIED OR THE INFORMATION HEREIN DIVULGED TO ANY THIRD PARTY OR USED FOR THE MAKING OF APPARATUS WITHOUT THE WRITTEN PERMISSION OF ANKARA SERAMİK A.Ş.

**ANKARA
SERAMİK**
www.ankaraseramik.com

PORSELEN SAN. ve TİC. A.Ş.
PORCELAIN INDUSTRY OF TURKEY
1.ORGANİZE SAN.BÖL.OSMANLI CAD.
NO:15 SİNCAN/ANKARA/TURKEY
TEL: (0312) 267 37 77 FAX: (0312) 267 27 77
info@ankaraseramik.com



IPU 10/1000-7,5 UHL 1
GEÇİŞ İZOLATÖRÜ
(Feedthrough Insulator)

| Malzeme (Material) | Porselen (Porcelain) | Adet (Piece) |
|--|----------------------|------------------|
| Std. No. | GOST 20454-85 | |
| Rev. No | | |
| Ürün no / Müşteri (Product No / Customer) | | Ölçek (Scale) |
| 9-441024-000 | | |