



TÜRK STANDARDLARI ENSTİTÜSÜ
TURKISH STANDARDS INSTITUTION

EU - TYPE EXAMINATION CERTIFICATE

2014/32/EU Measuring Instruments Directive

1783-MID-065

In accordance with Measuring Instruments Directive dated February 26, 2014 and numbered 2014/32/EU of the European Union Parliament and "Ölçü Aletleri Yönetmeliği (Measuring Instruments Directive)" numbered 2014/32/AB which was published in Official Journal of Turkish Republic dated 29.06.2016 and numbered 29757:

Manufacturer : LUNA ELEKTRİK ELEKTRONİK SAN. VE TİC. AŞ.
Atatürk Organize San. Böl. 10001. Sokak No:9 Çiğli / İZMİR

Essential requirements Applied : MID Annex I and Annex MI-003

Name of Measuring Instrument : Single-Phase Active Electrical Energy Meter

Type : LUN10F

Environmental Classes

- Climatic -40 °C / +70 °C
- Mechanic M1
- Electromagnetic E2

Project Number : 1902-19/12995

Comformity Assessment Report : 1902-MID-065/2019-01

Date of issue : 24.01.2019

Valid until : 23.01.2029

Total Page Number : 10

Sezai DOĞAN
Director of Directives
Ankara 24.01.2019 Rev 00



This certificate is only valid with annex and TSE-Notified Body 1783 seal.

www.tse.org.tr / Necatibey Cad. No: 112 Bakanlıklar - ANKARA / +90 312 416 62 00

Bu belge hiçbir suretle tahrif edilemez, kısmen veya bütünüyle değiştirilmez, pekiştirilmez, karıştırılır ve silinir yapılmaz.
This certificate cannot be altered, partially duplicated or creased for misunderstanding.



TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No:1783-MID-065/Rev. 00

1. General Information about Electrical Energy Meter

1.1 Designation

Electronical electric meter measuring active electrical energy and maximum power and showing these data on the LCD Display, auto-correcting day light saving time in summer and winter, keeping the intended data and programs in memory, getting a line on these data when required.

1.2 Design

Essential Parts of the Meter

- Electronic (circuit) card
- Lower cover-housing
- Upper cover
- Terminal cover

1.3 Metrological Characteristic

Measurement of the electrical energy

1.4 Software

21.01

1.5 Supplementary equipments

RS485 communication port

1.6 Equipments out of the scope of MID

RS485 communication port





TÜRK STANDARDLARI ENSTİTÜSÜ
TURKISH STANDARDS INSTITUTION

EU - TYPE EXAMINATION CERTIFICATE

2014/32/EU Measuring Instruments Directive

1783-MID-065

In accordance with Measuring Instruments Directive dated February 26, 2014 and numbered 2014/32/EU of the European Union Parliament and "Ölçü Aletleri Yönetmeliği (Measuring Instruments Directive)" numbered 2014/32/AB which was published in Official Journal of Turkish Republic dated 29.06.2016 and numbered 29757:

Manufacturer : LUNA ELEKTRİK ELEKTRONİK SAN. VE TİC. AŞ.
Atatürk Organize San. Böl. 10032. Sokak No:9 Çiğli / İZMİR

Essential requirements Applied : MID Annex I and Annex MI-003

Name of Measuring Instrument : Single-Phase Active Electrical Energy Meter

Type : LUN10F

Environmental Classes

- Climatic -40 °C / +70 °C
- Mechanic M1
- Electromagnetic E2

Project Number : 1902-19/12995

Comformity Assessment Report : 1902-MID-065/2019-01

Date of issue : 24.01.2019

Valid until : 23.01.2029

Total Page Number : 10

Sezai DOĞAN
Director of Directives

Ankara 24.01.2019 Rev 00



This certificate is only valid with annex and TSE No:1783-MID-065 Ankara / +90 312 416 62 00

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okumasını zorlaştıracak şekilde çoğaltılamaz, kopyası ve silinmesi yapılamaz.
This certificate cannot be altered, partially duplicated or creased for misunderstanding.



TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No:1783-MID-065/Rev. 00

1. General Information about Electical Energy Meter

1.1 Designation

Electronical electric meter measuring active electrical energy and maximum power and showing these data on the LCD Display, auto-correcting day light saving time in summer and winter, keeping the intended data and programs in memory, getting a line on these data when required.

1.2 Design

Essential Parts of the Meter

- Electronic (circuit) card
- Lower cover-housing
- Upper cover
- Terminal cover

1.3 Metrological Characteristic

Measurement of the electrical energy

1.4 Software

21.01

1.5 Supplementary equipments

Not applicable

1.6 Equipments out of the scope of MID

Not applicable





TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No:1783-MID-065/Rev. 00

2. Technical data

Type	LUN10F
Definition	1 phase, 2 wired, multi tariff, with demand meter, outdoor, active electronic electrical meter
Accuracy Class	Class B
Software Version No	21.01
Checksum	29D2C1AF
Place	İzmir
Meter Location	Outdoor
Meter Integrity	Meter integrity is preserved by seal and intervention from the outside is inhibited
Sealing Type	Plastic Pounding Seal
Circuit Type	Directly connected
Frequency	50 Hz
Reference Voltage (V)	230 V
Operating Voltage (V)	Between 0,8Un and 1,15Un
Starting Current (Ist)	20 mA (0,04Itr)
Minimum Current (Imin)	0,25 A
Transitional Current (Itr)	0,5 A
Reference Current (Iref)	5 A
Maximum Current (Imax)	100 A
Meter Constant	1000 imp/kWh
Operating Temperature	-40°C ...+70°C (3K7)
Relative Humidity	Max. %95
IP Rating	IP54 (Outdoor)
Protection Class	II (Two)
Mechanical Environment Class	M1
Electromagnetic Environment Class	E2
Voltage Circuit Power Consumption	< 2W, 10 VA
Current Circuit Power Consumption	< 4 VA
Electrostatic Discharges	Contact: 8 kV Air: 15 kV
Impulse Voltage	6 kV
Communication	Optic





TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No: 1783-MID-065/Rev. 00

3. Marking

The following data shall be marked on the water meter

- manufacturer's name and/or registered trademark,
- phase number and connection cable number
- year of production and serial number,
- current gauging interval, minimum current (I_{min}), reference current (I_{ref}), maximum current (I_{max})
- reference frequency (Hz),
- meter constant
- accuracy class
- electric security class güvenlik sınıfı (double square mark for meters with insulating lining)
- operating temperature interval or environmental class)
- nominal voltage (primary and secondary voltage if with transformer),
- EU-Type examination certificate number,
- conformity marking according to the regulation in regards to the measuring instruments

3.1 Registered trademark of the manufacturer

The manufacturer uses the following figure inscription commercial trademark on the electrical energy meters



4. Sealing

Lower housing of the meter and upper cover are screwed together and it is stamped by attaching a plastic seal on the gap above the screw. Terminal cover is sealed by authorised personnel after the meter has been mounted.

5. Terms of Production, putting into use and usage

5.1 Production

- no special terms identified for production

5.2 Putting into use

electrical energy meters must be installed in the plumbing as mentioned in installation instructions and/or user's manual of the manufacturer.

- type tests of the meter were carried out according to EN 50470-1:2006 and EN 50470-

3:2006



www.tse.org.tr / Necatibey Cad. No: 112 Bakanlıklar - ANKARA / +90 312 416 62 00

Sayfa 4 / 10

Bu belge hiçbir suretle tahrif edilemez, kısmen veya okunmasını zorlaştıracak şekilde çoğaltılamaz, kazıntı ve silinti yapılamaz.
This certificate cannot be altered, partially duplicated or creased for misunderstanding.



TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No: 1783-MID-065/Rev. 00

5.3 Requirements for usage

- must be used in accordance with the terms of the user's manual given by the manufacturer.

6. Documentation used within the scope of assessment

- Testing report dated 05.12.2018 and EL18-0049 issued by Eldaş Elektrik, Elektronik San. ve Tic. A.Ş.
- Manufacturer's technical file, technical drawings, component lists

7. Standards and regulations used within the scope of assessment

7.1 Regulations, harmonised standards and mandatory normative documents

- Measuring Instruments Directive numbered 2014/32/AB published in the Official Journal dated 29.06.2016 and number 29757
- EN 50470-1:2006
- EN 50470-3:2006
- OIML R 46:2012

7.2 Reference documents

- WELMEC Guide 7.2

8. Conclusion

Structural, technical and metrological parameters of the meter must be compatible with the documentation submitted with this Type Examination Certificate. The meter must meet the requirements of the Measuring Instruments Directive numbered 2014/32/EU of the European Union Parliament and the Council and the Measuring Instruments Directive numbered 2014/32/AB published in the Official Journal dated 29.06.2016 and number 29757 of Turkish Republic.

9. Annexes

Annex-1: Illustrative pictures of the water meter

Annex-2: Demonstration of Sealing

Annex-3: Marking

Annex 4: Meter Dimensions





TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No:1783-MID-065/Rev. 00

Annex-1:



Front Picture of Meter



Back Picture of Meter





TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION


Certificate No:1783-MID-065/Rev. 00




Right View Picture Of Meter



Inside view of the Meter

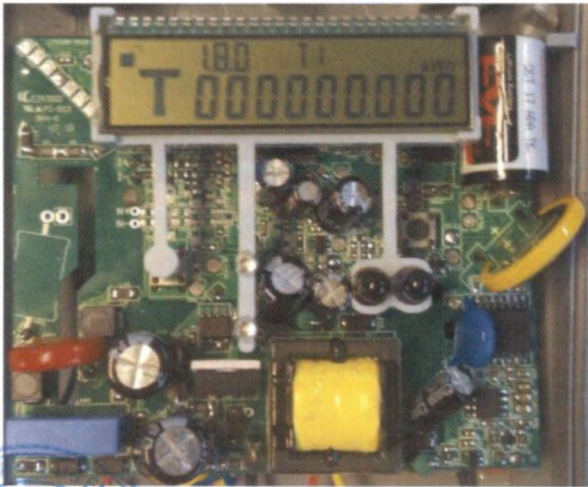

Electronic Card Front View

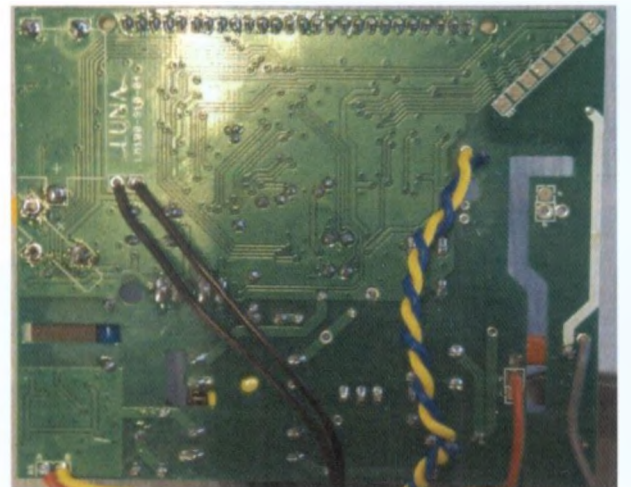

Electronic Card Back View






TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No:1783-MID-065/Rev. 00

Annex-2:

Sealing

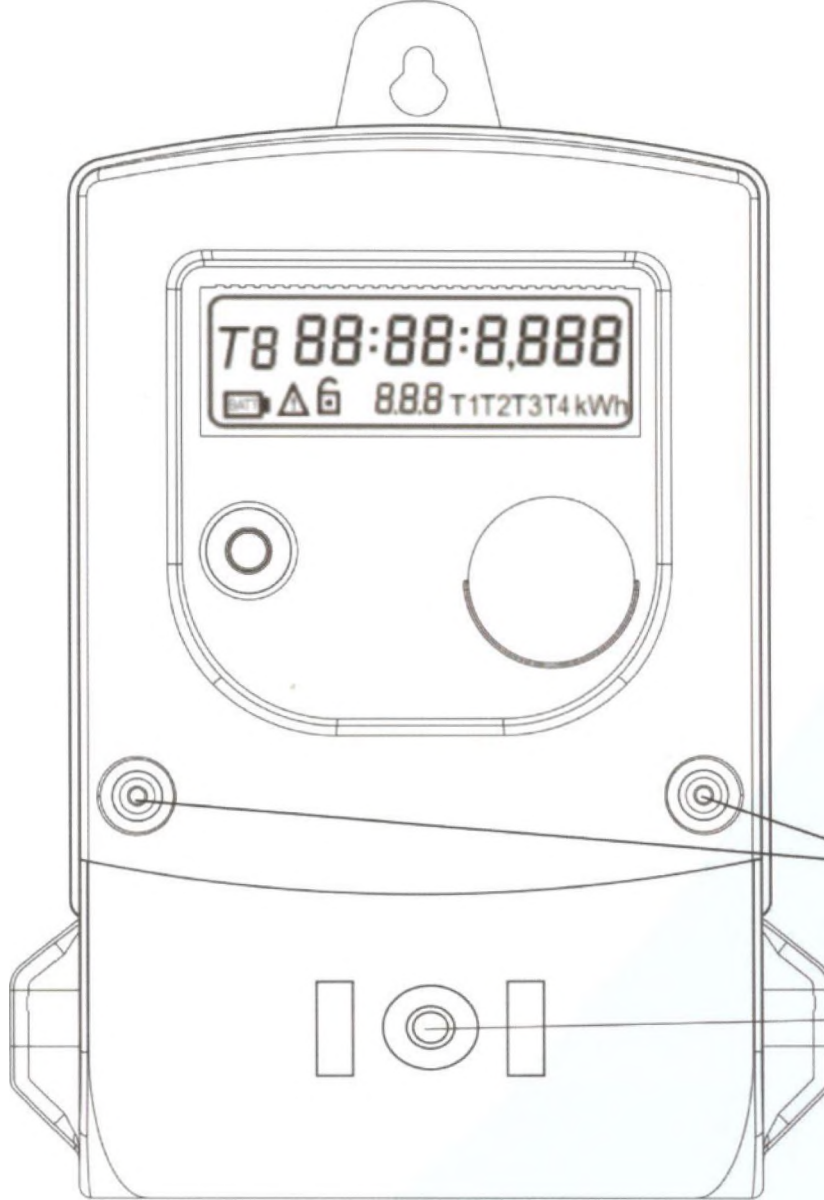

**LUNA A.Ş.
Mühür**

**Dağıtım Şirketi
Mühür**






TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No: 1783-MID-065/Rev. 00

Annex 3 :

Marking

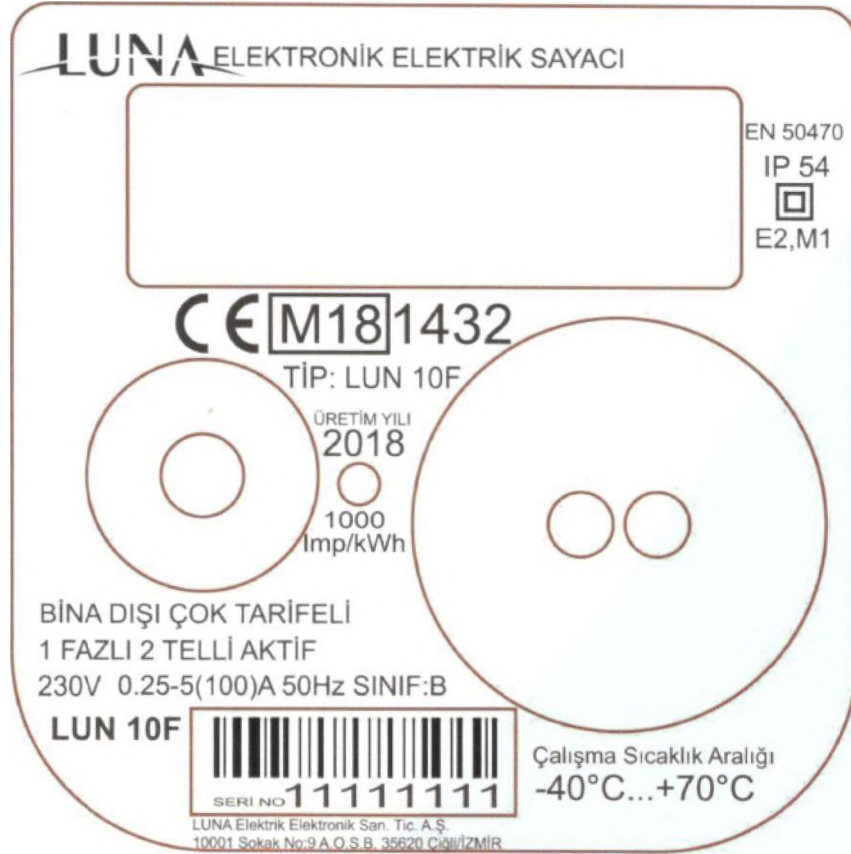



TÜRK STANDARDLARI ENSTİTÜSÜ

TURKISH STANDARDS INSTITUTION

Certificate No: 1783-MID-065/Rev. 00

Annex 4 :

Meter Dimensions

