


Nr. de inv. orig.	Data și semnătura	Nr. de inv. schimb.

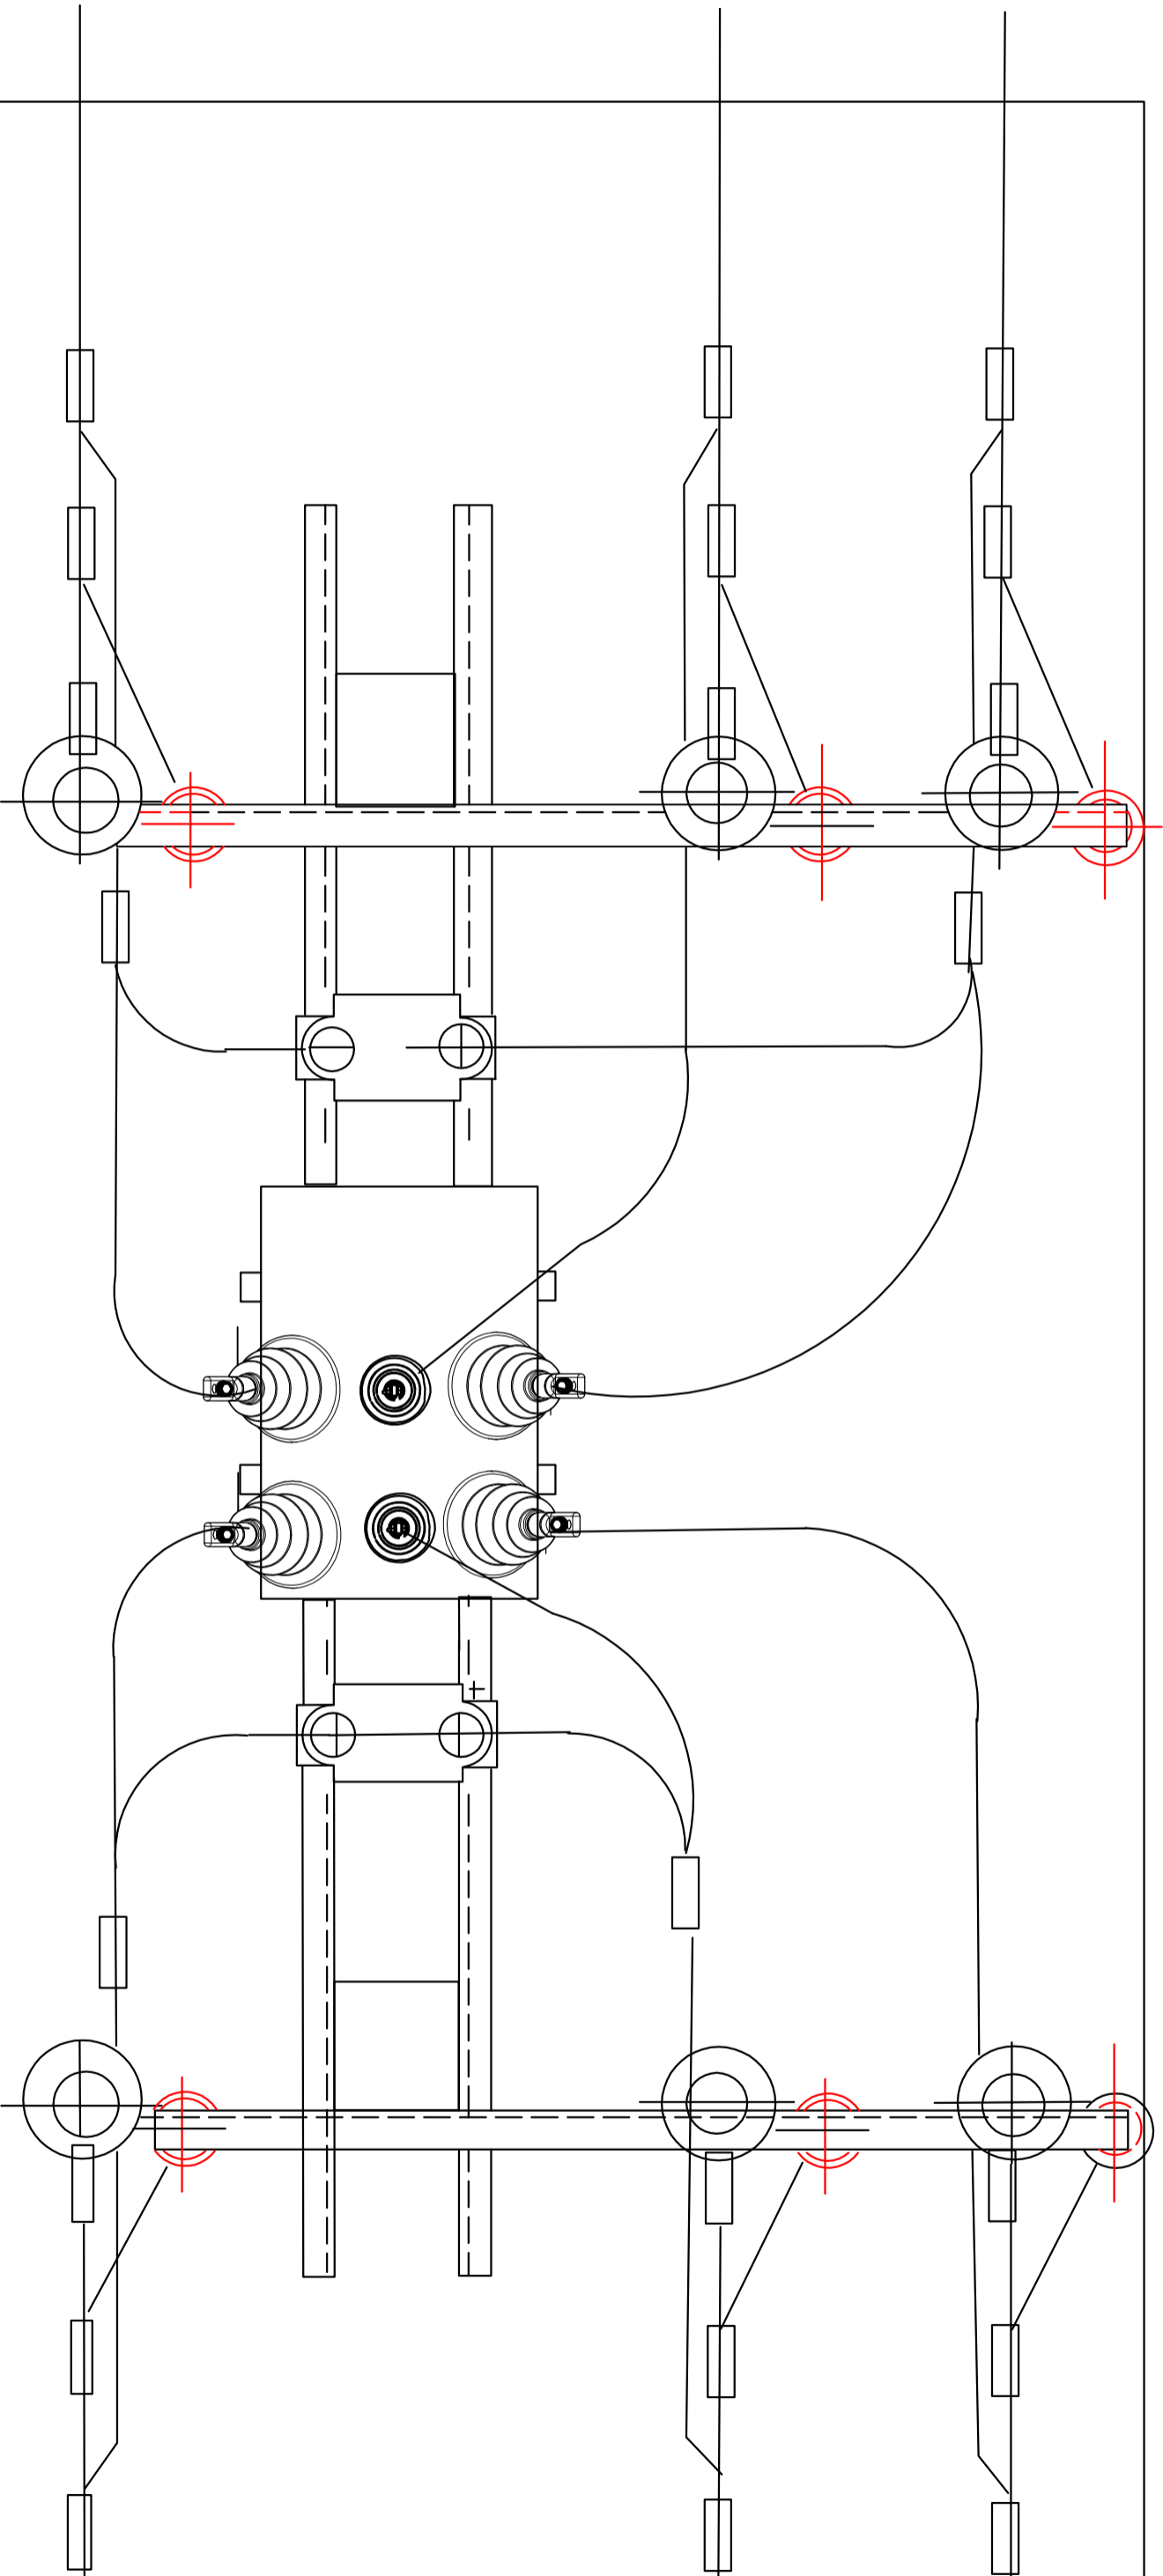

69-CM				
<i>Automatic Circuit 3-phase Recloser rated at 15.5 kV equipped with RC-10 control cubicle OSM 15-16-800-310</i>				
Nr. sec.	Coala	Nr. doc.	Semnat	Data
Sp. princ.		Bîrsan V.		03.18
Verificat		Noga L.		03.18
Elaborat		Codreanu I.		03.18
<i>pilon de capăt pentru separatorului-fuzibil</i>			"ABSOLUT ENERGIE" SRL	
<small>Концевая опора для предохранителя-разъединителя</small>				
Faza	Plansa	Planse		
PE	4	11		