
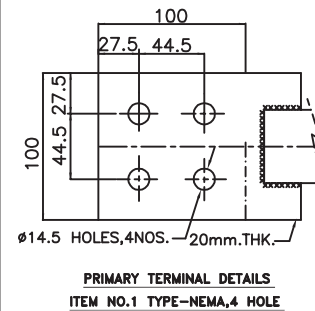
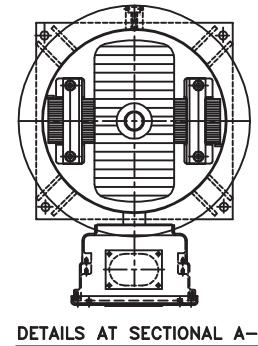

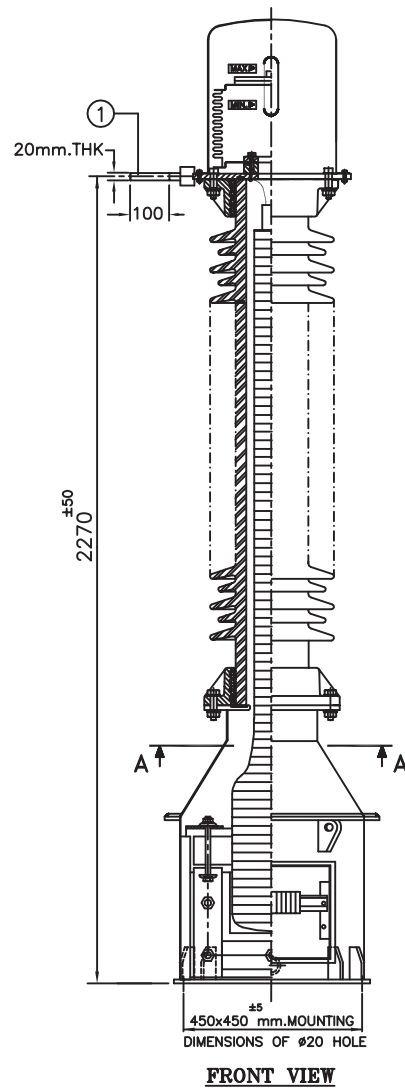


IF IN DOUBT ASK

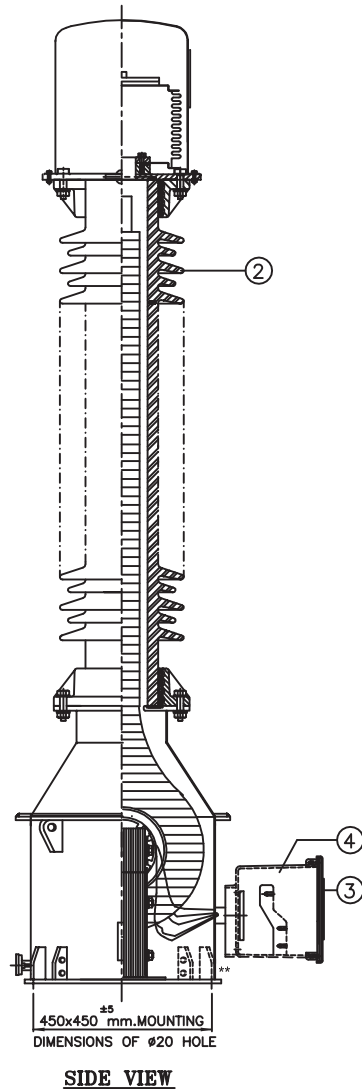

ITEM NO.	QTY.	DESCRIPTION
1	1	ALUMINIUM PRIMARY TERMINAL (TYPE-NEMA)
2	1	PORCELAIN INSULATOR (BROWN COLOUR)
3	1	RATING & SCHEMATIC DIAGRAM
4	1	SECONDARY TERMINAL BOX

NOTE : PLEASE REFER INSTRUCTION MANUAL FOR HANDLING & TRANSPORTATION OF IVT.

R6			R4			R2					SIGN		NAME	GENERAL ARRANGEMENT DRAWING 110 KV INDUCTIVE VOLTAGE TRANSFORMER TYPE-VROT										
											DRN		STJ											
R5			R3			R1					CHD		SDS											
											APPD		SDS											
NO	REVISION			SIGN	DATE	NO	REVISION			SIGN	DATE	NO	REVISION			SIGN	DATE	SCALE	N.T.S.	DATE : 04.03.2021		ALL DIMENSIONS ARE IN mm		DRG.NO:- SX7818 IVT3 GA/R0