

## DECLARAȚIE DE CONFORMITATE



SCHRÉDER ROMANIA S.R.L., cu sediul în Cluj - Napoca, str. Corneliu Coposu, nr. 167A, Jud. Cluj, România, înregistrată la Registrul Comerțului cu nr. J12/1759/1998, membră a SCHRÉDER GROUP, în calitate de furnizori de aparate de iluminat marca SCHRÉDER

Declarăm pe propria răspundere că aparatul de iluminat: **VOLTANA 0**

**Versiune:** max. 8 LED-uri  
**Clasă electrică:** I sau II  
**Balast:** electronic  
**Tensiune nominală:** 230V / 50Hz  
**Caracteristici:** Max. 1000mA  
**Etanșeitate compartiment optic:** IP 66  
**Etanșeitate compartiment aparataj:** IP 66

Cu condiția ca acesta să fie instalat, întreținut și utilizat în conformitate cu standardele de instalare și instrucțiunile producătorului. Este în conformitate cu următoarele directive sau standarde:

- EN 60598-1 (2015)
- EN 60598-2-1 (1979)
- EN 60598-2-3 (2003 + A1 2011)
- EN 61547 (2009)
- EN 61347 (2015)
- EN 55015 (2013)
- EN 61000-3-2 (2014) & 3-3 (2013)
- EN 62471 (2008)
- EN 62493 (2010)
- Directiva 2014/30/EU
- Directiva 2014/35/EU
- Directiva 2009/125/EC
- Directiva 2012/19/EU
- Directiva 2003/108/EC
- Directiva RoHS 2011/65/EU (RoHS 2)
- R.D. 1890/2008, 14 Noiembrie
- R.D. 154/1.995, 3 Februarie
- R.D. 842/2002, 2 August

SCHRÉDER ROMANIA S.R.L.  
Director General,

Alexandru SIRCA

Eliberat,  
Martie 2019, Cluj-Napoca

## LED Flux measurement

FORM-L-41 ED1 REV 2

Date : **16-01-19**

Operator : **FCE**



Filename : **2019\_52.xml**

**226 - TEST**

**NBN EN ISO/IEC 17025 : 2005**

### LEDs

Trademark : **Samsung**

Entry number : **39R004-2**

Type : **LH351C**

Power (Catalogue) : **0,00** W

BIN Description : **40-70M-4-TB-RB**

Flux : **0** lm/LED

Part number : **Unknown**

Color or CCT (Theoretical) : **NW**

Number of LEDs : **6**

### Lenses

Trademark : **None**

Type : **None**


### Power & Print

Type : **DELTA SM400-AR-4**

Print description : **00-71-626 A - Voltana 0**


Active

### Picture



### Sphere photometric measurement

Maximum flux : **1157** lumens

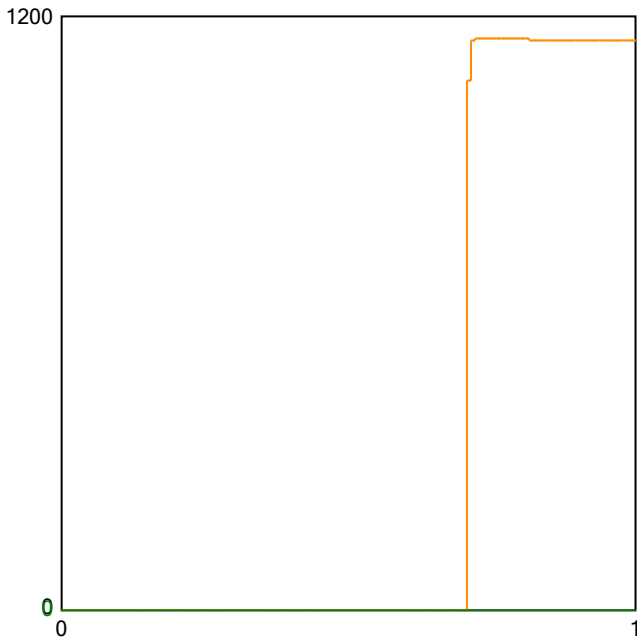

### Operating condition

Position in sphere :



Ambient sphere T ° : **24,6**

### Electrical measurement

#### ● Secondary electrical measurement

Voltage : **16,93** V

Current : **0,350** A

Power : **5,92** Watt

→ LEDs light efficiency at 25° :

**195,4** lm/W

**192,9** lm/Led

#### ● Primary electrical measurement

Voltage : **N/A** V

Current : **N/A** A

Power : **N/A** Watt

Cos φ : **N/A**

→ Driver losses : **N/A** %

→ LEDS & Driver light efficiency :

**N/A** lm/W

Description :

Flux @25°/350mA - pcb Voltana 0 - 6 Samsung LH351C - pcb N°2

Comment :

FORM-L-41 ED1 REV 2



226 - TEST

Approved by :

LED 2019/52 2/3



Colorimetry

File Preset Options Extra Calibration Info

Preset: CRI

Auto: ref: illuminant - Planckian radiator, CCT= 3859 K

Auto: ref: illuminant - Planckian radiator, CCT= 3859 K

Auto: ref: illuminant - Planckian radiator, CCT= 3859 K

Chromaticity difference DC= 6.2E+4

CRI color samples

|         |          |          |
|---------|----------|----------|
| R1=68.5 | R8=47.1  | R15=60.2 |
| R2=80.3 | R9=39.4  |          |
| R3=90.4 | R10=54.8 |          |
| R4=70.7 | R11=67.4 |          |
| R5=69.3 | R12=48.9 |          |
| R6=72.9 | R13=70.7 |          |
| R7=78.7 | R14=94.8 |          |

JIS color sample

Re= 62.37  
(mean value of R1 - R15)

Auto: ref: illuminant - Planckian radiator, CCT= 3859 K

Auto: ref: illuminant - Planckian radiator, CCT= 3859 K

Target

Calibration File: #1 no accessory

Measurement Mode: Radiance

Weighting Function: None

Average: 1

Measurement

Cont: 10

Hold Integration Time

Quick mode

#1

Transfer data to table

auto

Luminance  $L_v$  1.898E+2  $\frac{cd}{m^2}$

Radiance  $L_e$  5.383E-1  $\frac{W}{m^2 \cdot sr}$

Corr. Color Temp CCT 3859 K

Chromaticity x 0.3864 y 0.3793

Chromaticity  $u'$  0.2280  $v'$  0.5036

QUIT



**RTECH-PHOTOMETRY LABORATORY**

Testreport : Measurement of luminous intensity distribution related to the standard  
NBN-EN 13032-1; NBN-EN 13032-4; CIE 121-1996; CIE S 025/E; IES LM-79-08 and procedures PT-P-01  
and PT-P-02

rue de Mons, 3 B-4000 LIEGE - Tel : 04/224.71.40 - Fax : 04/224.25.90  
Measurement for Schröder group.


**LED**

|  |   |                           |                     |                         |
|--|---|---------------------------|---------------------|-------------------------|
| Origin<br>TUNGSRAM-Schröder Zrt.<br>Hungary  | Production<br>TUNGSRAM-Schröder Zrt.<br>Hungary | Luminaire<br>VOLTANA 0    | Inclination<br>0°   | Request #<br>FD39022    |
| Source   |   |                           |                     |                         |
| Type<br>LED  | BIN<br>40-70M-4-TB-RB                           | Trademark<br>Samsung      | Reference<br>LH351C | # LEDs<br>6             |
| Reflector<br>5206  | Master<br>-                                     |                           |                     | Reflector<br>No<br>5206 |
| DKI Led assembly Road lighting Injected 0.0°   |   |                           |                     |                         |
| Protector Refractor Lens   |   |                           |                     |                         |
| Protector integrated lenses<br>Lens DKI 5206 PC  |   |                           |                     |                         |
| Laboratory observation   |   |                           |                     |                         |
| VOLTANA 0 with 6 Samsung LH 351C<br>Used flux for efficiency matrix calculation = 1157lm - CCT = 3859K - CRI = 72,26 (see sphere test report 2019/52 on appendix).                           |   |                           |                     |                         |
| Purpose DOC  |   | Sample date<br>08-01-2019 | Sample #<br>39R004  |                         |
| Observation  |   |                           |                     |                         |
| DOC Voltana 0 with lenses 5206<br><br>Flux coefficient multiplicator (only for efficiency matrix):<br>From 350 to 500 mA : 1,379<br>From 350 to 700 mA : 1,846<br>From 350 to 1000mA: 2,450  |   |                           |                     |                         |
| Notes  |   |                           |                     |                         |
| The publication of this report in another form than the original one is not allowed without agreement of the laboratory.<br>This report concerns type tests on one or a series of specimens. |   |                           |                     |                         |

|                 |                    |                      |               |   |              |
|-----------------|--------------------|----------------------|---------------|---|--------------|
| Asked by<br>RCA | Measured by<br>CLD | Approved by<br>RLABO | Appendix<br>1 |   <b>226-TEST</b><br>NBN EN ISO/IEC 17025 : 2005 | <b>42572</b> |
|-----------------|--------------------|----------------------|---------------|---|--------------|

### LUMINOUS INTENSITY DIAGRAM

|   |  |   |                                       |                               |                       |                          |  |                             |  |
|---|--|---|---------------------------------------|-------------------------------|-----------------------|--------------------------|--|-----------------------------|--|
| Origin<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |  | Production<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |                                       | Luminaire<br><b>VOLTANA 0</b> |                       | Inclination<br><b>0°</b> |  | Request #<br><b>FD39022</b> |  |
| Source  | Type<br><b>LED</b>   | BIN<br><b>40-70M-4-TB-RB</b>                            | Trademark<br><b>Samsung</b>           | Reference<br><b>LH351C</b>    | # LEDs<br><b>6</b>    | Reflector<br><b>5206</b> |  |                             |  |
| Reflector   | <b>DKI Led assembly Road lighting Injected 0.0°</b>  |   |                                       |                               | No                    | <b>5206</b>              |  |                             |  |
| Matrices  | <b>425721</b>  |   | $\Phi$ 0-90° = 1040lm - 90-180° = 0lm |                               |                       | Absolute measurement     |  |                             |  |
| Protector Refractor Lens                            | Protector <b>integrated lenses</b><br>Lens <b>6 x DKI 5206 PC</b>  |   |                                       |                               |                       |                          |  |                             |  |
| Observation   | <p>Matrix in total flux @350 mA</p> <p>Light losses due to thermal stabilisation : 1%</p> <p>Electrical measurement on LED (#1) : Voltage = 16.83 V    Current = 0.350 A    Power = 5.88 W</p> <p>Electrical measurement on driver (#1) : Voltage = 230.00 V    Current = 0.037 A    Power = 7.98 W    PF = 0.936</p> <p><b>Total luminaire power = 7.98 W : Lm/Watt = 130.30 lm/W</b></p> <p>Driver #1 : Philips Xitanium FP 22W 0.3-1.0A SNLDAE 230V S175 sXt S175 sxt PCB 00-71-626 A</p> |   |                                       |                               |                       |                          |  |                             |  |
| Plane   | I Peak   | Peak position   | Index                                 | I zero                        | Laboratory ambient t° | Measurement date         |  | ↕                           |  |
| 15 - 165  | 723  | 55  | S                                     | 369                           | 24.9°                 | 07-02-2019               |  |                             |  |
| 90  | 384  | 7   | D                                     |                               |                       |                          |  |                             |  |
| 270   | 369  | 0   | G                                     |                               |                       |                          |  |                             |  |

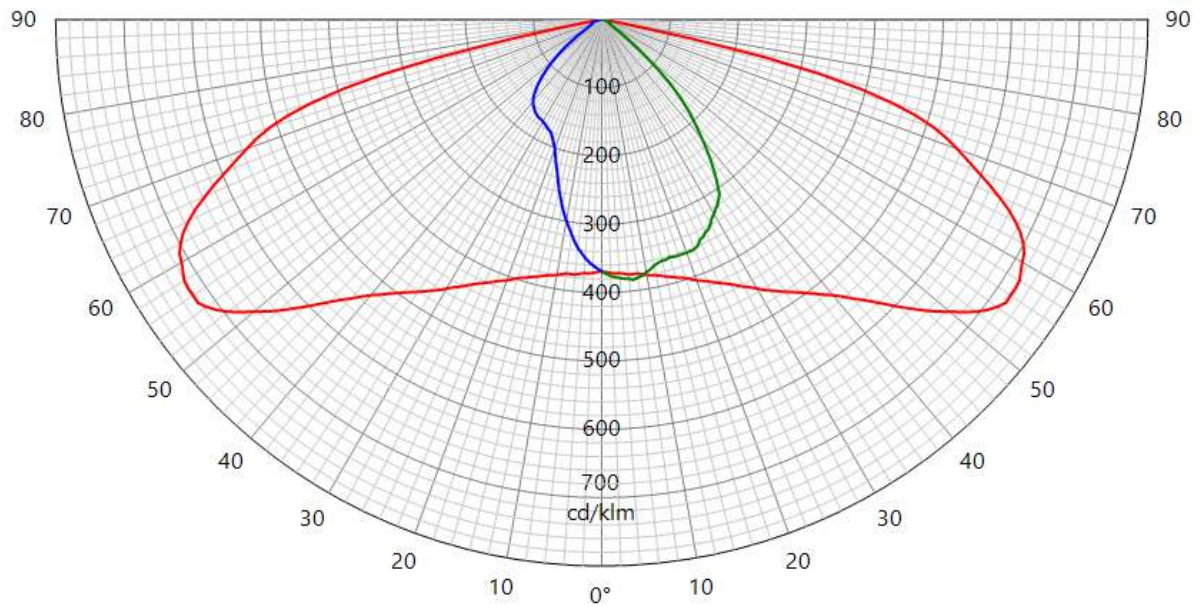


**42572**

### LUMINOUS INTENSITY DIAGRAM

|   |  |   |                                       |                               |                    |                          |             |                             |  |
|---|--|---|---------------------------------------|-------------------------------|--------------------|--------------------------|-------------|-----------------------------|--|
| Origin<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |  | Production<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |                                       | Luminaire<br><b>VOLTANA 0</b> |                    | Inclination<br><b>0°</b> |             | Request #<br><b>FD39022</b> |  |
| Source  | Type<br><b>LED</b>   | BIN<br><b>40-70M-4-TB-RB</b>                            | Trademark<br><b>Samsung</b>           | Reference<br><b>LH351C</b>    | # LEDs<br><b>6</b> | Reflector<br><b>5206</b> |             |                             |  |
| Reflector   | <b>DKI Led assembly Road lighting Injected 0.0°</b>  |   |                                       |                               | <b>No</b>          |                          | <b>5206</b> |                             |  |
| Matrices  | <b>425722</b>  |   | $\eta$ 0-90° = 89.9% - 90-180° = 0.0% |                               |                    | Relative measurement     |             |                             |  |
| Protector Refractor Lens                            | Protector <b>integrated lenses</b><br>Lens <b>6 x DKI 5206 PC</b>  |   |                                       |                               |                    |                          |             |                             |  |
| Observation   | <p>Matrix in efficiency @350 mA</p> <p>Light losses due to thermal stabilisation : 1%</p> <p>Electrical measurement on LED (#1) : Voltage = 16.83 V    Current = 0.350 A    Power = 5.88 W</p> <p>Electrical measurement on driver (#1) : Voltage = 230.00 V    Current = 0.037 A    Power = 7.98 W    PF = 0.936</p> <p><b>Total luminaire power = 7.98 W</b></p> <p>Driver #1 : Philips Xitanium FP 22W 0.3-1.0A SNLDAE 230V S175 sXt S175 sxt PCB 00-71-626 A</p> |   |                                       |                               |                    |                          |             |                             |  |


| Plane    | I Peak | Peak position | Index | I zero | Laboratory ambient t° | Measurement date | ↕ |
|----------|--------|---------------|-------|--------|-----------------------|------------------|---|
| 15 - 165 | 625    | 55            | S     | 319    | 24.9°                 | 07-02-2019       |   |
| 90       | 332    | 7             | D     |        |                       |                  |   |
| 270      | 319    | 0             | G     |        |                       |                  |   |

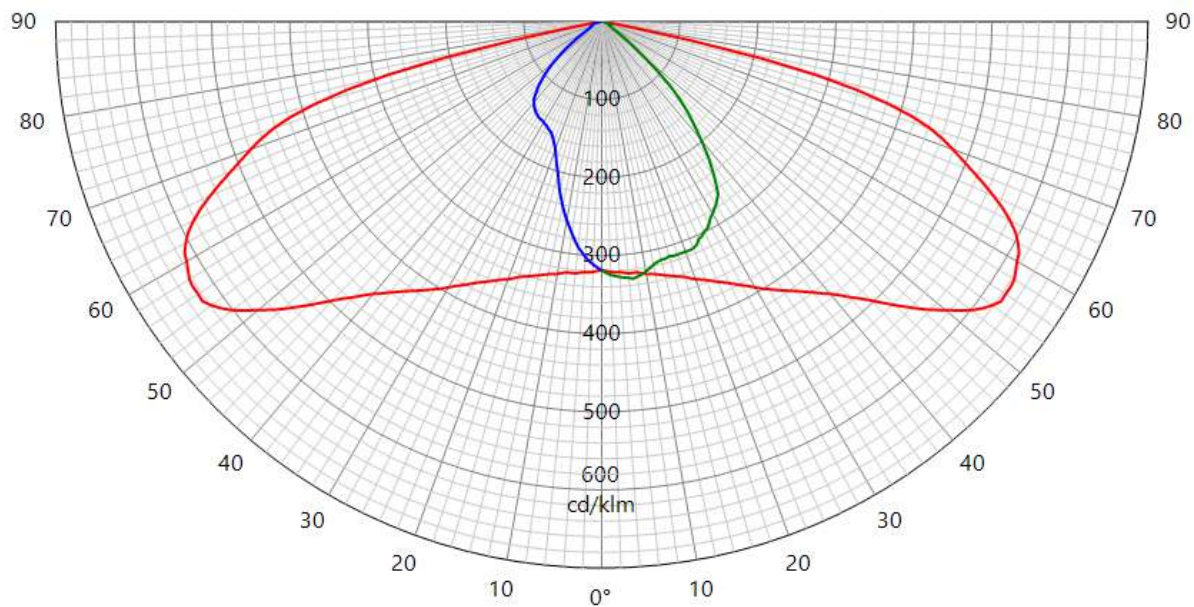

**42572**

### LUMINOUS INTENSITY DIAGRAM

|   |  |   |                                       |                               |                       |                          |  |                             |  |
|---|--|---|---------------------------------------|-------------------------------|-----------------------|--------------------------|--|-----------------------------|--|
| Origin<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |  | Production<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |                                       | Luminaire<br><b>VOLTANA 0</b> |                       | Inclination<br><b>0°</b> |  | Request #<br><b>FD39022</b> |  |
| Source  | Type<br><b>LED</b>   | BIN<br><b>40-70M-4-TB-RB</b>                            | Trademark<br><b>Samsung</b>           | Reference<br><b>LH351C</b>    | # LEDs<br><b>6</b>    | Reflector<br><b>5206</b> |  |                             |  |
| Reflector   | <b>DKI Led assembly Road lighting Injected 0.0°</b>  |   |                                       |                               | No                    | <b>5206</b>              |  |                             |  |
| Matrices  | <b>425723</b>  |   | $\Phi$ 0-90° = 1434lm - 90-180° = 0lm |                               |                       | Absolute measurement     |  |                             |  |
| Protector Refractor Lens                            | Protector <b>integrated lenses</b><br>Lens <b>6 x DKI 5206 PC</b>  |   |                                       |                               |                       |                          |  |                             |  |
| Observation   | <p>Matrix in total flux @500 mA</p> <p>Light losses due to thermal stabilisation : 1.7%</p> <p>Electrical measurement on LED (#1) : Voltage = 17.15 V    Current = 0.500 A    Power = 8.58 W</p> <p>Electrical measurement on driver (#1) : Voltage = 230.00 V    Current = 0.050 A    Power = 10.97 W    PF = 0.962</p> <p><b>Total luminaire power = 10.97 W : Lm/Watt = 130.70 lm/W</b></p> <p>Driver #1 : Philips Xitanium FP 22W 0.3-1.0A SNLDAE 230V S175 sXt S175 sxt PCB 00-71-626 A</p> |   |                                       |                               |                       |                          |  |                             |  |
| Plane   | I Peak   | Peak position   | Index                                 | I zero                        | Laboratory ambient t° | Measurement date         |  | ↕                           |  |
| 15 - 165  | 998  | 57  | S                                     | 511                           | 24.9°                 | 07-02-2019               |  |                             |  |
| 90  | 532  | 7   | D                                     |                               |                       |                          |  |                             |  |
| 270   | 511  | 0   | G                                     |                               |                       |                          |  |                             |  |

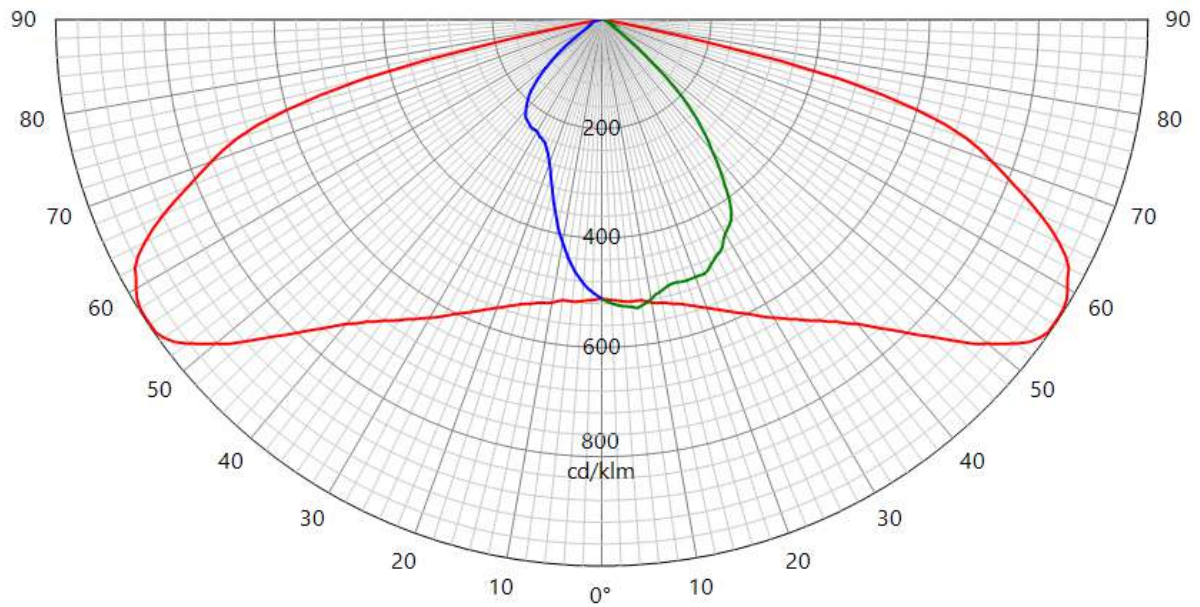


**42572**



### LUMINOUS INTENSITY DIAGRAM

|   |  |   |                                       |                               |                    |                          |  |                             |  |
|---|--|---|---------------------------------------|-------------------------------|--------------------|--------------------------|--|-----------------------------|--|
| Origin<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |  | Production<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |                                       | Luminaire<br><b>VOLTANA 0</b> |                    | Inclination<br><b>0°</b> |  | Request #<br><b>FD39022</b> |  |
| Source  | Type<br><b>LED</b>   | BIN<br><b>40-70M-4-TB-RB</b>                            | Trademark<br><b>Samsung</b>           | Reference<br><b>LH351C</b>    | # LEDs<br><b>6</b> | Reflector<br><b>5206</b> |  |                             |  |
| Reflector   | <b>DKI Led assembly Road lighting Injected 0.0°</b>  |   |                                       |                               | No                 | <b>5206</b>              |  |                             |  |
| Matrices  | <b>425724</b>  |   | $\Phi$ 0-90° = 1919lm - 90-180° = 0lm |                               |                    | Absolute measurement     |  |                             |  |
| Protector Refractor Lens                            | Protector <b>integrated lenses</b><br>Lens <b>6 x DKI 5206 PC</b>  |   |                                       |                               |                    |                          |  |                             |  |
| Observation   | <p>Matrix in total flux @700 mA</p> <p>Light losses due to thermal stabilisation : 2,6 %</p> <p>Electrical measurement on LED (#1) : Voltage = 17.51 V    Current = 0.700 A    Power = 12.27 W</p> <p>Electrical measurement on driver (#1) : Voltage = 230.00 V    Current = 0.067 A    Power = 15.15 W    PF = 0.977</p> <p><b>Total luminaire power = 15.15 W : Lm/Watt = 126.68 lm/W</b></p> <p>Driver #1 : Philips Xitanium FP 22W 0.3-1.0A SNLDAE 230V S175 sXt S175 sxt PCB 00-71-626 A</p> |   |                                       |                               |                    |                          |  |                             |  |

| Plane    | I Peak | Peak position | Index | I zero | Laboratory ambient t° | Measurement date | ↕ |
|----------|--------|---------------|-------|--------|-----------------------|------------------|---|
| 15 - 165 | 1342   | 57            | S     | 686    | 24.9°                 | 07-02-2019       |   |
| 90       | 713    | 6             | D     |        |                       |                  |   |
| 270      | 686    | 0             | G     |        |                       |                  |   |

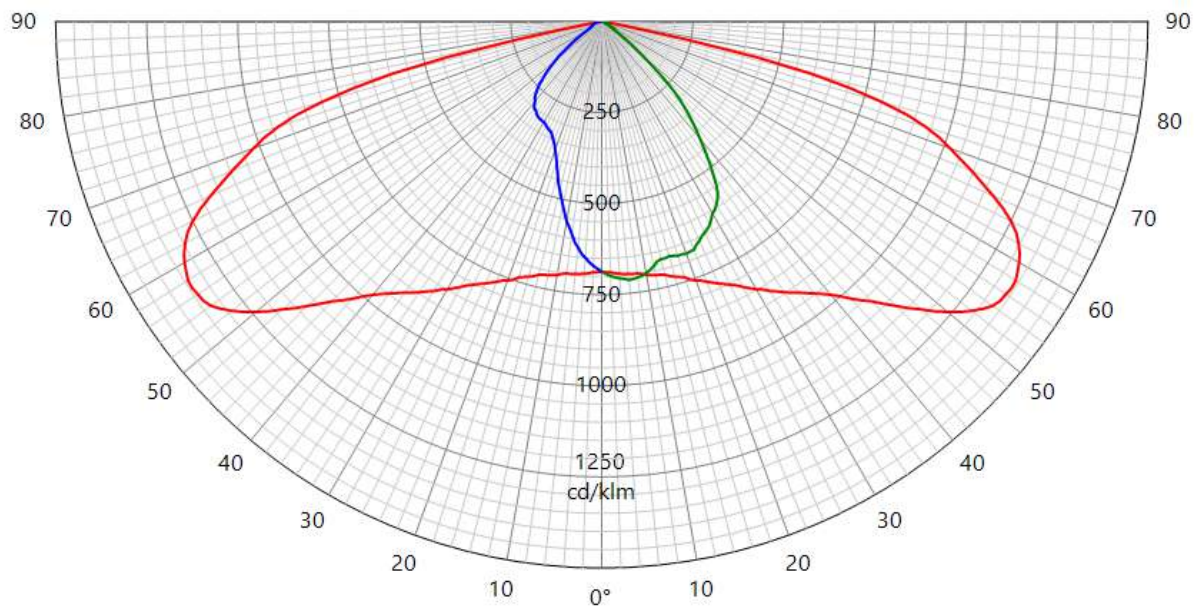


**42572**

### LUMINOUS INTENSITY DIAGRAM

|   |   |   |                                       |                               |                    |                          |  |                             |  |
|---|---|---|---------------------------------------|-------------------------------|--------------------|--------------------------|--|-----------------------------|--|
| Origin<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |   | Production<br><b>TUNGSRAM-Schröder Zrt.<br/>Hungary</b> |                                       | Luminaire<br><b>VOLTANA 0</b> |                    | Inclination<br><b>0°</b> |  | Request #<br><b>FD39022</b> |  |
| Source  | Type<br><b>LED</b>  | BIN<br><b>40-70M-4-TB-RB</b>                            | Trademark<br><b>Samsung</b>           | Reference<br><b>LH351C</b>    | # LEDs<br><b>6</b> | Reflector<br><b>5206</b> |  |                             |  |
| Reflector   | <b>DKI Led assembly Road lighting Injected 0.0°</b>   |   |                                       |                               | No                 | <b>5206</b>              |  |                             |  |
| Matrices  | <b>425725</b>   |   | $\Phi$ 0-90° = 2548lm - 90-180° = 0lm |                               |                    | Absolute measurement     |  |                             |  |
| Protector Refractor Lens                            | Protector <b>integrated lenses</b><br>Lens <b>6 x DKI 5206 PC</b>   |   |                                       |                               |                    |                          |  |                             |  |
| Observation   | <p>Matrix in total flux @1000 mA</p> <p>Light losses due to thermal stabilisation : 3,7 %</p> <p>Electrical measurement on LED (#1) : Voltage = 17.96 V    Current = 1.000 A    Power = 17.96 W</p> <p>Electrical measurement on driver (#1) : Voltage = 230.00 V    Current = 0.096 A    Power = 21.80 W    PF = 0.987</p> <p><b>Total luminaire power = 21.80 W : Lm/Watt = 116.87 lm/W</b></p> <p>Driver #1 : Philips Xitanium FP 22W 0.3-1.0A SNLDAE 230V S175 sXt S175 sxt PCB 00-71-626 A</p> |   |                                       |                               |                    |                          |  |                             |  |

| Plane    | I Peak | Peak position | Index | I zero | Laboratory ambient t° | Measurement date | ↕ |
|----------|--------|---------------|-------|--------|-----------------------|------------------|---|
| 15 - 165 | 1783   | 56            | S     | 914    | 24.9°                 | 07-02-2019       |   |
| 90       | 952    | 7             | D     |        |                       |                  |   |
| 270      | 914    | 0             | G     |        |                       |                  |   |

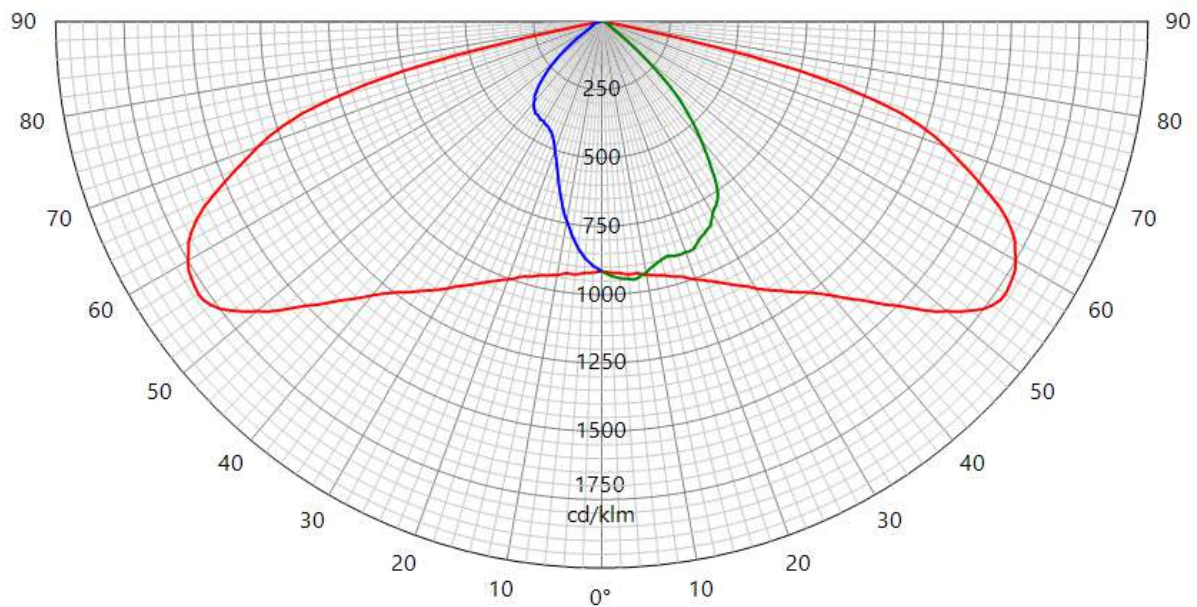

**42572**

## CONFORMITY STATEMENT

### Measurement fulfil Standards:

NBN-EN 13032-1  
NBN-EN 13032-4  
NBN-EN 17025:2005  
CIE 121-1996  
LM79-08  
CIE S 025

### Measurement quantities measured:

Light distribution in relative or absolute photometry  
Led alone cold lumen package  
Led CCT and CRI  
Power consumption of the fitting  
Lm/watt

### Electrical measurement, if not specified:

Primary values are AC with 50Hz frequency  
Secondary values on SSL are DC

CCT, CRI and chromaticity coordinates: are measured in Ulbricht sphere.  
If specified Main test report refer to sphere extra test report.

Light distribution are measured on gonio. If not otherwise specified, measurement is done at 50 Hz

Number of hours operated prior to measurement: if not otherwise specified, 0 hours (no aging).

Stabilization time: If not otherwise specified, a minimal stabilization time of 0.5 hour is applied; and measurement will start when it exists no more variation above 0.5% in 15 minutes

Total operating time of the product including stabilization:  
45 minutes have to be added by measurement.  
Minimal operating time is 75 minutes

Luminous intensity distribution: available on electronic file with  
.mat format (internal Schröder format)  
.ldt format (European standard)  
.IES format (American standard)

Statement of uncertainties (K=2, 95% of confidence level):  
Uncertainties calculated based on a typical Schröder fitting and PCBA

Intensity measurement: +/- 3%  
Angle: +/- 0.5°  
Flux: +/- 2.5%  
Electrical DC  
Power: +/- 0.25%  
Voltage: +/- 0.15%  
Current: +/- 0.15%  
Electrical AC  
Power: +/- 0.15%  
Voltage: +/- 0.3%  
Current: +/- 0.3%  
Temperature: +/- 0.65%

| ISP2000 | JETI   |          |
|---------|--------|----------|
| CCT:    | +/- 5% | +/-7.5%  |
| CRI:    | +/- 2% | +/-2.75% |
| x/y:    | +/- 2% | +/-4.6%  |

lm/Watt: +/-3.5%

Measuring instruments in use:

#### Gonio 1

Type C with Moving mirror

Manufacturer: LMT Lichtmesstechnik GmbH Berlin, Helmholtzstrasse 9 10587 Berlin, Germany

Type: GO-DS 2000

Calibration: traceable to PTB (Physikalisch-Technische Bundesanstalt D-Braunschweig) and METAS (Federal Institute of Metrology, CH-Bern)

Photometric test distance: By default 10 meter, on request 30 meter.

#### Gonio 2

Type C

Manufacturer: Technoteam Bildverarbeitung, Werner-von-Siemens-Strasse 5 98693 Ilmenau, Germany

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

Photometric test distance: Near Field

#### Sphere n°1

4p geometry

Manufacturer: LMT Lichtmesstechnik GmbH, Helmholtzstrasse 9 10587 Berlin, Germany

Type: UL2000 + U1000 V-Lambda photometer

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

#### Sphere n°2

4p geometry

Manufacturer: Instrument Systems GmbH, Neumarkter Str. 83, 81673 Muenchen, Germany

Type ISP2000 + Spectroradiometer CAS120 and CAS140

Calibration: traceable to NIST

#### Colorimetric portable spectroradiometer

Manufacturer: JETI Technische Instrumente GmbH, Tatzendpromenade 2 07745 Jena

Type: SPECBOS 1201

Calibration: traceable to NIST

#### Multimeters

Manufacturer: Agilent

Type: 34401A

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

#### Wattmeters

Manufacturer: Yokogawa

Type: WT210 and WT310

Calibration: traceable to BIPM (Bureau International des Poids et Mesures F-Sèvres)

#### Thermometers

Amarell Precision


Type: Liquid in glass N63833

Calibration: traceable to LBT (Laboratoire Belge de Thermométrie)

# Schröder

## VOLTANA 0

### Installation instructions

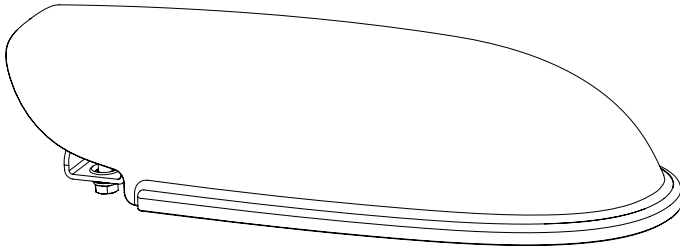

4-8m

350-1250mA  
8-38W









220-240V  
50/60Hz

**IP**






**66**

**IK**


**08**

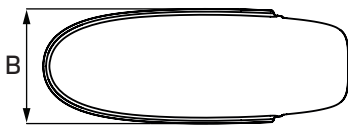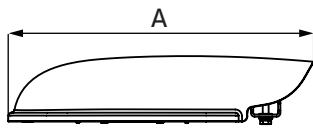




| Voltana0 |                     |
|----------|---------------------|
| A        | 416mm               |
| B        | 156mm               |
| C        | 91mm                |
|          | 2.6kg               |
| CxS      | 0.012m <sup>2</sup> |

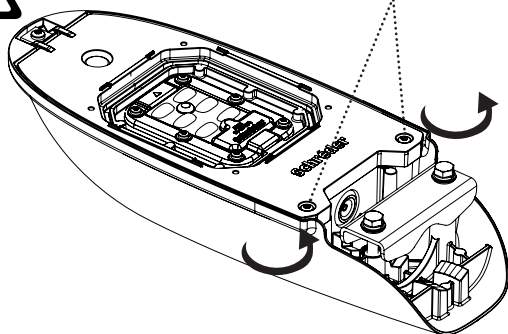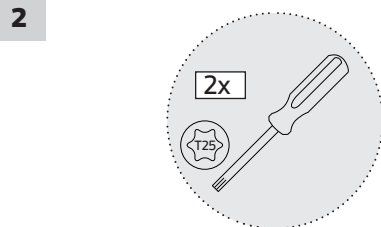


3

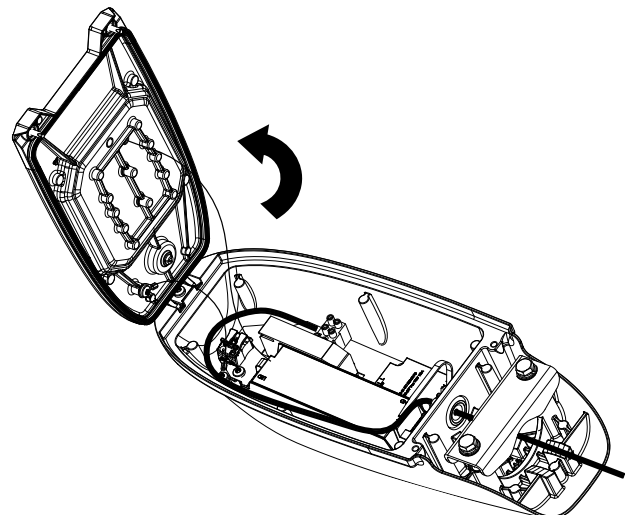


4a

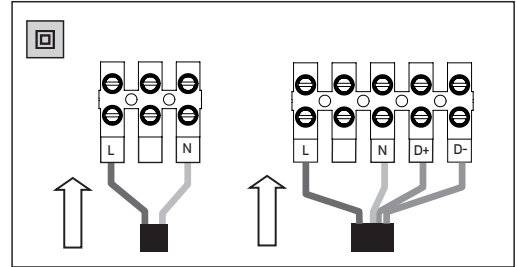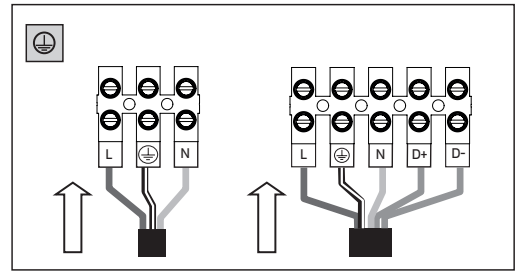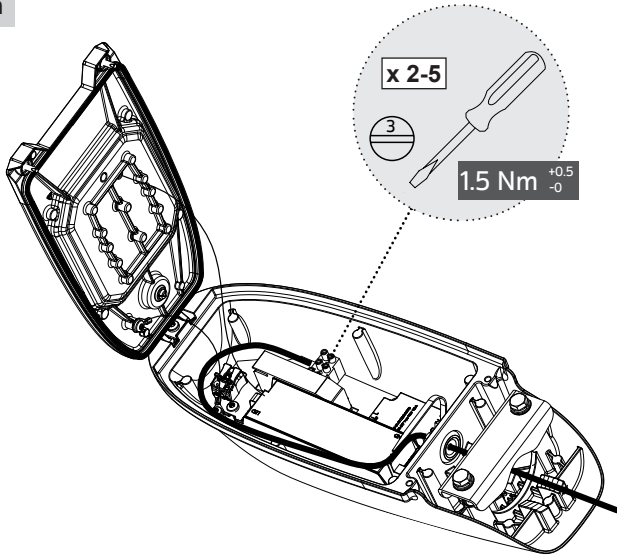




4b

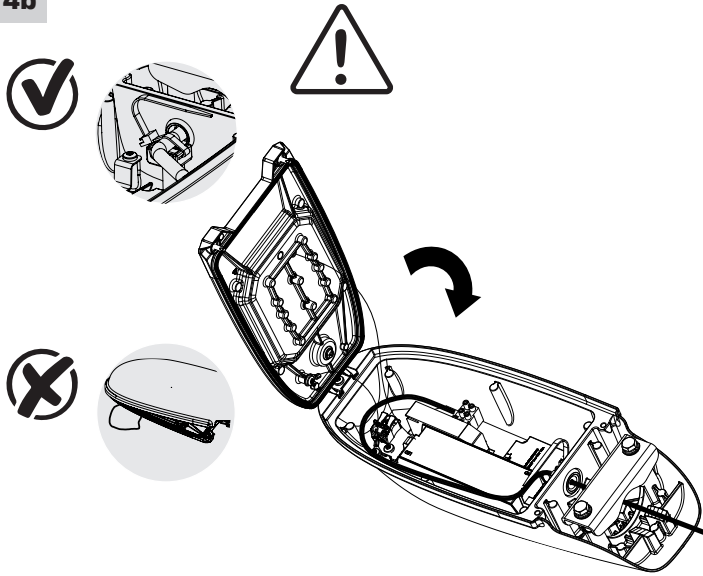

4c


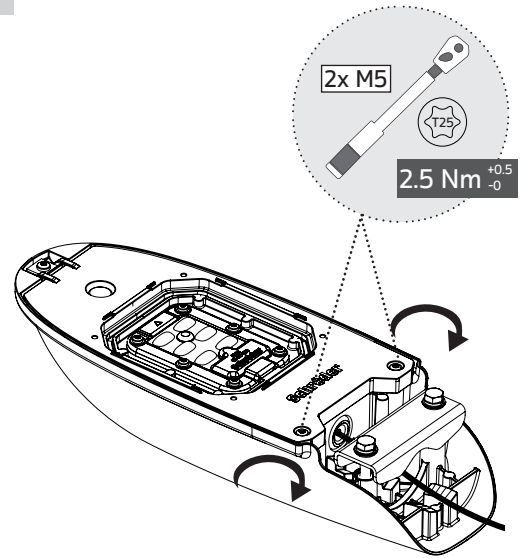


5

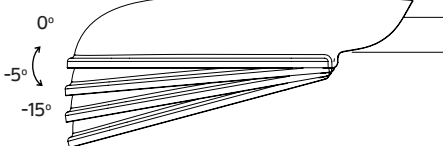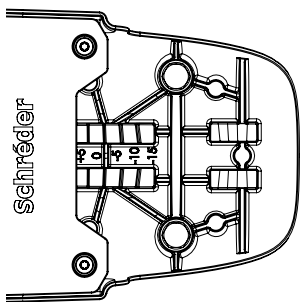

2x M8 x 70  
2x M8 x 45

|      | Ø42     | Ø48     | Ø60 |
|------|---------|---------|-----|
| -10° | M8 x 45 | M8 x 70 |     |
| -5°  |         |         |     |
| 0°   |         |         |     |
| +5°  |         |         |     |

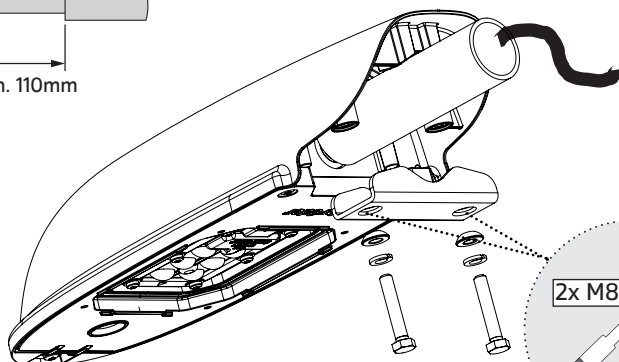



# Lumen maintenance report

## LED information


|                    |                              |
|--------------------|------------------------------|
| <b>LED type</b>    | LH351C                       |
| <b>LED current</b> | 1000 mA                      |
| <b>Ts</b>          | 55°C                         |
| <b>Description</b> | SLED-17-017 ISSUE Revision 1 |

## Projection data

|                                 |                  |                            |            |
|---------------------------------|------------------|----------------------------|------------|
| <b>Test duration</b>            | 10000 hrs        | <b><math>\alpha</math></b> | 1.112E-006 |
| <b>Time used for projection</b> | 5000 to 10000hrs | <b><math>\beta</math></b>  | 0.984      |

| L (%) | Time (kHrs) |
|-------|-------------|
| 78.8  | 200         |
| 80.0  | 186         |
| 88.1  | 100         |
| 90.0  | 80          |

## Projection graphic

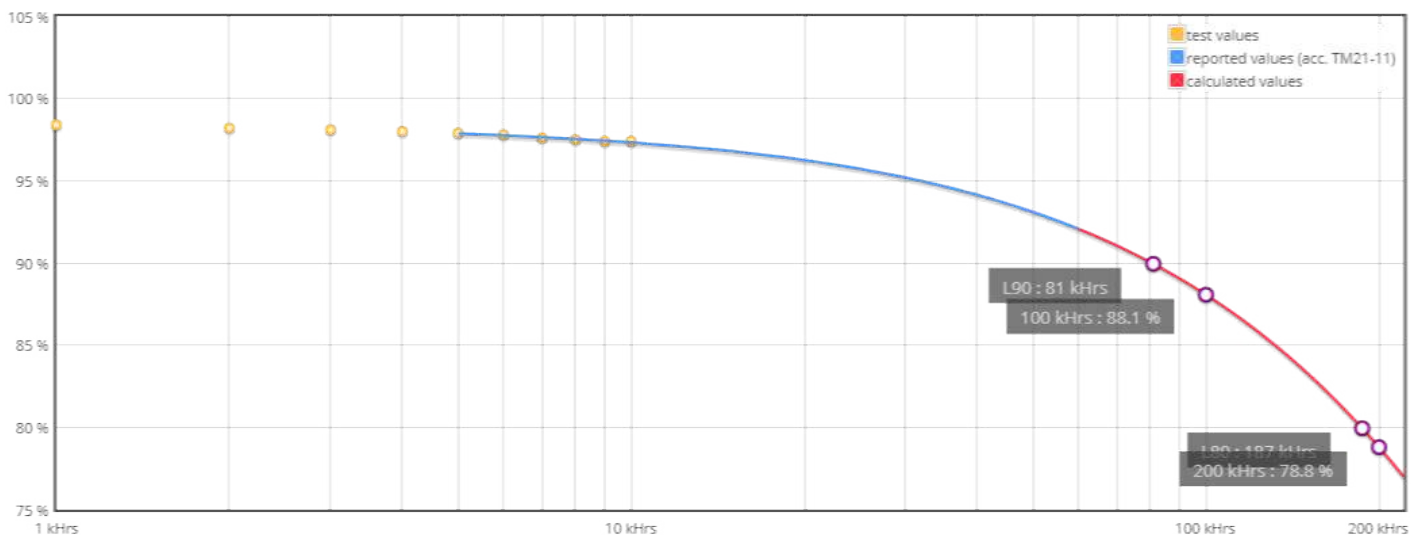

LxB50 results according to LM-80 and TM-21-11 procedures and norms.

LxBy results derived from LxB50 according to IEC 62717 Annex C.




# LICENCE

No. 20254 replaces No.20142

Issued to:  
Applicant:  
R-Tech  
Rue de Mons, 3  
4000 LIEGE  
Belgium



Licensee:  
Schreder S.A.  
Rue de Lusambo, 67  
1190 BRUXELLES  
Belgium

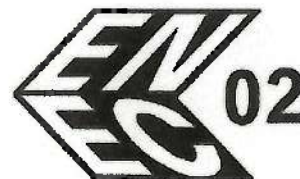

Product : road, square, street, flood lighting  
Trade name(s) : SCHREDER  
Type(s)/model(s) : VOLTANA0 6 LED xx, VOLTANA0 8 LED xx

The product and any acceptable variation thereto is specified in the annex to this licence and the documents therein referred to.

SGS CEBEC hereby declares that the above-mentioned product has been certified on the basis of:

- a type test according to the standard specified in annex
- an inspection of the production location.
- a certification agreement with the number 1173


SGS CEBEC hereby grants the right to use the CEBEC certification mark

The ENEC/CEBEC certification mark may be applied to the product as specified in this licence for the duration of the ENEC/CEBEC certification agreement and under the conditions of the ENEC/CEBEC certification agreement.

This licence is issued on: 15/03/2017

ir. C. Lana,  
Certification Manager

© Only integral publication of this certificate, including the annex, is allowed  
This certificate is only valid combined with the publication on the following web address: [www.sgs.com/ee](http://www.sgs.com/ee)

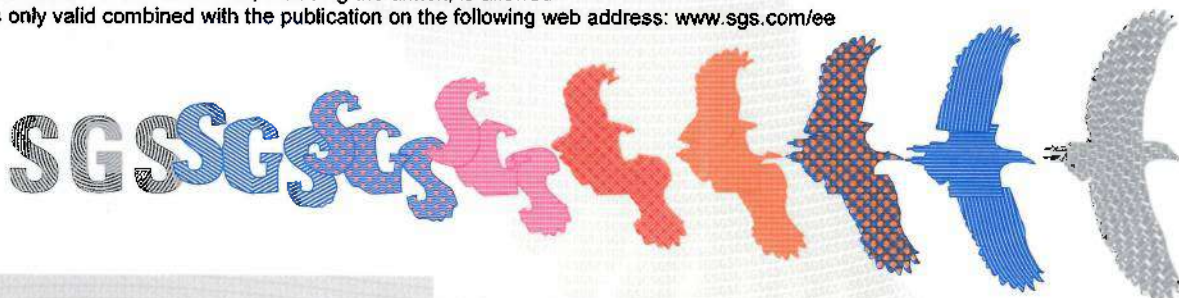

## SPECIFICATION OF THE CERTIFIED PRODUCT

### Product data

|                               |   |                                      |
|-------------------------------|---|--------------------------------------|
| Product                       | : | road, square, street, flood lighting |
| Trade name(s)                 | : | SCHREDER                             |
| Type(s)/Model(s)              | : | VOLTANA0 6 LED xx, VOLTANA0 8 LED xx |
| description                   | : | Street lighting                      |
| rated voltage (Un)            | : | 200-240 V                            |
| rated frequency               | : | 50-60 Hz                             |
| class                         | : | class I                              |
| degree of protection          | : | IP66                                 |
| additional information        | : | IK08                                 |
| rated output current (In out) | : | max. 1050 mA                         |

### Additional information

xx = Color Temperature can be :  
 NW neutral white  
 CW cool white  
 WW warm white

### Product data - type VOLTANA0 6 LED xx

|                   |   |              |
|-------------------|---|--------------|
| rated power       | : | 8-10-15-23 W |
| lamp(s)           | : | 6 LED        |
| temperature class | : | Ta max.50°C  |

### Product data - type VOLTANA0 8 LED xx

|                   |   |               |
|-------------------|---|---------------|
| rated power       | : | 11-14-20-31 W |
| lamp(s)           | : | 8 LED         |
| temperature class | : | Ta max. 40°C  |

## TESTS

### Test requirements

EN 60598-1:2015  
 EN 60598-2-3:2003 + A1:2011

**Test results**

The test results are laid down in test report(s) ref. P-1560-1a

**Remarks**

This certificate is based on test reports Nos. P1560-1a


**Conclusion**

The examination proved that all test requirements were met.

Checked by, project leader : Christian Maes - 15/03/2017

Department Manager,  
Product Certification :

Certification Manager :

 2017-03-15

**FACTORY LOCATION(S)**

Schröder do Brasil Iluminação Ltda.  
Rua Iracema Lucas, 415  
Distrito Industrial Vinhedo  
13280-000 SAO PAULO  
Brazil

Schreder TOV  
Vul. Mykulynetska 46B  
46000 TERNOPIIL  
Ukraine

Schreder (China) Lighting Industrial Co., Ltd  
No.40 Xinye 2 Street, Tianjin Economic Technological Development Zone West Zone,  
300462 Tianjin City, P.R.China  
China

Socelec S.A.  
Av. de Roanne, 66  
Poligono Industrial "EL HENARES"  
19180 MARCHAMALO (GUADALAJARA)  
Spain

Schröder Iluminação S.A.  
Rua da Fraternidade Operária, nº 3  
2795-491 CARNAXIDE, OEIRAS  
Portugal

Comatelec S.A.  
Z.I.  
18400 SAINT FLORENT S/CHER  
France

Tungsram-Schröder Világítási Berendezések Zrt  
Tópart 2  
2084 PILISSZENTIVAN  
Hungary



Test Report issued under the responsibility of:



**TEST REPORT**  
**IEC 60598-2-3**  
**Luminaires**  
**Part 2: Particular requirements**  
**Section 3: Luminaires for road and street lighting**

Report Number.....: P1560-1a  
 Date of issue .....: 2017-03-03  
 Total number of pages..... 45+2

Name of Testing Laboratory preparing the Report.....: R-TECH

Applicant's name.....: R-TECH  
 Address.....: Rue de Mons, 3,B-4000 LIEGE

**Test specification:**

Standard.....: IEC 60598-2-3:2002 (Third Edition) + A1:2011 used in conjunction with IEC 60598-1:2014 (Eighth Edition)  
 Test procedure .....: CB Scheme  
 Non-standard test method.....: N/A

Test Report Form No. ....: IEC60598\_2\_3J  
 Test Report Form(s) Originator ....: Intertek Semko AB  
 Master TRF.....: 2014-09

**Copyright © 2014 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.**

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.




**This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.**

**General disclaimer:**

The test results presented in this report relate only to the object tested.  
This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.



|                                    |  |
|------------------------------------|--|
| <b>Test item description</b> ..... | Street lighting  |
| <b>Trade Mark</b> .....            | SCHREDER   |
| <b>Manufacturer</b> .....          | SCHREDER   |
| <b>Model/Type reference</b> .....  | VOLTANA 0  |
| <b>Ratings</b> .....               | 120-240 V, 50-60 Hz, Cl. I , IP66, LED, IK08 (glass), IK08 (lenses).<br>Version with 6 & 8 led's ; Max. 23 & max.31 W.<br>Led: Max 1050 mA |


|   |   |   |
|---|---|---|
| <b>Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):</b> |   |   |
| <input type="checkbox"/>  | <b>CB Testing Laboratory:</b>                       |   |
| Testing location/ address .....   |   |   |
| <input type="checkbox"/>  | <b>Associated CB Testing Laboratory:</b>            |   |
| Testing location/ address .....   |   |   |
| Tested by (name, function, signature) .....   |   |   |
| Approved by (name, function, signature)...  |   |   |
| <input type="checkbox"/>  | <b>Testing procedure: TMP/CTF Stage 1:</b>          |   |
| Testing location/ address .....   |   |   |
| Tested by (name, function, signature) .....   |   |   |
| Approved by (name, function, signature)...  |   |   |
| <input type="checkbox"/>  | <b>Testing procedure: WMT/CTF Stage 2:</b>          |   |
| Testing location/ address .....   |   |   |
| Tested by (name + signature) .....  |   |   |
| Witnessed by (name, function, signature) . :  |   |   |
| Approved by (name, function, signature)...  |   |   |
| <input checked="" type="checkbox"/>   | <b>Testing procedure:<br/>SMT/CTF Stage 3 or 4:</b> | R-Tech  |
| Testing location/ address .....   |   | Rue de Mons, 3,B-4000 LIEGE   |
| Tested by (name, function, signature) .....   |   | Laurent Maghe      |
| Witnessed by (name, function, signature) . :  |   | Christian Maes     |
| Approved by (name, function, signature)...  |   | Cheuvart Geoffrey  |
| Supervised by (name, function, signature) :   |   |   |

|  |   |
|--|---|
| <p><b>List of Attachments (including a total number of pages in each attachment):</b></p> <p>EU deviations</p> <p>Picture s</p> <p>Instructions</p>  |   |
| <p><b>Summary of testing: full test</b></p>  |   |
| <p><b>Tests performed (name of test and test clause):</b></p> <p>IEC 60598-2-3:2002 (Third Edition) + A1:2011 used in conjunction with IEC 60598-1:2014 (Eighth Edition)</p>   | <p><b>Testing location:</b></p> <p>R-tech sa<br/>Rue de Mons, 3<br/>B-4000 LIEGE<br/>Belgium.</p> |
| <p><b>Summary of compliance with National Differences: Europe</b></p> <p><b>List of countries addressed</b></p> <p><input checked="" type="checkbox"/> <b>The product fulfils the requirements of</b></p> <p>IEC 60598-2-3: 2002 (third Edition) + A1:2011 used in conjunction with IEC 60598-1: 2014 (Eighth Edition).<br/>EN 60598-2-3: 2003 + A1:2011 used in conjunction with EN 60598-1:2014.</p> |   |



**Copy of marking plate:**

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBS that own these marks.

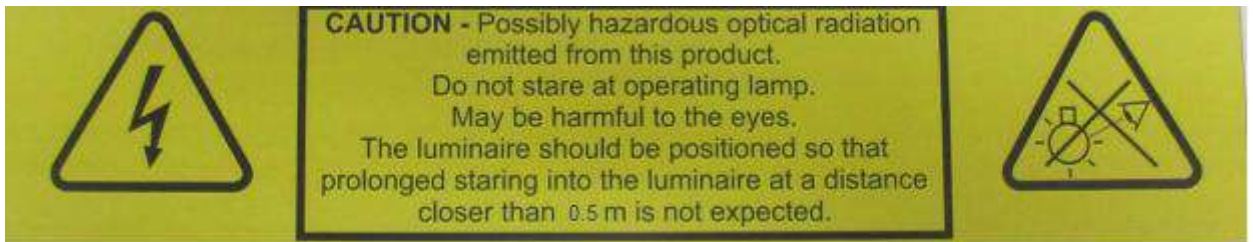

|  |  |
|--|--|
| <b>Test item particulars</b> ..... :   |  |
| <b>Classification of installation and use</b> ..... : Class I  |  |
| <b>Supply Connection</b> ..... : Connector   |  |
| ..... :  |  |
| <b>Possible test case verdicts:</b>  |  |
| - test case does not apply to the test object.....: N/A  |  |
| - test object does meet the requirement.....: P (Pass)   |  |
| - test object does not meet the requirement.....: F (Fail)   |  |
| <b>Testing</b> .....   |  |
| <b>Date of receipt of test item</b> .....: October 2016  |  |
| <b>Date (s) of performance of tests</b> .....: February 2017   |  |
| <b>General remarks:</b>  |  |
| "(See Enclosure #)" refers to additional information appended to the report.<br>"(See appended table)" refers to a table appended to the report.   |  |
| Throughout this report a <input type="checkbox"/> comma / <input type="checkbox"/> point is used as the decimal separator.   |  |
| <b>Manufacturer's Declaration per sub-clause 4.2.5 of IEC60598-2:</b>  |  |
| The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided..... : | <input checked="" type="checkbox"/> <b>Yes</b><br><input type="checkbox"/> <b>Not applicable</b>   |
| <b>When differences exist; they shall be identified in the General product information section.</b>  |  |
| <b>Name and address of factory (ie s) .....</b> :  |  |
| Comatelec S.A.<br>Z.I.<br>F-18400 SAINT FLORENT S/CHER<br>France   | Socelec S.A.<br>Av. de Roanne, 66<br>Poligono Industrial "EL HENARES"<br>19180 MARCHAMALO (GUADALAJARA),Spain  |
| Schröder Iluminação S.A.<br>Apartado, 132<br>2790-076 CARNAXIDE,Portugal   | Schröder do Brasil Iluminação Ltda.<br>Rua Iracema Lucas, 415<br>Distrito Industrial Vinhedo<br>13280-000 SAO PAULO,Brazil   |
| Schreder TOV<br>Vul. Mykulynetska 46B<br>46000 TERNOPIIL,Ukraine   | Schreder (China) Lighting Industrial Co., Ltd<br>No.40 Xinye 2 Street, Tianjin Economic Technological<br>Development Zone West Zone,<br>300462 Tianjin City, P.R.China,China |
| Tungsram-Schröder Világítási Berendezések Zrt<br>Tópart 2<br>2084 PILISSZENTIVAN,Hungary   |  |

**General product information:**

Ta following Leds current :

| LED Count | Current (mA) | Power (W) | Ta (°C) | Ta with EMI filter(°C) |
|-----------|--------------|-----------|---------|------------------------|
| 6         | 350          | 8         | 50      | 35                     |
|           | 500          | 10        | 50      | 30                     |
|           | 700          | 15        | 50      | 30                     |
|           | 1050         | 23        | 35      | 20                     |
| 8         | 350          | 11        | 40      | /                      |
|           | 500          | 14        | 40      | /                      |
|           | 700          | 20        | 40      | /                      |
|           | 1050         | 31        | 30      | /                      |

Color Temperature can be :

NW neutral white

CW cool white

WW warm white

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| 3.2 (0)   | GENERAL TEST REQUIREMENTS                         |   | P |
|-----------|---|---|---|
| 3.2 (0.1) | Information for luminaire design considered ..... | Standard<br>Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
| 3.2 (0.3) | More sections applicable .....                    | Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>             | — |

| 3.4 (2)   | CLASSIFICATION  |   | P |
|-----------|---|---|---|
| 3.4 (2.2) | Type of protection .....  | Class I   | — |
| 3.4 (2.3) | Degree of protection .....  | IP 66   | — |
| 3.4 (2.4) | Luminaire suitable for direct mounting on normally flammable surfaces ..... | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
| 3.4 (2.5) | Luminaire for normal use .....  | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
|           | Luminaire for rough service .....   | Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> | — |
| 3.4 (-)   | Modes of installation of road or street lighting                            |   | — |
|           | a) on a pipe  | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
|           | b) on a mast arm  | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
|           | c) on a post top  | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | — |
|           | d) on span or suspension wires  | Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> | — |
|           | e) on a wall  | Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> | — |

| 3.5 (3)     | MARKING                               |          |     |
|-------------|---------------------------------------|----------|-----|
| 3.5 (3.2)   | Mandatory markings                    |          | P   |
|             | Position of the marking               |          | P   |
|             | Format of symbols/text                |          | P   |
| 3.5 (3.3)   | Additional information                |          | P   |
|             | Language of instructions              |          | P   |
| 3.5 (3.3.1) | Combination luminaires                |          | N/A |
| 3.5 (3.3.2) | Nominal frequency in Hz               | 50-60 Hz | P   |
| 3.5 (3.3.3) | Operating temperature                 |          | N/A |
| 3.5 (3.3.4) | Symbol or warning notice              |          | N/A |
| 3.5 (3.3.5) | Wiring diagram                        |          | N/A |
| 3.5 (3.3.6) | Special conditions                    |          | N/A |
| 3.5 (3.3.7) | Metal halide lamp luminaire – warning |          | N/A |
| 3.5 (3.3.8) | Limitation for semi-luminaires        |          | N/A |
| 3.5 (3.3.9) | Power factor and supply current       | 0.91     | P   |

| IEC 60598-2-3 |   |                                  |         |
|---------------|---|----------------------------------|---------|
| Clause        | Requirement + Test  | Result - Remark                  | Verdict |
| 3.5 (3.3.10)  | Suitability for use indoors   |                                  | N/A     |
| 3.5 (3.3.11)  | Luminaires with remote control  |                                  | N/A     |
| 3.5 (3.3.12)  | Clip-mounted luminaire – warning  |                                  | N/A     |
| 3.5 (3.3.13)  | Specifications of protective shields  |                                  | N/A     |
| 3.5 (3.3.14)  | Symbol for nature of supply   |                                  | N/A     |
| 3.5 (3.3.15)  | Rated current of socket outlet  |                                  | N/A     |
| 3.5 (3.3.16)  | Rough service luminaire   |                                  | N/A     |
| 3.5 (3.3.17)  | Mounting instruction for type Y, type Z and some type X attachments         |                                  | P       |
| 3.5 (3.3.18)  | Non-ordinary luminaires with PVC cable                                      |                                  | N/A     |
| 3.5 (3.3.19)  | Protective conductor current in instruction if applicable                   |                                  | N/A     |
| 3.5 (3.3.20)  | Provided with information if not intended to be mounted within arm's reach  |                                  | N/A     |
| 3.5 (3.3.21)  | Non-replaceable and non-user replaceable light sources information provided |                                  | P       |
|               | Cautionary symbol   |                                  | P       |
| 3.5 (3.3.22)  | Controllable luminaires, classification of insulation provided              |                                  | N/A     |
| 3.5 (3.4)     | Test with water   |                                  | P       |
|               | Test with hexane  |                                  | P       |
|               | Legible after test  |                                  | P       |
|               | Label attached  |                                  | P       |
| 3.5 (-)       | Additional information in instruction leaflet                               |                                  |         |
|               | a) Design attitude  | See attached Installation Notice | P       |
|               | b) Weight   | See attached Installation Notice | P       |
|               | c) Overall dimensions   | See attached Installation Notice | P       |
|               | d) Maximum projected area if applicable                                     | See attached Installation Notice | P       |
|               | e) Cross-sectional area of wires if applicable                              |                                  | N/A     |
|               | f) Suitability for indoors use  |                                  | N/A     |
|               | g) Dimensions of the compartment  |                                  | N/A     |
|               | h) Torque setting to be applied to bolts or screws                          | See attached Installation Notice | P       |
|               | i) Maximum mounting height  | >6 m                             | P       |

| <b>IEC 60598-2-3</b> |  |                                  |         |
|----------------------|--|----------------------------------|---------|
| Clause               | Requirement + Test   | Result - Remark                  | Verdict |
| <b>3.6 (4)</b>       | <b>CONSTRUCTION</b>  |                                  |         |
| 3.6 (4.2)            | Components replaceable without difficulty  |                                  | N/A     |
| 3.6 (4.3)            | Wireways smooth and free from sharp edges  |                                  | P       |
| <b>3.6 (4.4)</b>     | <b>Lampholders</b>   |                                  |         |
| 3.6 (4.4.1)          | Integral lampholder  |                                  | N/A     |
| 3.6 (4.4.2)          | Wiring connection  |                                  | N/A     |
| 3.6 (4.4.3)          | Lampholder for end-to-end mounting   |                                  | N/A     |
| 3.6 (4.4.4)          | Positioning  |                                  | N/A     |
|                      | - pressure test (N) .....  |                                  | —       |
|                      | After test the lampholder comply with relevant standard sheets and show no damage  |                                  | N/A     |
|                      | After test on single-capped lampholder the lampholder have not moved from its position and show no permanent deformation |                                  | N/A     |
|                      | - bending test (N) .....   |                                  | —       |
|                      | After test the lampholder have not moved from its position and show no permanent deformation                             |                                  | N/A     |
| 3.6 (4.4.5)          | Peak pulse voltage   |                                  | N/A     |
| 3.6 (4.4.6)          | Centre contact   |                                  | N/A     |
| 3.6 (4.4.7)          | Parts in rough service luminaires resistant to tracking  |                                  | N/A     |
| 3.6 (4.4.8)          | Lamp connectors  |                                  | N/A     |
| 3.6 (4.4.9)          | Caps and bases correctly used  |                                  | N/A     |
| 3.6 (4.4.10)         | Light source for lampholder or connection according IEC 60061 not connected another way                                  |                                  | N/A     |
| <b>3.6 (4.5)</b>     | <b>Starter holders</b>   |                                  |         |
|                      | Starter holder in luminaires other than class II   |                                  | N/A     |
|                      | Starter holder class II construction   |                                  | N/A     |
| <b>3.6 (4.6)</b>     | <b>Terminal blocks</b>   |                                  |         |
|                      | Tails  | Provided with internal connector | N/A     |
|                      | Unsecured blocks   | Fixed                            | N/A     |
| <b>3.6 (4.7)</b>     | <b>Terminals and supply connections</b>  |                                  |         |
| 3.6 (4.7.1)          | Contact to metal parts   |                                  | P       |
| 3.6 (4.7.2)          | Test 8 mm live conductor   |                                  | P       |
|                      | Test 8 mm earth conductor  |                                  | P       |
| 3.6 (4.7.3)          | Terminals for supply conductors  |                                  | P       |

| <b>IEC 60598-2-3</b> |  |                 |         |
|----------------------|--|-----------------|---------|
| Clause               | Requirement + Test   | Result - Remark | Verdict |
| 3.6 (4.7.3.1)        | Welded method and material   |                 |         |
|                      | - stranded or solid conductor  |                 | N/A     |
|                      | - spot welding   |                 | N/A     |
|                      | - welding between wires  |                 | N/A     |
|                      | - Type Z attachment  |                 | N/A     |
|                      | - mechanical test according to 15.8.2  |                 | N/A     |
|                      | - electrical test according to 15.9  |                 | N/A     |
|                      | - heat test according to 15.9.2.3 and 15.9.2.4                                     |                 | N/A     |
| 3.6 (4.7.4)          | Terminals other than supply connection   |                 | N/A     |
| 3.6 (4.7.5)          | Heat-resistant wiring/sleeves  |                 | N/A     |
| 3.6 (4.7.6)          | Multi-pole plug  |                 | N/A     |
|                      | - test at 30 N   |                 | N/A     |
| <b>3.6 (4.8)</b>     | <b>Switches</b>  |                 |         |
|                      | - adequate rating  |                 | N/A     |
|                      | - adequate fixing  |                 | N/A     |
|                      | - polarized supply   |                 | N/A     |
|                      | - compliance with IEC 61058-1 for electronic switches                              |                 | N/A     |
| <b>3.6 (4.9)</b>     | <b>Insulating lining and sleeves</b>   |                 |         |
| 3.6 (4.9.1)          | Retainment   |                 | N/A     |
|                      | Method of fixing .....   |                 | —       |
| 3.6 (4.9.2)          | Insulated linings and sleeves:   |                 |         |
|                      | Resistant to a temperature > 20 °C to the wire temperature or                      |                 | N/A     |
|                      | a) & c) Insulation resistance and electric strength                                |                 | N/A     |
|                      | b) Ageing test. Temperature (°C) .....   |                 | N/A     |
| <b>3.6 (4.10)</b>    | <b>Double or reinforced insulation</b>   |                 |         |
| 3.6 (4.10.1)         | No contact, mounting surface – accessible metal parts – wiring of basic insulation |                 | N/A     |
|                      | Safe installation fixed luminaires   |                 | N/A     |
|                      | Capacitors and switches  |                 | N/A     |
|                      | Interference suppression capacitors according to IEC 60384-14                      |                 | N/A     |
| 3.6 (4.10.2)         | Assembly gaps:   |                 |         |
|                      | - not coincidental   |                 | N/A     |

| IEC 60598-2-3     |  |                               |         |
|-------------------|--|-------------------------------|---------|
| Clause            | Requirement + Test                                       | Result - Remark               | Verdict |
|                   | - no straight access with test probe                     |                               | N/A     |
| 3.6 (4.10.3)      | Retention of insulation:                                 |                               |         |
|                   | - fixed  |                               | N/A     |
|                   | - unable to be replaced; luminaire inoperative           |                               | N/A     |
|                   | - sleeves retained in position                           |                               | N/A     |
|                   | - lining in lampholder                                   |                               | N/A     |
| <b>3.6 (4.11)</b> | <b>Electrical connections and current-carrying parts</b> |                               |         |
| 3.6 (4.11.1)      | Contact pressure   |                               | P       |
| 3.6 (4.11.2)      | Screws:  |                               |         |
|                   | - self-tapping screws                                    |                               | N/A     |
|                   | - thread-cutting screws                                  |                               | N/A     |
| 3.6 (4.11.3)      | Screw locking:   |                               |         |
|                   | - spring washer  |                               | P       |
|                   | - rivets   |                               | N/A     |
| 3.6 (4.11.4)      | Material of current-carrying parts                       |                               | P       |
| 3.6 (4.11.5)      | No contact to wood or mounting surface                   |                               | P       |
| 3.6 (4.11.6)      | Electro-mechanical contact systems                       |                               | N/A     |
| <b>3.6 (4.12)</b> | <b>Screws and connections (mechanical) and glands</b>    |                               |         |
| 3.6 (4.12.1)      | Screws not made of soft metal                            |                               | P       |
|                   | Screws of insulating material                            |                               | N/A     |
|                   | Torque test: torque (Nm); part .....                     | 2Nm (case)                    | P       |
|                   | Torque test: torque (Nm); part .....                     | 1.2Nm (drivers)               | N/A     |
|                   | Torque test: torque (Nm); part .....                     | 1.2Nm (glass)                 | N/A     |
| 3.6 (4.12.2)      | Screws with diameter < 3 mm screwed into metal           |                               | N/A     |
| 3.6 (4.12.4)      | Locked connections:                                      |                               |         |
|                   | - fixed arms; torque (Nm) .....                          |                               | P       |
|                   | - lampholder; torque (Nm) .....                          |                               | N/A     |
|                   | - push-button switches; torque 0,8 Nm .....              |                               | N/A     |
| 3.6 (4.12.5)      | Screwed glands; force (Nm) .....                         |                               | P       |
| <b>3.6 (4.13)</b> | <b>Mechanical strength</b>                               |                               |         |
| 3.6 (4.13.1)      | Impact tests:  |                               | P       |
|                   | - fragile parts; energy (Nm) .....                       | IK08 (glass)<br>IK08 (lenses) | P       |
|                   | - other parts; energy (Nm) .....                         |                               | P       |
|                   | 1) live parts  |                               | P       |



| IEC 60598-2-3     |   |                 |         |
|-------------------|---|-----------------|---------|
| Clause            | Requirement + Test  | Result - Remark | Verdict |
|                   | 2) linings  |                 | P       |
|                   | 3) protection   |                 | P       |
|                   | 4) covers   |                 | P       |
| 3.6 (4.13.3)      | Straight test finger  |                 | P       |
| 3.6 (4.13.4)      | Rough service luminaires  |                 |         |
|                   | - IP54 or higher  |                 | N/A     |
|                   | a) fixed  |                 | N/A     |
|                   | b) hand-held  |                 | N/A     |
|                   | c) delivered with a stand   |                 | N/A     |
|                   | d) for temporary installations and suitable for mounting on a stand |                 | N/A     |
| 3.6 (4.13.6)      | Tumbling barrel   |                 | N/A     |
| <b>3.6 (4.14)</b> | <b>Suspensions, fixings and means of adjusting</b>                  |                 |         |
| 3.6 (4.14.1)      | Mechanical load:  |                 |         |
|                   | A) four times the weight  |                 | N/A     |
|                   | B) torque 2,5 Nm  |                 | P       |
|                   | C) bracket arm; bending moment (Nm) .....                           |                 | N/A     |
|                   | D) load track-mounted luminaires                                    |                 | N/A     |
|                   | E) clip-mounted luminaires, glass-shelve. Thickness (mm) .....      |                 | N/A     |
|                   | Metal rod. diameter (mm) .....                                      |                 | N/A     |
|                   | Fixed luminaire or independent control gear without fixing devices  |                 | N/A     |
| 3.6 (4.14.2)      | Load to flexible cables   |                 | N/A     |
|                   | Mass (kg) .....   |                 | —       |
|                   | Stress in conductors (N/mm <sup>2</sup> ) .....                     |                 | N/A     |
|                   | Mass (kg) of semi-luminaire .....                                   |                 | —       |
|                   | Bending moment (Nm) of semi-luminaire .....                         |                 | N/A     |
| 3.6 (4.14.3)      | Adjusting devices:  |                 |         |
|                   | - flexing test; number of cycles .....                              |                 | N/A     |
|                   | - strands broken .....  |                 | N/A     |
|                   | - electric strength test afterwards                                 |                 | N/A     |
| 3.6 (4.14.4)      | Telescopic tubes: cords not fixed to tube; no strain on conductors  |                 | N/A     |
| 3.6 (4.14.5)      | Guide pulleys   |                 | N/A     |
| 3.6 (4.14.6)      | Strain on socket-outlets  |                 | N/A     |

| IEC 60598-2-3     |  |                              |         |
|-------------------|--|------------------------------|---------|
| Clause            | Requirement + Test   | Result - Remark              | Verdict |
| <b>3.6 (4.15)</b> | <b>Flammable materials</b>                                       |                              |         |
|                   | - glow-wire test 650°C.....:                                     | See Test Table 3.15 (13.3.2) | N/A     |
|                   | - spacing ≥30 mm   |                              | N/A     |
|                   | - screen withstanding test of 13.3.1                             |                              | N/A     |
|                   | - screen dimensions  |                              | N/A     |
|                   | - no fiercely burning material                                   |                              | P       |
|                   | - thermal protection   |                              | N/A     |
|                   | - electronic circuits exempted                                   |                              | N/A     |
| 3.6 (4.15.2)      | Luminaires made of thermoplastic material with lamp control gear |                              |         |
|                   | a) construction  |                              | P       |
|                   | b) temperature sensing control                                   | 110                          | P       |
|                   | c) surface temperature   |                              | N/A     |
| <b>3.6 (4.16)</b> | <b>Luminaires for mounting on normally flammable surfaces</b>    |                              |         |
|                   | No lamp control gear .....                                       | (compliance with Section 12) | N/A     |
| 3.6 (4.16.1)      | Lamp control gear spacing:                                       |                              |         |
|                   | - spacing 35 mm  |                              | N/A     |
|                   | - spacing 10 mm  |                              | N/A     |
| 3.6 (4.16.2)      | Thermal protection:  |                              |         |
|                   | - in lamp control gear   |                              | N/A     |
|                   | - external   |                              | N/A     |
|                   | - fixed position   |                              | N/A     |
|                   | - temperature marked lamp control gear                           |                              | P       |
| 3.6 (4.16.3)      | Design to satisfy the test of 12.6                               | (see clause 12.6)            | P       |
| <b>3.6 (4.17)</b> | <b>Drain holes</b>   |                              |         |
|                   | Clearance at least 5 mm  |                              | N/A     |
| <b>3.6 (4.18)</b> | <b>Resistance to corrosion</b>                                   |                              |         |
| 3.6 (4.18.1)      | - rust-resistance  |                              | P       |
| 3.6 (4.18.2)      | - season cracking in copper                                      |                              | P       |
| 3.6 (4.18.3)      | - corrosion of aluminium   |                              | P       |
| 3.6 (4.19)        | Igniters compatible with ballast                                 |                              | N/A     |
| 3.6 (4.20)        | Rough service vibration  |                              | N/A     |
| <b>3.6 (4.21)</b> | <b>Protective shield</b>   |                              |         |
| 3.6 (4.21.1)      | Shield fitted if tungsten halogen lamps or metal halide lamps    |                              | N/A     |

| IEC 60598-2-3     |  |                                   |         |
|-------------------|--|-----------------------------------|---------|
| Clause            | Requirement + Test   | Result - Remark                   | Verdict |
|                   | Shield of glass if tungsten halogen lamps  |                                   | N/A     |
| 3.6 (4.21.2)      | Particles from a shattering lamp not impair safety   |                                   | N/A     |
| 3.6 (4.21.3)      | No direct path   |                                   | N/A     |
| 3.6 (4.21.4)      | Impact test on shield  |                                   | N/A     |
|                   | Glow-wire test on lamp compartment .....   | See Test Table 3.15 (13.3.2)      | N/A     |
| 3.6 (4.22)        | Attachments to lamps not cause overheating or damage   |                                   | N/A     |
| 3.6 (4.23)        | Semi-luminaires comply Class II  |                                   | N/A     |
| <b>3.6 (4.24)</b> | <b>Photobiological hazards</b>   |                                   |         |
| 3.6 (4.24.1)      | No excessive UV radiation if tungsten halogen lamps and metal halide lamps (Annex P)   |                                   | P       |
| 3.6 (4.24.2)      | Retinal blue light hazard  |                                   |         |
|                   | Luminaires with $E_{thr}$ :  |                                   |         |
|                   | a) Fixed luminaires  |                                   | P       |
|                   | - distance x m, borderline between RG1 and RG2 ...:  | RG2@20cm<br>RG1@50cm<br>RG0@500cm | P       |
|                   | - marking and instruction according 3.2.23   |                                   | N/A     |
|                   | b) Portable and handheld luminaires  |                                   |         |
|                   | - marking according 3.2.23 if RG1 exceeded at 200 mm according to IEC/TR 62778   |                                   | N/A     |
|                   | Portable luminaires for children IEC 60598-2-10 and Mains socket outlet nightlights IEC 60598-2-12 not exceed RG1 at 200 mm according to IEC/62778 |                                   | N/A     |
| <b>3.6 (4.25)</b> | <b>Mechanical hazard</b>   |                                   |         |
|                   | No sharp point or edges  |                                   | P       |
| <b>3.6 (4.26)</b> | <b>Short-circuit protection</b>  |                                   |         |
| 3.6 (4.26.1)      | Adequate means of uninsulated accessible SELV parts  |                                   | N/A     |
| 3.6 (4.26.2)      | Short-circuit test with test chain according 4.26.3  |                                   | N/A     |
|                   | Test chain not melt through  |                                   | N/A     |
|                   | Test sample not exceed values of Table 12.1 and 12.2   |                                   | N/A     |
| <b>3.6 (4.27)</b> | <b>Terminal blocks with integrated screwless earthing contacts</b>   |                                   |         |
|                   | Test according Annex V   |                                   | N/A     |
|                   | Pull test of terminal fixing (20 N)  |                                   | N/A     |
|                   | After test, resistance < 0,05 Ω  |                                   | N/A     |
|                   | Pull test of mechanical connection (50 N)  |                                   | N/A     |

| <b>IEC 60598-2-3</b> |   |                     |         |
|----------------------|---|---------------------|---------|
| Clause               | Requirement + Test  | Result - Remark     | Verdict |
|                      | After test, resistance < 0,05 Ω   |                     | N/A     |
|                      | Voltage drop test, resistance < 0,05 Ω  |                     | N/A     |
| <b>3.6 (4.28)</b>    | <b>Fixing of thermal sensing control</b>  |                     |         |
|                      | Not plug-in or easily replaceable type  |                     | N/A     |
|                      | Reliably kept in position   |                     | N/A     |
|                      | No adhesive fixing if UV radiations from a lamp can degrade the fixing  |                     | N/A     |
|                      | Not outside the luminaire enclosure   |                     | N/A     |
|                      | Test of adhesive fixing:  |                     | N/A     |
|                      | Max. temperature on adhesive material (°C).....:  |                     | —       |
|                      | 100 cycles between t min and t max  |                     | N/A     |
|                      | Temperature sensing control still in position   |                     | N/A     |
| <b>3.6 (4.29)</b>    | <b>Luminaires with non-replaceable light source</b>   |                     |         |
|                      | Not possible to replace light source  |                     | N/A     |
|                      | Live part not accessible after parts have been opened by hand or tools  |                     | N/A     |
| <b>3.6 (4.30)</b>    | <b>Luminaires with non-user replaceable light source</b>  |                     |         |
|                      | If protective cover provide protection against electric shock and marked with “caution, electric shock risk” symbol:  |                     | P       |
|                      | Minimum two fixing means  |                     | P       |
| <b>3.6 (4.31)</b>    | <b>Insulation between circuits</b>  |                     |         |
|                      | Circuits insulated from LV supply fulfil requirements according 4.31.1 – 4.31.3   | SELV/IEC 61347-2-13 | P       |
|                      | Controllable luminaires requiring same level of insulation for all components, the insulation between control terminals and LV supply fulfil requirements according 4.31.1 – 4.31.3 |                     | N/A     |
| <b>3.6 (4.31.1)</b>  | <b>SELV circuits</b>  |                     | P       |
|                      | Used SELV source  |                     | P       |
|                      | Voltage ≤ ELV   |                     | P       |
|                      | Insulating of SELV circuits from LV supply  | Double/reinforced   | P       |
|                      | Insulating of SELV circuits from other non SELV circuits  |                     | N/A     |
|                      | Insulating of SELV circuits from FELV   |                     | N/A     |
|                      | Insulating of SELV circuits from other SELV circuits  |                     | N/A     |
|                      | SELV circuits insulated from accessible parts according Table X.1   |                     | P       |

| <b>IEC 60598-2-3</b> |  |                 |         |
|----------------------|--|-----------------|---------|
| Clause               | Requirement + Test   | Result - Remark | Verdict |
|                      | Plugs not able to enter socket-outlets of other voltage systems  |                 | N/A     |
|                      | Socket outlets does not admit plugs of other voltage systems   |                 | N/A     |
|                      | Plugs and socket-outlets does not have protective conductor contact  |                 | N/A     |
| <b>3.6 (4.31.2)</b>  | <b>FELV circuits</b>   |                 |         |
|                      | Used FELV source   |                 | N/A     |
|                      | Voltage ≤ ELV  |                 | N/A     |
|                      | Insulating of FELV circuits from LV supply   |                 | N/A     |
|                      | FELV circuits insulated from accessible parts according Table X.1  |                 | N/A     |
|                      | Plugs not able to enter socket-outlets of other voltage systems  |                 | N/A     |
|                      | Socket outlets does not admit plugs of other voltage systems   |                 | N/A     |
|                      | Socket-outlets does not have protective conductor contact  |                 | N/A     |
| <b>3.6 (4.31.3)</b>  | <b>Other circuits</b>  |                 |         |
|                      | Other circuits insulated from accessible parts according Table X.1   |                 | N/A     |
|                      | Class II construction with equipotential bonding for protection against indirect contacts with live parts: |                 |         |
|                      | - conductive parts are connected together  |                 | N/A     |
|                      | - test according 7.2.3 of above  |                 | N/A     |
|                      | - conductive part not cause an electric shock in case of an insulation fault                               |                 | N/A     |
|                      | - equipotential bonding in master/slave applications   |                 | N/A     |
|                      | - master luminaire provided with terminal for accessible conductive parts of slave luminaires              |                 | N/A     |
|                      | - slave luminaire constructed as class I   |                 | N/A     |
| <b>3.6 (4.32)</b>    | <b>Overvoltage protective devices</b>  |                 |         |
|                      | Comply with IEC 61643-11   | CB              | P       |
|                      | External to controlgear and connected to earth:  |                 |         |
|                      | - only in fixed luminaires   |                 | P       |
|                      | - only connected to protective earth   |                 | P       |
| <b>3.6.1 (-)</b>     | At least IP X3 or X5 respectively. IP .....  | IP66            | P       |
|                      | Column-integrated luminaires:  |                 |         |

| IEC 60598-2-3 |   |                               |         |
|---------------|---|-------------------------------|---------|
| Clause        | Requirement + Test  | Result - Remark               | Verdict |
|               | - parts below 2,5 m. IP .....   |                               | N/A     |
|               | - parts above 2,5 m. IP .....   |                               | N/A     |
| 3.6.2 (-)     | Suspension on span wires  |                               | N/A     |
| 3.6.3 (-)     | Means for attaching the luminaire or external parts to its support appropriate to the weight                            |                               | P       |
| 3.6.3.1 (-)   | Static load test  |                               |         |
|               | - drag coefficient .....  | 0.2563                        | P       |
|               | - loaded area (m <sup>2</sup> ).....  | 0.014m <sup>2</sup>           | P       |
|               | - used load (N) .....   | 0.2N                          | P       |
|               | - measured deformation (cm/m) .....   | 0cm/m                         | P       |
|               | - no rotation   |                               | P       |
| 3.6.4 (-)     | Adjustable lampholders  |                               | N/A     |
| 3.6.5 (-)     | Luminaires installed above 5 m, glass covers shall be:  |                               |         |
|               | a) glass that fractures into small pieces (test according to 3.6.5.1), or   | Safety Glass                  | P       |
|               | b) glass having a high impact shock resistance (test according to 3.6.5.2), or  |                               | P       |
|               | c) protected by any means to retain glass fragments   |                               | N/A     |
|               | For tunnel luminaires 3.6.5.1 apply   |                               | N/A     |
|               | Method of protection declared by the manufacturer   |                               | N/A     |
| 3.6.5.1 (-)   | Protection by the use of glass that fractures into small pieces   |                               | P       |
|               | - number of particles is more than 40 .....   | 48                            | P       |
| 3.6.5.2 (-)   | Protection by the use of high impact resistant glass  |                               | P       |
| 3.6.5.2.1 (-) | Glass covers have high mechanical strength  |                               | P       |
|               | Test according IEC 62262 with test apparatus according IEC 60068-2-75 with impact energy of 5J on preconditioned sample | Glass : IK08<br>Lenses : IK08 | P       |
| 3.6.5.2.2 (-) | Glass covers not break into large pieces  |                               | P       |
|               | - test according 3.6.5.1, number of particles is more than 20 .....   | 50                            | P       |
| 3.6.6 (-)     | Connection compartment of column-integrated luminaire   |                               |         |
|               | - provides adequate space   |                               | N/A     |
|               | - means for attachment  |                               | N/A     |
|               | - means for attachment of metal corrosion-resistant   |                               | N/A     |
| 3.6.7 (-)     | Compliance with ISO standard or other .....   |                               | N/A     |
| 3.6.8 (-)     | Doors of column-integrated luminaires:  |                               |         |

| IEC 60598-2-3 |   |                 |         |
|---------------|---|-----------------|---------|
| Clause        | Requirement + Test  | Result - Remark | Verdict |
|               | - corrosion-resistant   |                 | N/A     |
|               | - opening only possible for an authorized person                          |                 | N/A     |
|               | - impact test 5 Nm  |                 | N/A     |
|               | - sample show no damage   |                 | N/A     |
| 3.6.9 (-)     | Column-integrated luminaire:  |                 |         |
|               | - dimension of the cable entry slot (mm) .....                            |                 | N/A     |
|               | - cable path from the slot to the connection compartment (mm) .....       |                 | N/A     |
|               | - cable path free from obstruction that might cause abrasion of the cable |                 | N/A     |

| 3.7 (11)   | CREEPAGE DISTANCES AND CLEARANCES                                      |   | P |
|------------|--|---|---|
| 3.7 (11.2) | Creepage distances and clearances .....                                | See Table 3.7 (11.2)  | P |
|            | Working voltage (V) .....  | 120-240 V   | — |
|            | Rated pulse voltage (kV) .....   | /   | — |
|            | Voltage form .....   | Sinusoidal <input checked="" type="checkbox"/><br>Non-sinusoidal <input type="checkbox"/> | — |
|            | PTI .....  | < 600 <input type="checkbox"/> ≥ 600 <input checked="" type="checkbox"/>                  | — |
|            | Impulse withstand category (Normal category II) (Category III Annex U) | Category II <input type="checkbox"/> Category III <input type="checkbox"/>                | — |

| 3.8 (7)             | PROVISION FOR EARTHING   |  |     |
|---------------------|--|--|-----|
| 3.8 (7.2.1 + 7.2.3) | Accessible metal parts   |  | P   |
|                     | Metal parts in contact with supporting surface                                       |  | P   |
|                     | Resistance < 0,5 Ω .....   |  | P   |
|                     | Self-tapping screws used   |  | N/A |
|                     | Thread-forming screws  |  | N/A |
|                     | Thread-forming screw used in a grove   |  | N/A |
|                     | Earth makes contact first  |  | P   |
|                     | Terminal blocks with integrated screwless earthing contacts tested according Annex V |  | N/A |
|                     | Protective earthing of the luminaire not via built-in control gear                   |  | P   |
| 3.8 (7.2.2 + 7.2.3) | Earth continuity in joints, etc.   |  | P   |
| 3.8 (7.2.4)         | Locking of clamping means  |  | P   |

| <b>IEC 60598-2-3</b> |   |                       |          |
|----------------------|---|-----------------------|----------|
| Clause               | Requirement + Test  | Result - Remark       | Verdict  |
|                      | Compliance with 4.7.3   |                       | P        |
|                      | Terminal blocks with integrated screwless earthing contacts tested according Annex V  |                       | N/A      |
| 3.8 (7.2.5)          | Earth terminal integral part of connector socket  |                       | P        |
| 3.8 (7.2.6)          | Earth terminal adjacent to mains terminals  |                       | P        |
| 3.8 (7.2.7)          | Electrolytic corrosion of the earth terminal  |                       | P        |
| 3.8 (7.2.8)          | Material of earth terminal  |                       | P        |
|                      | Contact surface bare metal  |                       | P        |
| 3.8 (7.2.10)         | Class II luminaire for looping-in   |                       | N/A      |
|                      | Double or reinforced insulation to functional earth   |                       | N/A      |
| 3.8 (7.2.11)         | Earthing core coloured green-yellow   |                       | P        |
|                      | Length of earth conductor   |                       | N/A      |
| 3.8.1 (-)            | Attachment prevented from rotation  |                       | N/A      |
| <b>3.9 (14)</b>      | <b>SCREW TERMINALS</b>  |                       | P        |
|                      | Separately approved; component list .....   | (see Annex 1)         | P        |
|                      | Part of the luminaire.....  | (see Annex 3)         | N/A      |
| <b>3.9 (15)</b>      | <b>SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS</b>   |                       | P        |
|                      | Separately approved; component list .....   | (see Annex 1)         | P        |
|                      | Part of the luminaire.....  | (see Annex 4)         | N/A      |
| <b>3.10 (5)</b>      | <b>EXTERNAL AND INTERNAL WIRING</b>   |                       |          |
| <b>3.10 (5.2)</b>    | <b>Supply connection and external wiring</b>  |                       | <b>P</b> |
| 3.10 (5.2.1)         | Means of connection.....  | Internal connector    | P        |
|                      | Outdoor luminaire has not PVC insulated external wiring if not class III or SELV $\leq 25$ V a.c./60 V d.c. or protected from outdoor environment |                       | N/A      |
| 3.10 (5.2.2)         | Type of cable .....   | H07RN-F (if provided) | P        |
|                      | Nominal cross-sectional area (mm <sup>2</sup> ).....  | 1,5 mm <sup>2</sup>   | P        |
|                      | Cables equal to IEC 60227 or IEC 60245  |                       | P        |
| 3.10 (5.2.3)         | Type of attachment, X, Y or Z   |                       | N/A      |
| 3.10 (5.2.5)         | Type Z not connected to screws  |                       | N/A      |
| 3.10 (5.2.6)         | Cable entries:  |                       |          |
|                      | - suitable for introduction   |                       | P        |



| IEC 60598-2-3   |  |                 |         |
|-----------------|--|-----------------|---------|
| Clause          | Requirement + Test                                       | Result - Remark | Verdict |
|                 | - adequate degree of protection                          |                 | P       |
| 3.10 (5.2.7)    | Cable entries through rigid material have rounded edges  |                 | P       |
| 3.10 (5.2.8)    | Insulating bushings:                                     |                 |         |
|                 | - suitably fixed   |                 | N/A     |
|                 | - material in bushings                                   |                 | N/A     |
|                 | - material not likely to deteriorate                     |                 | N/A     |
|                 | - tubes or guards made of insulating material            |                 | N/A     |
| 3.10 (5.2.9)    | Locking of screwed bushings                              |                 | N/A     |
| 3.10 (5.2.10)   | Cord anchorage:  |                 |         |
|                 | - covering protected from abrasion                       |                 | P       |
|                 | - clear how to be effective                              |                 | P       |
|                 | - no mechanical or thermal stress                        |                 | P       |
|                 | - no tying of cables into knots etc.                     |                 | P       |
|                 | - insulating material or lining                          |                 | P       |
| 3.10 (5.2.10.1) | Cord anchorage for type X attachment:                    |                 |         |
|                 | a) at least one part fixed                               |                 | N/A     |
|                 | b) types of cable  |                 | N/A     |
|                 | c) no damaging of the cable                              |                 | N/A     |
|                 | d) whole cable can be mounted                            |                 | N/A     |
|                 | e) no touching of clamping screws                        |                 | N/A     |
|                 | f) metal screw not directly on cable                     |                 | N/A     |
|                 | g) replacement without special tool                      |                 | N/A     |
|                 | Glands not used as anchorage                             |                 | N/A     |
|                 | Labyrinth type anchorages                                |                 | N/A     |
| 3.10 (5.2.10.2) | Adequate cord anchorage for type Y and type Z attachment |                 | N/A     |
| 3.10 (5.2.10.3) | Tests:   |                 |         |
|                 | - impossible to push cable; unsafe                       |                 | P       |
|                 | - pull test: 25 times; pull (N) .....: 60                |                 | P       |
|                 | - torque test: torque (Nm) .....: 0.25Nm                 |                 | P       |
|                 | - displacement ≤ 2 mm                                    |                 | P       |
|                 | - no movement of conductors                              |                 | P       |

| IEC 60598-2-3     |  |                 |         |
|-------------------|--|-----------------|---------|
| Clause            | Requirement + Test   | Result - Remark | Verdict |
|                   | - no damage of cable or cord                                       |                 | P       |
|                   | - function independent of electrical connection                    |                 | N/A     |
| 3.10<br>(5.2.11)  | External wiring passing into luminaire                             |                 | N/A     |
| 3.10<br>(5.2.12)  | Looping-in terminals   |                 | N/A     |
| 3.10<br>(5.2.13)  | Wire ends not tinned   |                 | N/A     |
|                   | Wire ends tinned: no cold flow                                     |                 | N/A     |
| 3.10<br>(5.2.14)  | Mains plug same protection   |                 | N/A     |
|                   | Class III luminaire plug   |                 | N/A     |
|                   | No unsafe compatibility  |                 | N/A     |
| 3.10<br>(5.2.16)  | Appliance inlets (IEC 60320)                                       |                 | P       |
|                   | Installation couplers (IEC 61535)                                  |                 | N/A     |
|                   | Other appliance inlet or connector according relevant IEC standard |                 | N/A     |
| 3.10<br>(5.2.17)  | No standardized interconnecting cables properly assembled          |                 | N/A     |
| 3.10<br>(5.2.18)  | Used plug in accordance with                                       |                 |         |
|                   | - IEC 60083  |                 | N/A     |
|                   | - other standard   |                 | N/A     |
| <b>3.10 (5.3)</b> | <b>Internal wiring</b>   |                 |         |
| 3.10 (5.3.1)      | Internal wiring of suitable size and type                          |                 | P       |
|                   | Through wiring   |                 |         |
|                   | - not delivered/ mounting instruction                              |                 | N/A     |
|                   | - factory assembled  |                 | N/A     |
|                   | - socket outlet loaded (A) .....                                   |                 | N/A     |
|                   | - temperatures .....   | (see Annex 2)   | N/A     |
|                   | Green-yellow for earth only  |                 | N/A     |
| 3.10<br>(5.3.1.1) | Internal wiring connected directly to fixed wiring                 |                 |         |
|                   | Cross-sectional area (mm <sup>2</sup> ) .....                      |                 | P       |
|                   | Insulation thickness   |                 | P       |
|                   | Extra insulation added where necessary                             |                 | N/A     |

| <b>IEC 60598-2-3</b> |  |                 |         |
|----------------------|--|-----------------|---------|
| Clause               | Requirement + Test   | Result - Remark | Verdict |
| 3.10<br>(5.3.1.2)    | Internal wiring connected to fixed wiring via internal current-limiting device     |                 |         |
|                      | Adequate cross-sectional area and insulation thickness                             |                 | N/A     |
| 3.10<br>(5.3.1.3)    | Double or reinforced insulation for class II                                       |                 | N/A     |
| 3.10<br>(5.3.1.4)    | Conductors without insulation  |                 | N/A     |
| 3.10<br>(5.3.1.5)    | SELV current-carrying parts  |                 | P       |
| 3.10<br>(5.3.1.6)    | Insulation thickness other than PVC or rubber                                      |                 | P       |
| 3.10 (5.3.2)         | Sharp edges etc.   |                 | P       |
|                      | No moving parts of switches etc.   |                 | N/A     |
|                      | Joints, raising/lowering devices   |                 | N/A     |
|                      | Telescopic tubes etc.  |                 | N/A     |
|                      | No twisting over 360°  |                 | N/A     |
| 3.10 (5.3.3)         | Insulating bushings:   |                 |         |
|                      | - suitable fixed   |                 | N/A     |
|                      | - material in bushings   |                 | N/A     |
|                      | - material not likely to deteriorate   |                 | N/A     |
|                      | - cables with protective sheath  |                 | N/A     |
| 3.10 (5.3.4)         | Joints and junctions effectively insulated   |                 | N/A     |
| 3.10 (5.3.5)         | Strain on internal wiring  |                 | P       |
| 3.10 (5.3.6)         | Wire carriers  |                 | N/A     |
| 3.10 (5.3.7)         | Wire ends not tinned   |                 | P       |
|                      | Wire ends tinned: no cold flow   |                 | N/A     |
| 3.10.1 (-)           | Cord anchorage if applicable   |                 | P       |
|                      | - pull test: 25 times; pull (N) .....  | 60 N            | P       |
|                      | - torque test: torque (Nm) .....   | 0.25 Nm         | P       |
| <b>3.11 (8)</b>      | <b>PROTECTION AGAINST ELECTRIC SHOCK</b>   |                 |         |
| 3.11 (8.2.1)         | Live parts not accessible  |                 | P       |
|                      | Basic insulated parts not used on the outer surface without appropriate protection |                 | P       |

| IEC 60598-2-3  |  |                 |         |
|----------------|--|-----------------|---------|
| Clause         | Requirement + Test   | Result - Remark | Verdict |
|                | Basic insulated parts not accessible with standard test finger on portable, settable and adjustable luminaires         |                 | P       |
|                | Basic insulated parts not accessible with Ø 50 mm probe from outside, other types of luminaires                        |                 | P       |
|                | Lamp and starterholders in portable and adjustable luminaires comply with double or reinforced insulation requirements |                 | N/A     |
|                | Basic insulation only accessible under lamp or starter replacement   |                 | N/A     |
|                | Protection in any position   |                 | N/A     |
|                | Double-ended tungsten filament lamp  |                 | N/A     |
|                | Insulation lacquer not reliable  |                 | N/A     |
|                | Double-ended high pressure discharge lamp  |                 | N/A     |
|                | Relevant warning according to 3.2.18 fitted to the luminaire   |                 | N/A     |
| 3.11 (8.2.2)   | Portable luminaire adjusted in most unfavourable position  |                 | N/A     |
| 3.11 (8.2.3.a) | Class II luminaire:  |                 |         |
|                | - basic insulated metal parts not accessible during starter or lamp replacement  |                 | N/A     |
|                | - basic insulation not accessible other than during starter or lamp replacement  |                 | N/A     |
|                | - glass protective shields not used as supplementary insulation  |                 | N/A     |
| 3.11 (8.2.3.b) | BC lampholder of metal in class I luminaires shall be earthed  |                 | N/A     |
| 3.11 (8.2.3.c) | SELV circuits with exposed current carrying parts:   |                 |         |
|                | Ordinary luminaire:  |                 |         |
|                | - touch current .....  |                 | N/A     |
|                | - no-load voltage.....   |                 | N/A     |
|                | Other than ordinary luminaire:   |                 |         |
|                | - nominal voltage .....  |                 | N/A     |
| 3.11 (8.2.4)   | Portable luminaire have protection independent of supporting surface   |                 | N/A     |
| 3.11 (8.2.5)   | Compliance with the standard test finger or relevant probe   |                 | P       |
| 3.11 (8.2.6)   | Covers reliably secured  |                 | P       |

| IEC 60598-2-3 |  |                 |         |
|---------------|--|-----------------|---------|
| Clause        | Requirement + Test                               | Result - Remark | Verdict |
| 3.11 (8.2.7)  | Discharging of capacitors $\geq 0,5 \mu\text{F}$ |                 | N/A     |
|               | Portable plug connected luminaire with capacitor |                 | N/A     |
|               | Other plug connected luminaire with capacitor    |                 | N/A     |
|               | Discharge device on or within capacitor          |                 | N/A     |
|               | Discharge device mounted separately              |                 | N/A     |

|                  |   |                              |          |
|------------------|---|------------------------------|----------|
| <b>3.12 (12)</b> | <b>ENDURANCE TEST AND THERMAL TEST</b>  |                              | <b>P</b> |
| 3.12.2 (-)       | If IP > IP 20 relevant test of (12.4), (12.5) and (12.6) after (9.2) before (9.3) specified in 3.13 |                              | —        |
| 3.12 (12.3)      | Endurance test:   |                              | <b>P</b> |
|                  | - mounting-position .....   | Acc. To mounting instruction | —        |
|                  | - test temperature (°C) .....   | 35°C                         | —        |
|                  | - total duration (h) .....  | 240 H                        | —        |
|                  | - supply voltage: Un factor; calculated voltage (V)....:  |                              | —        |
|                  | - lamp used .....   |                              | —        |
| 3.12 (12.3.2)    | After endurance test:   |                              |          |
|                  | - no part unserviceable   |                              | <b>P</b> |
|                  | - luminaire not unsafe  |                              | <b>P</b> |
|                  | - no damage to track system   |                              | N/A      |
|                  | - marking legible   |                              | <b>P</b> |
|                  | - no cracks, deformation etc.   |                              | <b>P</b> |
| 3.12 (12.4)      | Thermal test (normal operation)   | (see Annex 2)                | <b>P</b> |
| 3.12 (12.5)      | Thermal test (abnormal operation)   | (see Annex 2)                | <b>P</b> |
| 3.12 (12.6)      | Thermal test (failed lamp control gear condition):  |                              |          |
| 3.12 (12.6.1)    | Through wiring or looping-in wiring loaded by a current of (A) .....                                |                              | —        |
|                  | - case of abnormal conditions .....   |                              | —        |
|                  | - electronic lamp control gear  |                              | N/A      |
|                  | - measured winding temperature (°C): at 1,1 Un .....  |                              | —        |
|                  | - measured mounting surface temperature (°C) at 1,1 Un.....   |                              | N/A      |
|                  | - calculated mounting surface temperature (°C) .....  |                              | N/A      |
|                  | - track-mounted luminaires  |                              | N/A      |

| IEC 60598-2-3      |  |                         |         |
|--------------------|--|-------------------------|---------|
| Clause             | Requirement + Test   | Result - Remark         | Verdict |
| 3.12<br>(12.6.2)   | Temperature sensing control  |                         |         |
|                    | - case of abnormal conditions .....  |                         | —       |
|                    | - thermal link   |                         | N/A     |
|                    | - manual reset cut-out   |                         | N/A     |
|                    | - auto reset cut-out   |                         | N/A     |
|                    | - measured mounting surface temperature (°C) .....                         |                         | N/A     |
|                    | - track-mounted luminaires   |                         | N/A     |
| 3.12 (12.7)        | Thermal test (failed lamp control gear in plastic luminaires):             |                         | N/A     |
| 3.12<br>(12.7.1)   | Luminaire without temperature sensing control                              |                         | N/A     |
| 3.12<br>(12.7.1.1) | Luminaire with fluorescent lamp ≤ 70W                                      |                         | N/A     |
|                    | Test method 12.7.1.1 or Annex W .....                                      |                         | —       |
|                    | Test according to 12.7.1.1:  |                         |         |
|                    | - case of abnormal conditions .....  |                         | —       |
|                    | - Ballast failure at supply voltage (V) .....                              |                         | —       |
|                    | - Components retained in place after the test                              |                         | N/A     |
|                    | - Test with standard test finger after the test                            |                         | N/A     |
|                    | Test according to Annex W:   |                         |         |
|                    | - case of abnormal conditions .....  |                         | —       |
|                    | - measured winding temperature (°C): at 1,1 Un .....                       |                         | —       |
|                    | - measured temperature of fixing point/exposed part (°C): at 1,1 Un .....  |                         | —       |
|                    | - calculated temperature of fixing point/exposed part (°C) .....           |                         | —       |
|                    | Ball-pressure test .....   | See Table 3.15 (13.2.1) | N/A     |
| 3.12<br>(12.7.1.2) | Luminaire with discharge lamp, fluorescent lamp > 70W, transformer > 10 VA |                         |         |
|                    | - case of abnormal conditions .....  |                         | —       |
|                    | - measured winding temperature (°C): at 1,1 Un .....                       |                         | —       |
|                    | - measured temperature of fixing point/exposed part (°C): at 1,1 Un .....  |                         | —       |
|                    | - calculated temperature of fixing point/exposed part (°C) .....           |                         | —       |
|                    | Ball-pressure test .....   | See Table 3.15 (13.2.1) | N/A     |

| IEC 60598-2-3      |   |  |         |
|--------------------|---|--|---------|
| Clause             | Requirement + Test  | Result - Remark  | Verdict |
| 3.12<br>(12.7.1.3) | Luminaire with short circuit proof transformers<br>≤ 10 VA                        |  | N/A     |
|                    | - case of abnormal conditions .....   |  | —       |
|                    | - Components retained in place after the test                                     |  | N/A     |
|                    | - Test with standard test finger after the test                                   |  | N/A     |
| 3.12<br>(12.7.2)   | Luminaire with temperature sensing control  |  | N/A     |
|                    | - thermal link .....  | Yes <input type="checkbox"/> No <input type="checkbox"/> | —       |
|                    | - manual reset cut-out .....  | Yes <input type="checkbox"/> No <input type="checkbox"/> | —       |
|                    | - auto reset cut-out .....  | Yes <input type="checkbox"/> No <input type="checkbox"/> | —       |
|                    | - case of abnormal conditions .....   |  | —       |
|                    | - highest measured temperature of fixing point/<br>exposed part (°C): .....       |  | —       |
|                    | Ball-pressure test: .....   | See Table 3.15 (13.2.1)                                  | N/A     |
| 3.12.1 (-)         | Temperature reduction if for outdoor use only                                     |  | N/A     |
| 3.12.2 (-)         | (See above)   |  | —       |
| 3.12.3 (-)         | Glass covers used within the thermal limits declared<br>by the glass manufacturer |  | N/A     |

|                 |   |                              |     |
|-----------------|---|------------------------------|-----|
| <b>3.13 (9)</b> | <b>RESISTANCE TO DUST, SOLID OBJECTS AND MOISTURE</b>   |                              | P   |
| 3.13.1 (-)      | If IP > IP 20 the order of tests as specified in clause 3.12                                      |                              | P   |
| 3.13 (9.2)      | Tests for ingress of dust, solid objects and moisture:  |                              | —   |
|                 | - classification according to IP .....  | IP66                         | —   |
|                 | - mounting position during test .....   | Acc. to mounting instruction | —   |
|                 | - fixing screws tightened; torque (Nm) .....  | Acc. to mounting instruction | —   |
|                 | - tests according to clauses .....  |                              | —   |
|                 | - electric strength test afterwards   |                              | P   |
|                 | a) no deposit in dust-proof luminaire   |                              | P   |
|                 | b) no talcum in dust-tight luminaire  |                              | P   |
|                 | c) no trace of water on current-carrying parts or on<br>insulation where it could become a hazard |                              | P   |
|                 | d) i) For luminaires without drain holes – no water<br>entry                                      |                              | P   |
|                 | d) ii) For luminaires with drain holes – no hazardous<br>water entry                              |                              | N/A |
|                 | e) no water in watertight luminaire   |                              | P   |

| IEC 60598-2-3 |  |                 |         |
|---------------|--|-----------------|---------|
| Clause        | Requirement + Test   | Result - Remark | Verdict |
|               | f) no contact with live parts (IP 2X)  |                 | P       |
|               | f) no entry into enclosure (IP 3X and IP 4X)                                   |                 | P       |
|               | f) no contact with live parts (IP3X and IP4X)                                  |                 | P       |
|               | g) no trace of water on part of lamp requiring protection from splashing water |                 | N/A     |
|               | h) no damage of protective shield or glass envelope                            |                 | N/A     |
| 3.13 (9.3)    | Humidity test 48 h   |                 | P       |

|                  |  |           |     |
|------------------|--|-----------|-----|
| <b>3.14 (10)</b> | <b>INSULATION RESISTANCE AND ELECTRIC STRENGTH</b>   |           | P   |
| 3.14 (10.2.1)    | Insulation resistance test   |           | P   |
|                  | Cable or cord covered by metal foil or replaced by a metal rod of mm Ø .....   |           | —   |
|                  | Insulation resistance (MΩ) .....   |           | —   |
|                  | SELV   |           |     |
|                  | - between current-carrying parts of different polarity :   | >1,3 Mohm | P   |
|                  | - between current-carrying parts and mounting surface .....  | >1,3 Mohm | P   |
|                  | - between current-carrying parts and metal parts of the luminaire .....  | >1,3 Mohm | P   |
|                  | - between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... |           | N/A |
|                  | - Insulation bushings as described in Section 5 .....  |           | N/A |
|                  | Other than SELV  |           |     |
|                  | - between live parts of different polarity .....   | >2,6 Mohm | P   |
|                  | - between live parts and mounting surface .....  | >2,6 Mohm | P   |
|                  | - between live parts and metal parts .....   | >2,6 Mohm | P   |
|                  | - between live parts of different polarity through action of a switch .....  |           | N/A |
|                  | - between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... | >2,6 Mohm | P   |
|                  | - Insulation bushings as described in Section 5 .....  |           | N/A |
| 3.14 (10.2.2)    | Electric strength test   |           | P   |
|                  | Dummy lamp   |           | N/A |
|                  | Luminaires with ignitors after 24 h test   |           | N/A |



| IEC 60598-2-3 |  |                 |         |
|---------------|--|-----------------|---------|
| Clause        | Requirement + Test   | Result - Remark | Verdict |
|               | Luminaires with manual ignitors  |                 | N/A     |
|               | Test voltage (V) .....   |                 | P       |
|               | SELV   |                 |         |
|               | - between current-carrying parts of different polarity :   |                 | N/A     |
|               | - between current-carrying parts and mounting surface .....  |                 | N/A     |
|               | - between current-carrying parts and metal parts of the luminaire .....  |                 | N/A     |
|               | - between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... |                 | N/A     |
|               | - Insulation bushings as described in Section 5 .....  |                 | N/A     |
|               | Other than SELV  |                 |         |
|               | - between live parts of different polarity .....   | 1480 V          | P       |
|               | - between live parts and mounting surface .....  | 1480 V          | P       |
|               | - between live parts and metal parts .....   | 1480 V          | P       |
|               | - between live parts of different polarity through action of a switch .....  |                 | N/A     |
|               | - between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... | 1480 V          | P       |
|               | - Insulation bushings as described in Section 5 .....  |                 | N/A     |
| 3.14 (10.3)   | Touch current or protective conductor current (mA) :   | <<0,5           | P       |

| 3.15 (13)     | RESISTANCE TO HEAT, FIRE AND TRACKING |                              |     |
|---------------|---------------------------------------|------------------------------|-----|
| 3.15 (13.2.1) | Ball-pressure test .....              | See Test Table 3.15 (13.2.1) | N/A |
| 3.15 (13.3.1) | Needle-flame test (10 s) .....        | See Test Table 3.15 (13.3.1) | N/A |
| 3.15 (13.3.2) | Glow-wire test (650°C) .....          | See Test Table 3.15 (13.3.2) | N/A |
| 3.15 (13.4)   | Proof tracking test (IEC 60112) ..... | See Test Table 3.15 (13.4)   | N/A |

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| 3.7 (11.2)                                       | TABLES: Creepage distances and clearances                             |     |     |     |     |      | p   |
|--|---|-----|-----|-----|-----|------|-----|
| <b>Table 11.1</b>                                | <b>Minimum distances (mm) for a.c. (50/60 Hz) sinusoidal voltages</b> |     |     |     |     |      |     |
| RMS working voltage (V) not exceeding            | 50  | 150 | 250 | 500 | 750 | 1000 |     |
| <b>Creepage distances</b>                        |   |     |     |     |     |      |     |
| Required basic insulation, PTI $\geq$ 600        | 0,6   | 0,8 | 1,5 | 3   | 4   | 5,5  |     |
| Measured   |   |     | >2  |     |     |      |     |
| Required basic insulation, PTI < 600             | 1,2   | 1,6 | 2,5 | 5   | 8   | 10   |     |
| Measured   |   |     |     |     |     |      |     |
| Required supplementary insulation PTI $\geq$ 600 | -   | 0,8 | 1,5 | 3   | 4   | 5,5  |     |
| Measured   |   |     |     |     |     |      |     |
| Required supplementary insulation PTI < 600      | -   | 1,6 | 2,5 | 5   | 8   | 10   |     |
| Measured   |   |     |     |     |     |      |     |
| Required reinforced insulation                   | -   | 3,2 | 5   | 6   | 8   | 11   |     |
| Measured   |   |     |     |     |     |      |     |
| <b>Clearances</b>                                |   |     |     |     |     |      |     |
| Required basic insulation                        | 0,2   | 0,8 | 1,5 | 3   | 4   | 5,5  |     |
| Measured   |   |     | >2  |     |     |      |     |
| Required supplementary insulation                | -   | 0,8 | 1,5 | 3   | 4   | 5,5  |     |
| Measured   |   |     |     |     |     |      |     |
| Required reinforced insulation                   | -   | 1,6 | 3   | 6   | 8   | 11   |     |
| Measured   |   |     |     |     |     |      |     |
| <b>Table 11.2</b>                                | <b>Minimum distances (mm) for non-sinusoidal pulse voltages</b>       |     |     |     |     |      |     |
| Rated pulse voltage (peak kV)                    | 2,0   | 2,5 | 3,0 | 4,0 | 5,0 | 6,0  | 8,0 |
| Required clearances                              | 1,0   | 1,5 | 2   | 3   | 4   | 5,5  | 8   |
| Measured   |   |     |     |     |     |      |     |
| Rated pulse voltage (peak kV)                    | 10  | 12  | 15  | 20  | 25  | 30   | 40  |
| Required clearances                              | 11  | 14  | 18  | 25  | 33  | 40   | 60  |
| Measured   |   |     |     |     |     |      |     |
| Rated pulse voltage (peak kV)                    | 50  | 60  | 80  | 100 | -   | -    | -   |
| Required clearances                              | 75  | 90  | 130 | 170 | -   | -    | -   |
| Measured   |   |     |     |     |     |      |     |

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

|   |  |                       |                          |            |
|---|--|-----------------------|--------------------------|------------|
| 3.15<br>(13.2.1)                              | <b>TABLE: Ball Pressure Test of Thermoplastics</b> |                       |                          | <b>N/A</b> |
| <b>Allowed impression diameter (mm) .....</b> |  |                       | —                        |            |
| Object/ Part No./ Material                    | Manufacturer/<br>trademark                         | Test temperature (°C) | Impression diameter (mm) |            |
|   |  |                       |                          |            |
| Supplementary information:                    |  |                       |                          |            |

|                               |  |   |  |                                    |            |
|-------------------------------|--|---|--|------------------------------------|------------|
| 3.15<br>(13.3.1)              | <b>TABLE: Needle-flame test (IEC 60695-11-5)</b> |   |  |                                    | <b>N/A</b> |
| Object/ Part No./<br>Material | Manufacturer/<br>trademark                       | Duration of<br>application of test<br>flame (ta); (s) | Ignition of<br>specified layer<br>Yes/No | Duration of<br>burning (tb)<br>(s) | Verdict    |
|                               |  |   |  |                                    |            |
| Supplementary information:    |  |   |  |                                    |            |

|   |   |   |  |                                    |            |
|---|---|---|--|------------------------------------|------------|
| 3.15<br>(13.3.2)  | <b>TABLE: Glow-wire test (IEC 60695-2-11)</b> |   |  |                                    | <b>N/A</b> |
| <b>Glow wire temperature .....</b>  |   | 650°C   |  | —                                  |            |
| Object/ Part No./<br>Material   | Manufacturer/<br>trademark                    | Duration of<br>application of test<br>flame (ta); (s) | Ignition of<br>specified layer<br>Yes/No | Duration of<br>burning (tb)<br>(s) | Verdict    |
|   |   |   |  |                                    |            |
| Any flame or glowing of the sample extinguished within 30 s of withdrawing the glow-wire, and any burning or molten drop did not ignite the underlying parts (Yes/No) ..... |   |   |  |                                    |            |
| Supplementary information:  |   |   |  |                                    |            |

|                               |   |  |  |   |            |
|-------------------------------|---|--|--|---|------------|
| 3.15 (13.4)                   | <b>TABLE: Proof tracking test (IEC 60112)</b> |  |  |   | <b>N/A</b> |
| <b>Test voltage PTI .....</b> |   | 175 V  |  | — |            |
| Object/ Part No./ Material    | Manufacturer/<br>trademark                    | Withstand 50 drops without failure on three places or on three specimens |  |   | Verdict    |
|                               |   |  |  |   |            |
| Supplementary information:    |   |  |  |   |            |

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| ANNEX 1                 |      | TABLE: Critical components information |   |   |                             |                                     |  |
|-------------------------|------|--|---|---|-----------------------------|-------------------------------------|--|
| Object / part No.       | Code | Manufacturer/ trademark                | Type / model                              | Technical data  | Standard                    | Mark(s) of conformity <sup>1)</sup> |  |
| Drivers                 | A    | Meanwell                               | APC-8E Series                             | 8W 50-60Hz 0,25-0,7A 200-240V<br>Tc=75°C                      | IEC 61347-2-13              | CB                                  |  |
| Drivers                 | A    | Meanwell                               | PLM-12 Series                             | 12W 50-60Hz 0,35-1,05A 110-240V<br>Tc=75°C                    | IEC 61347-2-13<br>IEC 62384 | TUV                                 |  |
| Drivers                 | A    | Meanwell                               | PLM-25 Series                             | 25W 50-60Hz 0,35-1,05A 110-240V<br>Tc=80°C                    | IEC 61347-2-13<br>IEC 62384 | TUV                                 |  |
| Drivers                 | A    | Meanwell                               | PLD-16 Series                             | 17W 50-60Hz 0,35-1,4A 200-240V<br>Tc=70°C                     | IEC 61347-2-13              | CB                                  |  |
| Drivers                 | A    | Meanwell                               | PLD-25 Series                             | 25W 50-60Hz<br>0.35/0.7/1.05/1.4A<br>100-240Vac<br>Tc=70°C    | IEC 61347-2-13              | CB                                  |  |
| Drivers                 | A    | Meanwell                               | PLD-40 Series                             | 40W 50-60Hz 0.35-1.75A 200-240Vac<br>Tc=90°C                  | IEC 61347-2-13              | CB                                  |  |
| Driver                  | A    | LG                                     | PISE-A027M                                | 27W 0,2-1A 120-277V 50-60Hz<br>Tc=80°C                        | IEC 61347-2-13              | CB / UL                             |  |
| Driver                  | A    | LG                                     | PISE-A027A                                | 27W 1A 120-277V<br>50-60Hz Tc=80°C                            | IEC 61347-2-13              | CB / UL                             |  |
| Drivers                 | A    | Moons                                  | PU025H Series                             | 25W 50-60Hz 0,35-2,1A 100-240V<br>Tc=90°C                     | IEC 61347-2-13              | TUV                                 |  |
| Drivers                 | A    | PHILIPS                                | Xi LP/FP 22W<br>0,3-1,0A 230V<br>S175 sXt | 22W 50-60Hz 0,3-1,05A 198-264V<br>Tc=85°C                     | IEC 61347-2-13              | CB                                  |  |
| Drivers                 | A    | PHILIPS                                | Xi FP/LP 40W<br>0,3-1,0A 230V<br>S175 sXt | 40W 50-60Hz 0,3-1,05A 198-264V<br>Tc=90°C                     | IEC 61347-2-13              | CB                                  |  |
| Drivers                 | A    | TRIDONIC                               | LCI 27W                                   | 27W 50-60Hz 1A<br>220-240V<br>Tc=70°C                         | IEC 61347-2-13              | OVE                                 |  |
| EMI filter              | A    | TE connectivity                        | Corcom 2FB3                               | I <sub>max</sub> 2A<br>V <sub>max</sub> = 250Vac/d<br>Tc 50°C | IEC 60939-2                 | VDE                                 |  |
| Surge protection Device | A    | CITEL                                  | MLPC1-230L-R                              | 277 V, T85<br>10kA<br>20KV (DM)<br>120KV (CM)                 | IEC 61643-11                | ENEC                                |  |
| VDR                     | A    | Littelfuse                             | TM0V                                      | 275 Vac<br>Tc=85°C<br>10kA                                    | IEC 61051-2-2               | VDE                                 |  |
| FUSE HOLDER             | A    | Mersen                                 | 10x38mm<br>CCR8-10 Series                 | 20-32A 400V   | IEC 60269-1 & -2            | ENEC                                |  |
| FUSE HOLDER             | A    | ADELS                                  | 403/503 SI                                | 400V 10A 5x20mm   | IEC 60127-1 & -6            | VDE                                 |  |
| FUSE                    | A    | Mersen                                 | FR10 10x38mm                              | 0.5-32A 400-500V  | IEC 60269-1 & -2            | ENEC                                |  |
| FUSE                    | A    | Littelfuse                             | 5x20mm<br>213 Series                      | 0.2-6.3A 250V   | IEC 60269-1 & -2            | VDE                                 |  |
| Terminal                | A    | ADELS                                  | 500 Series                                | 0.5-4mm <sup>2</sup> 450V                                     | EN 60998-1&2-2              | VDE                                 |  |
| Terminal                | A    | ADELS                                  | 900-07 & 08                               | 0.5-4mm <sup>2</sup> 450V                                     | EN 60998-1&2-2              | VDE / UL                            |  |
| Terminal                | A    | WIELAND                                | ST18,<br>GST18I                           | 12-16A 250V 0,75-2,5mm <sup>2</sup>                           | EN 60998-1&2-2              | VDE / UL                            |  |

| IEC 60598-2-3 |                    |  |  |                 |  |         |
|---------------|--------------------|--|--|-----------------|--|---------|
| Clause        | Requirement + Test |  |  | Result - Remark |  | Verdict |

|             |   |    |   |                                   |                        |                        |
|-------------|---|----|---|-----------------------------------|------------------------|------------------------|
| Led Modules | A | LG | 6 Leds LG3535<br>G4TOP@1050<br>mA<br>8 Leds LG3535<br>G4TOP @1000<br>mA | RG2@20cm<br>RG1@40cm<br>RG0@325cm | IEC/EN 62031-<br>62471 | Tested in<br>appliance |
| Led Modules | A | LG | 6 Leds LG3535<br>G4L@1050 mA  | RG2@20cm<br>RG1@50cm<br>RG0@500cm | IEC/EN 62031-<br>62471 | Tested in<br>appliance |

Supplementary information:

<sup>1)</sup> Provided evidence ensures the agreed level of compliance. See OD-CB2039.

The codes above have the following meaning:

- A - The component is replaceable with another one, also certified, with equivalent characteristics
- B - The component is replaceable if authorised by the test house
- C - Integrated component tested together with the appliance
- D - Alternative component

| <b>IEC 60598-2-3</b> |                    |                 |         |
|----------------------|--------------------|-----------------|---------|
| Clause               | Requirement + Test | Result - Remark | Verdict |

| <b>ANNEX 2</b> | <b>TABLE: Temperature measurements, thermal tests of Section 12</b>                       |                          |   |
|----------------|---|--------------------------|---|
|                | Type reference .....  | VOLTANA-0                | — |
|                | Lamp used .....   | 6 Led's LG3535           | — |
|                | Lamp control gear used .....  | MeanWell PLM-25 @ 1050mA | — |
|                | Mounting position of luminaire .....  | Horizontal               | — |
|                | Supply wattage (W) .....  |                          | — |
|                | Supply current (A) .....  |                          | — |
|                | Calculated power factor .....   |                          | — |
|                | Table: measured temperatures corrected for ta = 35 °C:                                    |                          |   |
|                | - abnormal operating mode .....   |                          | — |
|                | - test 1: rated voltage .....   |                          | — |
|                | - test 2: 1,06 times rated voltage or 1,05 times rated wattage .....                      |                          | — |
|                | - test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage ..... |                          | — |
|                | - test 4: 1,1 times rated voltage or 1,05 times rated wattage .....                       |                          | — |
|                | Through wiring or looping-in wiring loaded by a current of A during the test .....        |                          | — |

| <b>Temperature measurements, (°C)</b> |         |                      |        |        |       |                        |       |
|---------------------------------------|---------|----------------------|--------|--------|-------|------------------------|-------|
| Part                                  | Ambient | Clause 12.4 – normal |        |        |       | Clause 12.5 – abnormal |       |
|                                       |         | test 1               | test 2 | test 3 | limit | test 4                 | limit |
| Convertor Tc                          | 35      | 78                   |        |        | 80    |                        |       |
| VDR x 3 Tc                            | 35      | 52                   |        |        | 85    |                        |       |
| Supply wiring                         | 35      | 52                   |        |        | 90    |                        |       |
| Led Module                            | 35      | 76                   |        |        | 85    |                        |       |
| Terminal                              | 35      | 52                   |        |        | 110   |                        |       |
| Internal wiring                       | 35      | 52                   |        |        | 90    |                        |       |
|                                       |         |                      |        |        |       |                        |       |

Supplementary information:  
Corrected for Ta 35 °C

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| ANNEX 2 | TABLE: Temperature measurements, thermal tests of Section 12                              |                 |   |
|---------|---|-----------------|---|
|         | Type reference .....  | VOLTANA-0       | — |
|         | Lamp used .....   | 6 Led's LG3535  | — |
|         | Lamp control gear used .....  | PLD-16 @ 700 mA | — |
|         | Mounting position of luminaire .....  | Horizontal      | — |
|         | Supply wattage (W) .....  |                 | — |
|         | Supply current (A) .....  |                 | — |
|         | Calculated power factor .....   |                 | — |
|         | Table: measured temperatures corrected for ta = 50 °C:                                    |                 |   |
|         | - abnormal operating mode .....   |                 | — |
|         | - test 1: rated voltage .....   |                 | — |
|         | - test 2: 1,06 times rated voltage or 1,05 times rated wattage .....                      |                 | — |
|         | - test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage ..... |                 | — |
|         | - test 4: 1,1 times rated voltage or 1,05 times rated wattage .....                       |                 | — |
|         | Through wiring or looping-in wiring loaded by a current of A during the test .....        |                 | — |

| Temperature measurements, (°C) |         |                      |        |        |       |                        |       |
|--------------------------------|---------|----------------------|--------|--------|-------|------------------------|-------|
| Part                           | Ambient | Clause 12.4 – normal |        |        |       | Clause 12.5 – abnormal |       |
|                                |         | test 1               | test 2 | test 3 | limit | test 4                 | limit |
| Convertor Tc                   | 50      | 70                   |        |        | 70    |                        |       |
| VDR x 3 Tc                     | 50      | 60                   |        |        | 85    |                        |       |
| Supply wiring                  | 50      | 60                   |        |        | 90    |                        |       |
| Led Module                     | 50      | 75                   |        |        | 85    |                        |       |
| Terminal                       | 50      | 60                   |        |        | 110   |                        |       |
| Internal wiring                | 50      | 60                   |        |        | 90    |                        |       |
|                                |         |                      |        |        |       |                        |       |

Supplementary information:  
Corrected for Ta 50 °C

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| ANNEX 2 | TABLE: Temperature measurements, thermal tests of Section 12                              |                  |   |
|---------|---|------------------|---|
|         | Type reference .....  | VOLTANA-0        | — |
|         | Lamp used .....   | 8 Led's LG3535   | — |
|         | Lamp control gear used .....  | LCI 27W @ 1000mA | — |
|         | Mounting position of luminaire .....  | Horizontal       | — |
|         | Supply wattage (W) .....  |                  | — |
|         | Supply current (A) .....  |                  | — |
|         | Calculated power factor .....   |                  | — |
|         | Table: measured temperatures corrected for ta = 30 °C:                                    |                  |   |
|         | - abnormal operating mode .....   |                  | — |
|         | - test 1: rated voltage .....   |                  | — |
|         | - test 2: 1,06 times rated voltage or 1,05 times rated wattage .....                      |                  | — |
|         | - test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage ..... |                  | — |
|         | - test 4: 1,1 times rated voltage or 1,05 times rated wattage .....                       |                  | — |
|         | Through wiring or looping-in wiring loaded by a current of A during the test .....        |                  | — |

| Temperature measurements, (°C) |         |                      |        |        |       |                        |       |
|--------------------------------|---------|----------------------|--------|--------|-------|------------------------|-------|
| Part                           | Ambient | Clause 12.4 – normal |        |        |       | Clause 12.5 – abnormal |       |
|                                |         | test 1               | test 2 | test 3 | limit | test 4                 | limit |
| Convertor Tc                   | 30      | 64                   |        |        | 70    |                        |       |
| SPD Tc                         | 30      | 53                   |        |        | 85    |                        |       |
| Supply wiring                  | 30      | 53                   |        |        | 90    |                        |       |
| Led Module                     | 30      | 80                   |        |        | 85    |                        |       |
| Terminal                       | 30      | 53                   |        |        | 110   |                        |       |
| Internal wiring                | 30      | 53                   |        |        | 90    |                        |       |
|                                |         |                      |        |        |       |                        |       |

Supplementary information:  
Corrected for Ta 30°C



| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| ANNEX 2 | TABLE: Temperature measurements, thermal tests of Section 12                              |                      |   |
|---------|---|----------------------|---|
|         | Type reference .....  | VOLTANA-0            | — |
|         | Lamp used .....   | 8 Led's LG3535       | — |
|         | Lamp control gear used .....  | Philips 40W @ 1050mA | — |
|         | Mounting position of luminaire .....  | Horizontal           | — |
|         | Supply wattage (W) .....  |                      | — |
|         | Supply current (A) .....  |                      | — |
|         | Calculated power factor .....   |                      | — |
|         | Table: measured temperatures corrected for ta = 35 °C:                                    |                      |   |
|         | - abnormal operating mode .....   |                      | — |
|         | - test 1: rated voltage .....   |                      | — |
|         | - test 2: 1,06 times rated voltage or 1,05 times rated wattage .....                      |                      | — |
|         | - test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage ..... |                      | — |
|         | - test 4: 1,1 times rated voltage or 1,05 times rated wattage .....                       |                      | — |
|         | Through wiring or looping-in wiring loaded by a current of A during the test .....        |                      | — |

| Temperature measurements, (°C) |         |                      |        |        |       |                        |       |
|--------------------------------|---------|----------------------|--------|--------|-------|------------------------|-------|
| Part                           | Ambient | Clause 12.4 – normal |        |        |       | Clause 12.5 – abnormal |       |
|                                |         | test 1               | test 2 | test 3 | limit | test 4                 | limit |
| Convertor Tc                   | 30      | 84                   |        |        | 90    |                        |       |
| SPD Tc                         | 30      | 53                   |        |        | 85    |                        |       |
| Supply wiring                  | 30      | 53                   |        |        | 90    |                        |       |
| Led Module                     | 30      | 74                   |        |        | 85    |                        |       |
| Terminal                       | 30      | 53                   |        |        | 110   |                        |       |
| Internal wiring                | 30      | 53                   |        |        | 90    |                        |       |
|                                |         |                      |        |        |       |                        |       |

Supplementary information:  
Corrected for Ta 35°C

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

| ANNEX 2 | TABLE: Temperature measurements, thermal tests of Section 12                              |                                      |   |
|---------|---|--------------------------------------|---|
|         | Type reference .....  | VOLTANA-0                            | — |
|         | Lamp used .....   | 6 Led's LG3535                       | — |
|         | Lamp control gear used.....   | Moons @ 1050mA<br>(MeanWell @ 350mA) | — |
|         | Mounting position of luminaire .....  | Horizontal                           | — |
|         | Supply wattage (W).....   |                                      | — |
|         | Supply current (A).....   |                                      | — |
|         | Calculated power factor.....  |                                      | — |
|         | Table: measured temperatures corrected for ta = 20 °C (35°C):                             |                                      |   |
|         | - abnormal operating mode.....  |                                      | — |
|         | - test 1: rated voltage .....   |                                      | — |
|         | - test 2: 1,06 times rated voltage or 1,05 times rated wattage .....                      |                                      | — |
|         | - test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage ..... |                                      | — |
|         | - test 4: 1,1 times rated voltage or 1,05 times rated wattage .....                       |                                      | — |
|         | Through wiring or looping-in wiring loaded by a current of A during the test .....        |                                      | — |

| Temperature measurements, (°C) |           |                      |        |        |         |                        |       |
|--------------------------------|-----------|----------------------|--------|--------|---------|------------------------|-------|
| Part                           | Ambient   | Clause 12.4 – normal |        |        |         | Clause 12.5 – abnormal |       |
|                                |           | test 1               | test 2 | test 3 | limit   | test 4                 | limit |
| Convertor Tc                   | 20 (35°C) | 42 (57)              |        |        | 90 (75) |                        |       |
| SPD Tc                         | 20 (35°C) | 33 (38)              |        |        | 85      |                        |       |
| Supply wiring                  | 20 (35°C) | 33 (38)              |        |        | 90      |                        |       |
| Led Module                     | 20 (35°C) | 74 (45)              |        |        | 85      |                        |       |
| Terminal                       | 20 (35°C) | 33 (38)              |        |        | 110     |                        |       |
| Internal wiring                | 20 (35°C) | 33 (38)              |        |        | 90      |                        |       |
| EMI filter                     | (35°C)    | (45)                 |        |        | 50      |                        |       |

Supplementary information:  
Corrected for Ta 20°C (35°C)

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

|                |  |  |     |
|----------------|--|--|-----|
| <b>ANNEX 3</b> | <b>Screw terminals (part of the luminaire)</b>       |  | N/A |
| <b>(14)</b>    | <b>SCREW TERMINALS</b>                               |  | N/A |
| (14.2)         | Type of terminal .....                               |  | —   |
|                | Rated current (A) .....                              |  | —   |
| (14.3.2.1)     | One or more conductors                               |  | N/A |
| (14.3.2.2)     | Special preparation                                  |  | N/A |
| (14.3.2.3)     | Terminal size  |  | N/A |
|                | Cross-sectional area (mm <sup>2</sup> ) .....        |  | —   |
| (14.3.3)       | Conductor space (mm) .....                           |  | N/A |
| (14.4)         | Mechanical tests                                     |  | N/A |
| (14.4.1)       | Minimum distance                                     |  | N/A |
| (14.4.2)       | Cannot slip out                                      |  | N/A |
| (14.4.3)       | Special preparation                                  |  | N/A |
| (14.4.4)       | Nominal diameter of thread (metric ISO thread) ..... |  | N/A |
|                | External wiring                                      |  | N/A |
|                | No soft metal  |  | N/A |
| (14.4.5)       | Corrosion  |  | N/A |
| (14.4.6)       | Nominal diameter of thread (mm) .....                |  | N/A |
|                | Torque (Nm) .....                                    |  | N/A |
| (14.4.7)       | Between metal surfaces                               |  | N/A |
|                | Lug terminal   |  | N/A |
|                | Mantle terminal                                      |  | N/A |
|                | Pull test; pull (N) .....                            |  | N/A |
| (14.4.8)       | Without undue damage                                 |  | N/A |

|                |  |  |     |
|----------------|--|--|-----|
| <b>ANNEX 4</b> | <b>Screwless terminals (part of the luminaire)</b> |  | N/A |
| <b>(15)</b>    | <b>SCREWLESS TERMINALS</b>                         |  | N/A |
| (15.2)         | Type of terminal .....                             |  | —   |
|                | Rated current (A) .....                            |  | —   |
| (15.3.1)       | Material   |  | N/A |
| (15.3.2)       | Clamping   |  | N/A |

| IEC 60598-2-3 |   |                 |         |
|---------------|---|-----------------|---------|
| Clause        | Requirement + Test  | Result - Remark | Verdict |
| (15.3.3)      | Stop  |                 | N/A     |
| (15.3.4)      | Unprepared conductors   |                 | N/A     |
| (15.3.5)      | Pressure on insulating material   |                 | N/A     |
| (15.3.6)      | Clear connection method   |                 | N/A     |
| (15.3.7)      | Clamping independently  |                 | N/A     |
| (15.3.8)      | Fixed in position   |                 | N/A     |
| (15.3.10)     | Conductor size  |                 | N/A     |
|               | Type of conductor   |                 | N/A     |
| (15.5.1)      | Terminals internal wiring   |                 | N/A     |
| (15.5.1.1)    | Pull test spring-type terminals (4 N, 4 samples) .....                            |                 | N/A     |
| (15.5.1.2)    | Pull test pin or tab terminals (4 N, 4 samples) .....                             |                 | N/A     |
|               | Insertion force not exceeding 50 N  |                 | N/A     |
| (15.5.1.2)    | Permanent connections: pull-off test (20 N)                                       |                 | N/A     |
| (15.5.2)      | Electrical tests  |                 | N/A     |
|               | Voltage drop (mV) after 1 h (4 samples) .....                                     |                 | N/A     |
|               | Voltage drop of two inseparable joints  |                 | N/A     |
|               | Number of cycles:   |                 | —       |
|               | Voltage drop (mV) after 10th alt. 25th cycle (4 samples) .....                    |                 | N/A     |
|               | Voltage drop (mV) after 50th alt. 100th cycle (4 samples) .....                   |                 | N/A     |
|               | After ageing, voltage drop (mV) after 10th alt. 25th cycle (4 samples) .....      |                 | N/A     |
|               | After ageing, voltage drop (mV) after 50th alt. 100th cycle (4 samples) .....     |                 | N/A     |
| (15.6)        | Terminals external wiring   |                 | N/A     |
|               | Terminal size and rating  |                 | N/A     |
| (15.6.2.1)    | Pull test spring-type terminals or welded connections (4 samples); pull (N) ..... |                 | N/A     |
|               | Pull test pin or tab terminals (4 samples); pull (N) .....                        |                 | N/A     |

| IEC 60598-2-3 |                    |                 |  |  |  |  |  |  |         |  |
|---------------|--------------------|-----------------|--|--|--|--|--|--|---------|--|
| Clause        | Requirement + Test | Result - Remark |  |  |  |  |  |  | Verdict |  |

| (15.6.3.1)                 | TABLE: Contact resistance test                             |   |   |   |   |   |   |   |   |    | N/A |
|----------------------------|--|---|---|---|---|---|---|---|---|----|-----|
|                            | Voltage drop (mV) after 1 h                                |   |   |   |   |   |   |   |   |    | —   |
| terminal                   | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |     |
| voltage drop (mV)          |  |   |   |   |   |   |   |   |   |    |     |
|                            | Voltage drop of two inseparable joints                     |   |   |   |   |   |   |   |   |    | N/A |
|                            | Voltage drop after 10th alt. 25th cycle                    |   |   |   |   |   |   |   |   |    | N/A |
|                            | Max. allowed voltage drop (mV).....:                       |   |   |   |   |   |   |   |   |    | —   |
| terminal                   | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |     |
| voltage drop (mV)          |  |   |   |   |   |   |   |   |   |    |     |
|                            | Voltage drop after 50th alt. 100th cycle                   |   |   |   |   |   |   |   |   |    | N/A |
|                            | Max. allowed voltage drop (mV).....:                       |   |   |   |   |   |   |   |   |    | —   |
| terminal                   | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |     |
| voltage drop (mV)          |  |   |   |   |   |   |   |   |   |    |     |
|                            | Continued ageing: voltage drop after 10th alt. 25th cycle  |   |   |   |   |   |   |   |   |    | N/A |
|                            | Max. allowed voltage drop (mV).....:                       |   |   |   |   |   |   |   |   |    | —   |
| terminal                   | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |     |
| voltage drop (mV)          |  |   |   |   |   |   |   |   |   |    |     |
|                            | Continued ageing: voltage drop after 50th alt. 100th cycle |   |   |   |   |   |   |   |   |    | N/A |
|                            | Max. allowed voltage drop (mV).....:                       |   |   |   |   |   |   |   |   |    | —   |
| terminal                   | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |     |
| voltage drop (mV)          |  |   |   |   |   |   |   |   |   |    |     |
| Supplementary information: |  |   |   |   |   |   |   |   |   |    |     |

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

**Installation notice and Pictures**

# VOLTANA 0

**IK**  
08

|            |  |            |   |            |   |            |  |
|------------|--|------------|---|------------|---|------------|--|
| <b>ENG</b> | The light source fitted in this luminaire shall only be replaced by a Schröder employee or agent or a similar qualified person.                      | <b>UKR</b> | Джерело світла, встановлене в цій світельнику, підлягає заміні лише працівником спеціалізованої фірми.  | <b>NLD</b> | De lichtbron in dit verlichtingsarmatuur zal alleen vervangen worden door een medewerker, agent of vergelijkbaar getoetste persoon van Schröder.                  | <b>RON</b> | Sursa de lumină încorporată în acest aparat de iluminat va fi înlocuită doar de către un angajat al Schröder, de un agent al companiei sau de o persoană cu calificări similare. |
| <b>SPA</b> | La fuente de luz instalada en este luminaria solo puede ser sustituida por Schröder o un agente cualificado.   | <b>ITA</b> | La sorgente luminosa montata in questo apparecchio potrà essere sostituita esclusivamente da un addetto Schröder o da una persona perentri qualificata. | <b>DEU</b> | Die eingebaute Lichtquelle in der Leuchte sollte nur von einem Schröder Mitarbeiter oder Vertreter oder einer ähnlichen qualifizierten Person ersetzt werden.     | <b>HUN</b> | A lámpatestő szerelt fényforrás (LED-modul) cseréjét csak a gyártó, annak szerelői szakszolgálat, vagy erre kiképzett szakember végezheti!                                       |
| <b>FRA</b> | La source de lumière intégrée dans ce luminaire peut uniquement être remplacée par un employé de Schröder, un agent ou une autre personne qualifiée. | <b>POL</b> | Źródło światła zamontowane w tej oprawie może być tylko wymienione przez pracownika Schröder lub przez inną wykwalifikowaną osobę.                      | <b>POR</b> | A fonte de luz montada nesta luminária só pode ser substituída por um funcionário ou agente da Schröder ou por profissional qualificado autorizado para o efeito. | <b>SRP</b> | Zamenu svetilnega izvora ugrađenog u ovoj svetiljki će izvršiti samo Schröder-ov radnik, ovlašćeni predstavnik ili slična stručna osoba.   |
| <b>CHI</b> | 该灯具内的光源仅可由施耐德员工、指定代理商或具有类似资质的人员进行更换。   | <b>VIE</b> | Nguồn sáng được lắp trong bộ đèn này chỉ được thay thế bởi nhân viên Schröder hoặc đại lý hoặc người có trình độ tương đương.                           | <b>RUS</b> | Источник света, установленный в этом светильнике, должен заменяться только сотрудниками Schröder, или специалистами аналогичной квалификации.                     | <b>SLK</b> | Výmena svetelného zdroja (LED modulu) je možná len výrobcom, resp. len ním vyškolenými osobami!  |

**A**

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

**1**

**2**

**3**

**4**

**5**


|      | Ø42     | Ø48     | Ø60 |
|------|---------|---------|-----|
| -15° | M8 x 45 | M8 x 70 |     |
| -10° |         |         |     |
| -5°  |         |         |     |
| 0°   |         |         |     |
| +5°  |         |         |     |

| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |





| IEC 60598-2-3 |                    |                 |         |
|---------------|--------------------|-----------------|---------|
| Clause        | Requirement + Test | Result - Remark | Verdict |

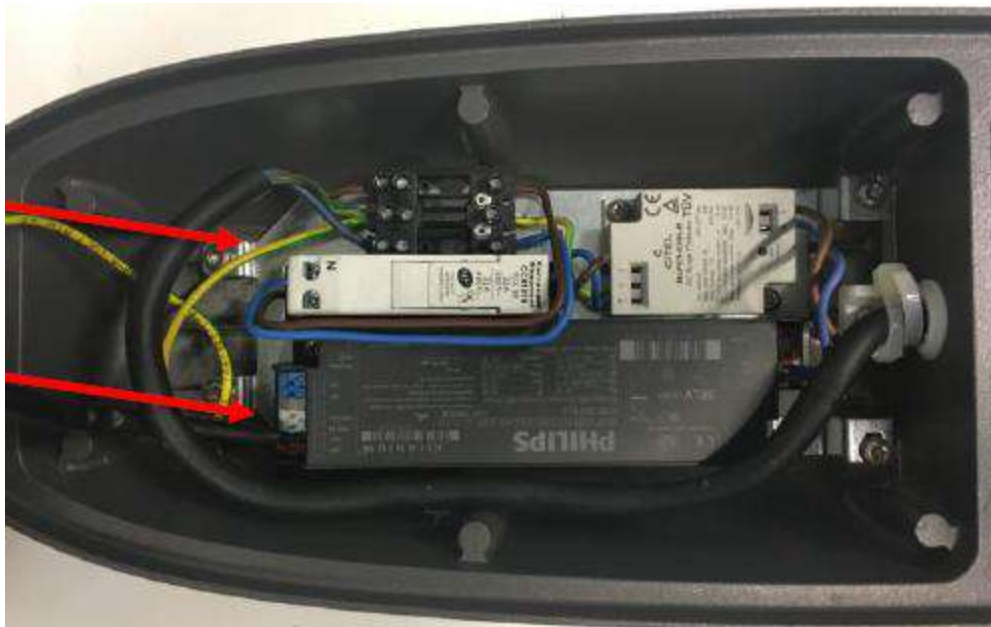

## IEC60598\_2\_3K - ATTACHMENT

| Clause | Requirement – Test | Result - Remark | Verdict |
|--------|--------------------|-----------------|---------|
|--------|--------------------|-----------------|---------|

**ATTACHMENT TO TEST REPORT IEC 60598-2-3**  
**EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES**  
**LUMINAIRES**  
**PART 2: PARTICULAR REQUIREMENTS**  
**SECTION 3: LUMINAIRES FOR ROAD AND STREET LIGHTING**

**Differences according to** ..... : EN 60598-2-3:2003 + A1:2011 used in conjunction with EN 60598-1:2015

**Annex Form No.** ..... : EU\_GD\_IEC60598\_2\_3K

**Annex Form Originator** ..... : IMQ S.p.A.

**Master Annex Form**..... : 2016-12

**Copyright © 2016 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.**

|  |  |          |
|--|--|----------|
|  | <b>CENELEC COMMON MODIFICATIONS (EN)</b> | <b>P</b> |
|--|--|----------|

|                |   |          |
|----------------|---|----------|
| <b>3.5 (3)</b> | <b>MARKING</b>  | <b>P</b> |
| 3.5 (3.3.101)  | For luminaires not supplied with terminal block:<br>Adequate warning on the package | N/A      |

|                |                                    |     |
|----------------|------------------------------------|-----|
| <b>3.6 (4)</b> | <b>CONSTRUCTION</b>                |     |
| 3.6 (4.11.6)   | Electro-mechanical contact systems | N/A |

|                 |  |     |
|-----------------|--|-----|
| <b>3.10 (5)</b> | <b>EXTERNAL AND INTERNAL WIRING</b>                                      |     |
| 3.10 (5.2.1)    | Connecting leads   | N/A |
|                 | - without a means for connection to the supply                           | N/A |
|                 | - terminal block specified   | N/A |
|                 | - relevant information provided  | N/A |
|                 | - compliance with 4.6, 4.7.1, 4.7.2, 4.10.1, 11.2, 12 and 13.2 of Part 1 | N/A |
| 3.10 (5.2.2)    | Cables equal to EN 50525   | N/A |
|                 | Replace table 5.1 – Supply cord  | N/A |

|                  |  |     |
|------------------|--|-----|
| <b>3.12 (12)</b> | <b>ENDURANCE TESTS AND THERMAL TESTS</b>   |     |
| 3.12 (12.4.2c)   | Thermal test (normal operation)<br>see footnote c to table 12.2 relating to unsleeved fixed wiring | N/A |

|           |   |     |
|-----------|---|-----|
| <b>ZB</b> | <b>ANNEX ZB, SPECIAL NATIONAL CONDITIONS (EN)</b>       |     |
| (3.3)     | DK: power supply cords of class I luminaires with label | N/A |
| (4.5.1)   | DK: socket-outlets                                      | N/A |

## IEC60598\_2\_3K - ATTACHMENT

| Clause | Requirement – Test | Result - Remark | Verdict |
|--------|--------------------|-----------------|---------|
|--------|--------------------|-----------------|---------|

|         |                              |  |  |
|---------|------------------------------|--|--|
| (5.2.1) | CY, DK, FI, GB: type of plug |  |  |
|---------|------------------------------|--|--|

| <b>ZC</b> | <b>ANNEX ZC, NATIONAL DEVIATIONS (EN)</b>   |  |     |
|-----------|---|--|-----|
| (4 & 5)   | FR: Shuttered socket-outlets 10/16A   |  | N/A |
|           | FR: Safety requirements for high buildings<br><br>(Arrêté du 30 décembre 2011 portant règlement de sécurité pour la construction des immeubles de grande hauteur et leur protection contre les risques d'incendie et de panique; Section VIII; Article GH 48, Eclairage)<br><br>Glow-wire test for outer parts of luminaires: |  |     |
|           | - 850°C for luminaires in stairways and horizontal travel paths   |  | N/A |
|           | - 650°C for indoor luminaires   |  | N/A |
|           | GB: Requirements according to United Kingdom Building Regulation  |  | N/A |

# Laboratory Service PHYSICAL TEST REPORT



**R-Tech**  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA-0 / 6 led's / Moons PU025H105AQ 0-10V driver

Sample n°: P-E16371, P-E16375

**Test purpose:** Electrical measurements @ 1.05A

**Remarks:**

Test request n°: P-D16542

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: CLOSSET Frédéric

Load: 6 Led's  
Typical Vf: 3,1 V

Driver: Moon's PU025H105AQ\_0-10V Series

Power supply: Elgar ET3500 230V 50Hz

Measurement device: Fluke Norma 4000 HF power meter

**CONCLUSIONS:**

PF: 0.97

Efficiency: 82.1 %

THD: 9.1 %

Harmonics we are under the 25W => no measurements



Duplicate to: Mr M. Thijs  
LAB 05/10/2016  
L. Maghe

//P-16CR542

A handwritten signature in blue ink, appearing to read "Maghe".

# Laboratory Service PHYSICAL TEST REPORT



**R-Tech**  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA-0 8 led's class II PHILIPS driver 40 W

Sample n°: P-E17149

**Test purpose:** EMC tests according to EN 55015 & EN 61547 Standards

**Remarks:**

Test request n°: P-D17187

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: EMC - ULg

**Test Summary**

EN 55015 & EN 61547 Standards

**Emission**

| Standard                    | Limit / Level    | Result |      |
|-----------------------------|------------------|--------|------|
|                             |                  | PASS   | FAIL |
| EN 55015 Conducted Emission | 9kHz- 30 MHz     | X      |      |
| EN 55015 Annex B            | 30 MHz – 300 MHz | X      |      |
| EN 61000-3-2                | Class C a)       | X      |      |

**Immunity**

| Standard      | Limit / Level   | Result |      |
|---------------|---|--------|------|
|               |   | PASS   | FAIL |
| EN 61000-4-2  | 4 kV at contact<br>2, 4 & 8 kV in the air<br>Criteria B required  | X      |      |
| EN 61000-4-3  | 3 V/m 80 MHz – 1 GHz<br>AM 80 % 1 kHz<br>Criteria A required      | X      |      |
| EN 61000-4-4  | 1 kV 5 kHz<br>Criteria B required                                 | X      |      |
| EN 61000-4-5  | 0.5 & 1 kV MD<br>Criteria C required                              | X      |      |
| EN 61000-4-5  | Complementary levels<br>2, 4, 8 & 10 in MD<br>Criteria C required | X      |      |
| EN 61000-4-6  | 3 V 150 kHz – 80 MHz<br>AM 80 % 1 kHz<br>Criteria A required      | X      |      |
| EN 61000-4-11 | 0% U 0.5 period<br>70% U 10 periods<br>Criteria B/C required      | X      |      |

**VOLTANA-0 8 led's class II PHILIPS driver 40 W**

**Driver:** Philips FP 40W 0.3-1A

**EMC Auxiliaries:** Varistors

---

**CONCLUSIONS:**



VOLTANA 0 8 led's driven by PHILIPS FP 40 W driver complies with the CISPR/EN 55015 and EN 61547 Standards.

**Remark:** Surge protection tested OK up to 10 KV for Differential mode for the equipment with eventual Fuse replacement.

---

Duplicate to: Mr Ph. Verbeeck  
LAB 24/04/2014  
G. Cheuvart

//P-17CR187

A handwritten signature in blue ink, appearing to read 'G. Cheuvart', with a large, sweeping flourish extending to the right.

# Laboratory Service PHYSICAL TEST REPORT



**R-Tech**  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA-0 with Glass protector

Sample n°: P-E16420

**Test purpose:** Mechanical impact resistance test following IEC/EN 62262 Standard

**Remarks:**

Test request n°: P-D16604

Folder n°: P-F16041

## TEST CONDITIONS:

Operator: BOMBIL Patrick

Glass thickness: 5 mm

### At pendulum hammer

5 impact points distributed on protector surface

1 impact on clamp

One impact on each point

**Test on 5 samples**

### Test

### Result

**IK08** : Impact energy: 5 joules  
Hammer weight: 1,7 kg  
Height of fall: 29,4 cm

OK for the 5 samples for all tested points

## CONCLUSIONS:



VOLTANA 0 equipped with glass protector complies with IK08 test following IEC/EN 62262 Standard.

Duplicate to: Mr M. Thijs  
LAB 07/11/2016  
L. Maghe

**//P-16CR604**

A handwritten signature in blue ink, appearing to read "Maghe".

# Laboratory Service PHYSICAL TEST REPORT



**R-Tech**  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA-0 equipped with 5205 & 5206 lenses

Sample n°: P-E16393, P-E16460

**Test purpose:** Mechanical impact resistance test following IEC/EN 62262 Standard

**Remarks:**

Test request n°: P-D16655

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: BOMBIL Patrick

VOLTANA-0 equipped with 6 led's

**At pendulum hammer**

5+2 impact points distributed on lens protector surface

One impact on each point

**Test on 5 samples**

**Test**

**IK08 :** Impact energy: 5 joules  
Hammer weight: 1,7 kg  
Height of fall: 29,4 cm

**Result**

OK for all tested samples

**CONCLUSIONS:**



VOLTANA 0 equipped with 5205 & 5206 lenses complies with IK08 test following IEC/EN 62262 Standard.

Duplicate to: Mr M. Thijs  
LAB 23/11/2016  
L. Maghe

//P-16CR655

A handwritten signature in blue ink, appearing to read "M. Thijs".



# Laboratory Service PHYSICAL TEST REPORT



R-Tech  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA 0 – 8 led's – Flat glass protector

Sample n°: P-E16377, P-E16394

**Test purpose:** Tightness test IP66 following IEC/EN 60598-1 Standard

**Remarks:**

Test request n°: P-D16575

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: BOMBIL Patrick

VOLTANA-0 8 led's with flat glass protector

**Pre-conditioning:** endurance test

| Test   | Result |
|--|--------|
| <b>IP6X</b> : -Luminaire switched ON until stable T°<br>-Talcum in suspension (blowing ON)<br>-After 1', luminaire OFF<br>-Talcum for 3 hours  | OK     |
| <b>IPX6</b> : - Luminaire switched ON until stable T°<br>- Luminaire switched OFF and immediately sprayed with water jet<br>- Hose $\Phi$ 12,5 mm<br>- Water pressure: 1 kg/cm <sup>2</sup><br>- Spraying distance: 3 m<br>- Duration of test: 3 minutes | OK     |

**CONCLUSIONS:**



VOLTANA-0 8 led's with flat glass protector complies with IP66 test following IEC/EN 60598-1 Standard.

Duplicate to: Mr M. Thijs  
LAB 21/11/2016  
L. Maghe

//P-16CR575

# Laboratory Service PHYSICAL TEST REPORT



**R-Tech**  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA 0 – 6 led's NW @ 1050 mA

Sample n°: P-E16418

**Test purpose:** Photobiological safety tests following IEC-EN 62471 Standard

**Remarks:**

Test request n°: P-D17045

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: Laborelec

**VOLTANA 0 – 6 led's NW @ 1050 mA**



**Test program:**

Spectral radiance and irradiance measurements of the device under test in the following wavelength ranges:

- 200 to 400 nm : « Actinic UV skin & eye » irradiance
- 315 to 400 nm : « Eye UV-A » irradiance
- 300 to 700 nm : « Blue Light » radiance
- 380 to 1400 nm : « Thermal Retinal » radiance
- 780 to 1400 nm : « Thermal Retinal » radiance (weak visual stimulus)

Determination of the Risk Group classification for each hazard and recommendation about the marking of the product.

**CONCLUSIONS:**

RG2 @ 20 cm

RG1 @ 30 cm

Duplicate to: Mr Ph. Verbeeck  
LAB 08/06/2017  
G. Cheuvart

**//P-17CR045**

A handwritten signature in blue ink, appearing to read "Cheuvart", written over a blue scribble.

# Laboratory Service PHYSICAL TEST REPORT



R-Tech  
Rue de Mons 3 – B-4000 Liège – Belgium  
Tel.: +32 4 224 71 40 – Fax: +32 4 224 25 90  
Member of Schröder Group

**Subject:** VOLTANA-0 / 6 led's / Moons PU025H105AQ 0-10V driver

Sample n°: P-E16371, P-E16375

**Test purpose:** Thermal test @ 1050 mA following IEC/EN 60598-1 Standard

**Remarks:**

Test request n°: P-D16541

Folder n°: P-F16041

**TEST CONDITIONS:**

Operator: CLOSSET Frédérick



Load: 6 Led's

Driver: Moon's PU025H105AQ\_0-10V Series

Tc: 90°C

Working temperature: -40 ~ +60°C according  
To datasheet.

**Measurement device:**

Yokogawa TX10: thermal measurement

Yokogawa WT 210: primary EM

Fluke 87: Led's EM

**Junction Temperature measurement method**

Junction temperature measurement by base temperature measurement and electrical measurement.

$$T^{\circ}_j = T^{\circ}_b + R_{jb} \times P_{led}$$

**CONCLUSIONS:**

Ta (IEC): 55 °C limited by Driver

Tq (IEC): 35 °C limited by Driver

Tq given for 100 khrs of lifetime

T° given without wind effect to comply with IEC 62722-2-1

Duplicate to: Mr M. Thijs

LAB 06/10/2016

L. Maghe

//P-16CR541

# VOLTANA 0

## 5206

|           |                   |
|-----------|-------------------|
| Optic     | 5206              |
| Protector | Integrated lenses |
| Source    | 6 Samsung LH351C  |
| Matrix    | 425722            |



### Characteristics

|             |            |             |             |                  |                    |                   |                       |
|-------------|------------|-------------|-------------|------------------|--------------------|-------------------|-----------------------|
|             |            |             |             |                  |                    |                   |                       |
| 416         | 156        | 91          | 2.6         | IP 66            | IK 08              | I EU              | 0.012                 |
| Length (mm) | Width (mm) | Height (mm) | Weight (kg) | Tightness level* | Impact resistance* | Electrical class* | CxS (m <sup>2</sup> ) |

\* According to IEC-EN60598 and IEC-EN62262

### Features

The ultimate, cost-effective, performing family of luminaires that pays for itself

- Cost-effective and efficient lighting solution for a fast return on investment
- High performance with safety and comfort
- 5 sizes for flexibility
- IP 66 tightness level
- ThermiX® to withstand high temperatures
- Designed to incorporate the Owlet range of control solutions

### Types of application

- Square and park
- Roundabout
- Residential road
- Urban road

### Information for 1000 lm matrix

|              |         |                      |         |                         |                                   |
|--------------|---------|----------------------|---------|-------------------------|-----------------------------------|
| Efficacy (%) | 89.9    | G Class (EN 13201-2) | G3      | I 70-80-90-95 (cd)      | 503 - 28 - X - X                  |
| DLOR (%)     | 89.9    | G* (EN 13201 2015)   | G*3     | CIE flux code N 1→5 (%) | 47.4 - 81.3 - 98.6 - 100.0 - 89.9 |
| ULOR (%)     | 0.0     | Imax (cd)            | 625     | Gradient 90°            | 15cd                              |
| ULR (%)      | 0.0     | Aperture 0-180°      | 74 - 74 | Gradient 270°           | 10cd                              |
| Incl ULR 4%  | -45/45° | Aperture 90-270°     | 22 - 2  |                         |                                   |

## Photometrical characteristics

| LED count          | Colour code | Current (mA) | Luminaire power (W) | Source flux (lm) | Luminaire output flux (lm) | Luminaire efficacy (lm/W) | Peak (cd) | BUG Rating | Voltage (V) |
|--------------------|-------------|--------------|---------------------|------------------|----------------------------|---------------------------|-----------|------------|-------------|
| Ambient temp = 25° |             |              |                     |                  |                            |                           |           |            |             |
| 6                  | NW 740      | 350          | 8                   | 1140             | 1025                       | 128                       | 712       | B0 U0 G0   | 230         |
| 6                  | NW 740      | 500          | 11                  | 1572             | 1413                       | 128                       | 982       | B1 U0 G0   | 230         |
| 6                  | NW 740      | 700          | 15                  | 2104             | 1891                       | 126                       | 1315      | B1 U0 G0   | 230         |
| 6                  | NW 740      | 1000         | 22                  | 2793             | 2510                       | 114                       | 1745      | B1 U0 G1   | 230         |
| 6                  | NW 740      | 1050         | 23                  | 2896             | 2602                       | 113                       | 1809      | B1 U0 G1   | 230         |
| 6                  | WW 730      | 350          | 8                   | 1080             | 971                        | 121                       | 675       | B0 U0 G0   | 230         |
| 6                  | WW 730      | 500          | 11                  | 1489             | 1338                       | 122                       | 930       | B1 U0 G0   | 230         |
| 6                  | WW 730      | 700          | 15                  | 1994             | 1792                       | 119                       | 1245      | B1 U0 G0   | 230         |
| 6                  | WW 730      | 1000         | 22                  | 2646             | 2378                       | 108                       | 1653      | B1 U0 G1   | 230         |
| 6                  | WW 730      | 1050         | 23                  | 2743             | 2465                       | 107                       | 1714      | B1 U0 G1   | 230         |

*Tolerance on flux +- 7% - Tolerance on power +- 5%*

## Summary

### CONCEPT

Family of 6 road LED luminaires

Recommended installation height: between 4.00 and 12.00m

For optimal heat dissipation, the driver and LED engine are in separate compartments and juxtaposed in a horizontal section

### HOUSING & FINISH

- Housing in high-pressure, die-cast aluminium, polyester powder coated
- Colour: RAL 7038

### INSTALLATION

- Luminaire can be fixed by side-entry with a clamp, suitable for 42-60mm diameter
- Built-in inclination steps: -10°, -5°, 0°, 5°
- Post-top adapter diameter 48-60mm or 76mm, tightened with 2 stainless steel screws
- Direct access to the driver compartment with screws for easy maintenance on-site

### OPTICAL UNIT

- Protected against lens degradation by 5mm thick extra-clear hardened glass
- Flatbed PCB with acrylic lens overlay principle
- Various photometric distributions: from narrow road to motorway, medium and large area
- CRI > 70
- ULOR: 0%

### LED lumen depreciation

- Lifetime residual flux @ Tq=25°C @ 100.000 hrs: 350mA & 500mA; 90%; 700mA: 80%; 1A: 70%

### ELECTRICAL

- Class I or Class II
- Input voltage: 120-277V - 50-60Hz
- Power factor > 90% at full load
- Surge protection: 4kV minimum (10kV + 10kA optional)
- Thermal protection on LED PCBA (see Thermix concept)

### STANDARDS & CERTIFICATIONS


- CE
- ENEC
- LM79-80
- ROHS
- Certified for 3G vibration
- All measurements in ISO17025 accredited laboratory

### OPTIONS

- Other RAL or AKZO colours
- Back Light control system
- OWLET remote management
- Custom dimming profile


VOLTANA 0 - 5206 - 6 Samsung LH351C - Integrated lenses - 425722

- Photocell

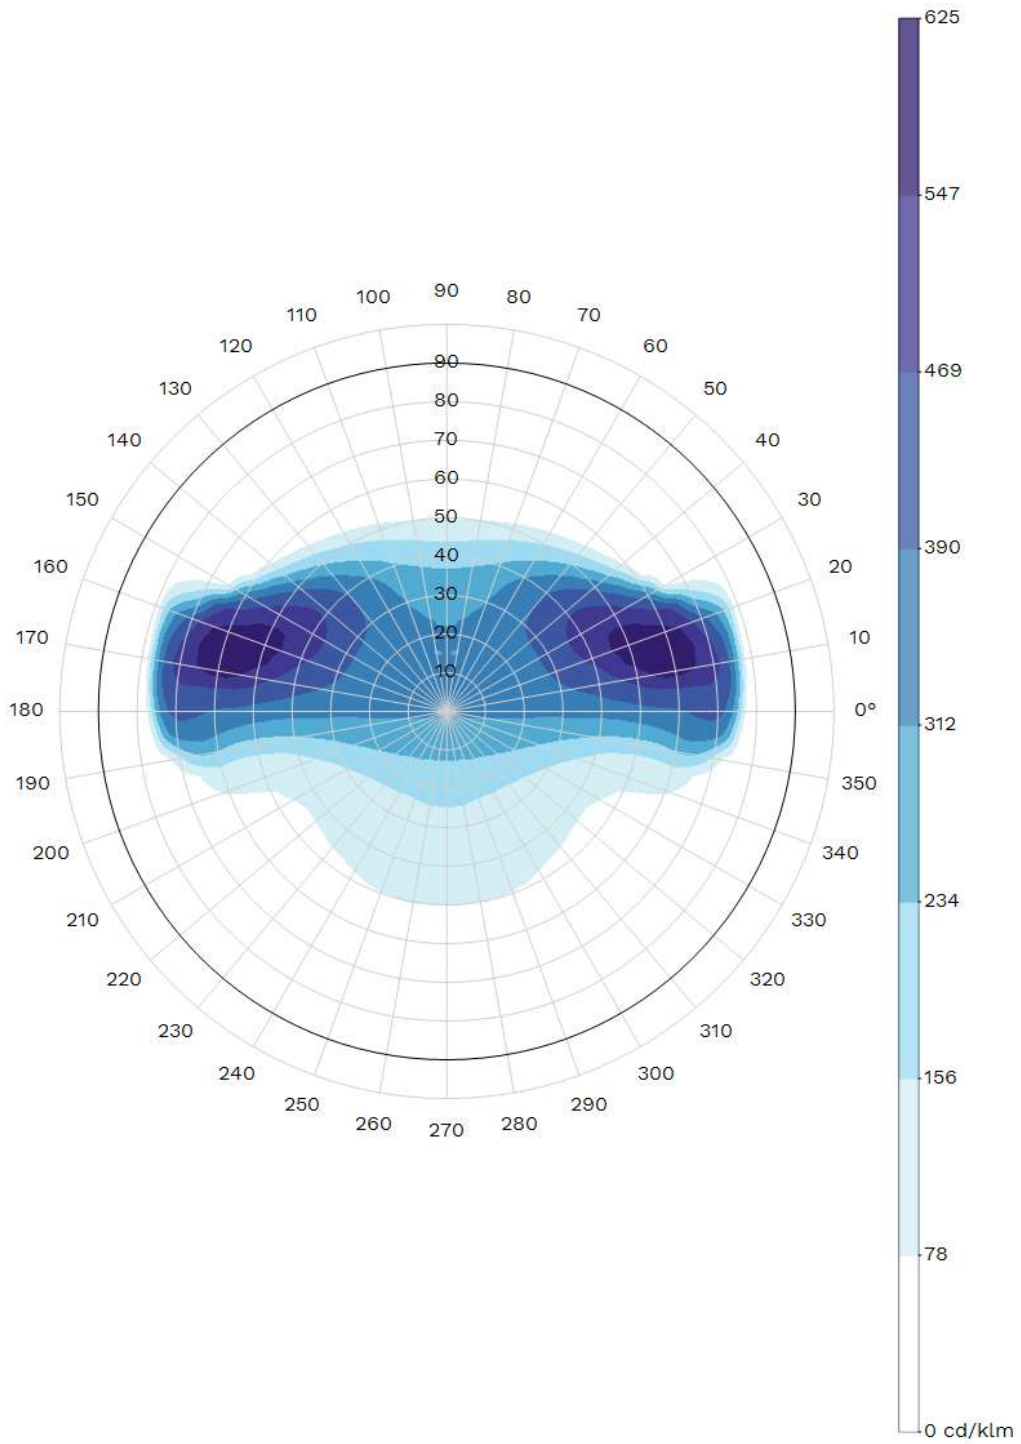





Polar/Cartesian diagram

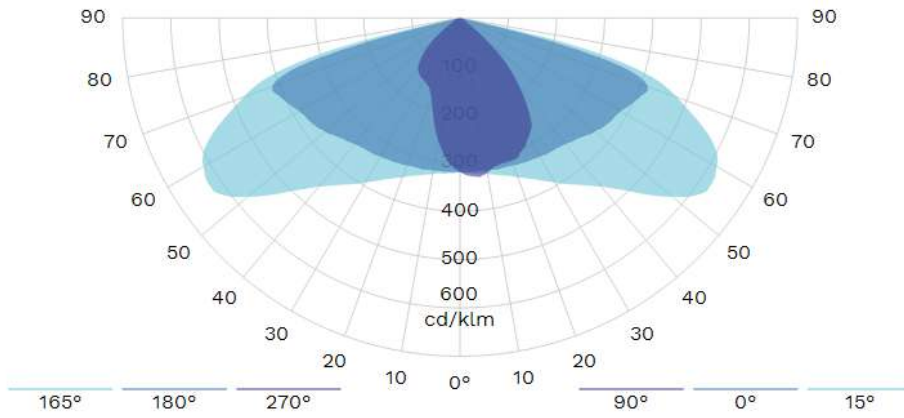


Isolux

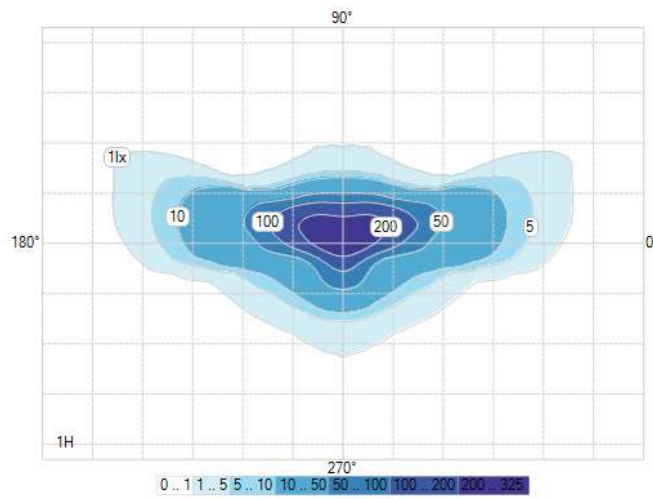


K-Curve

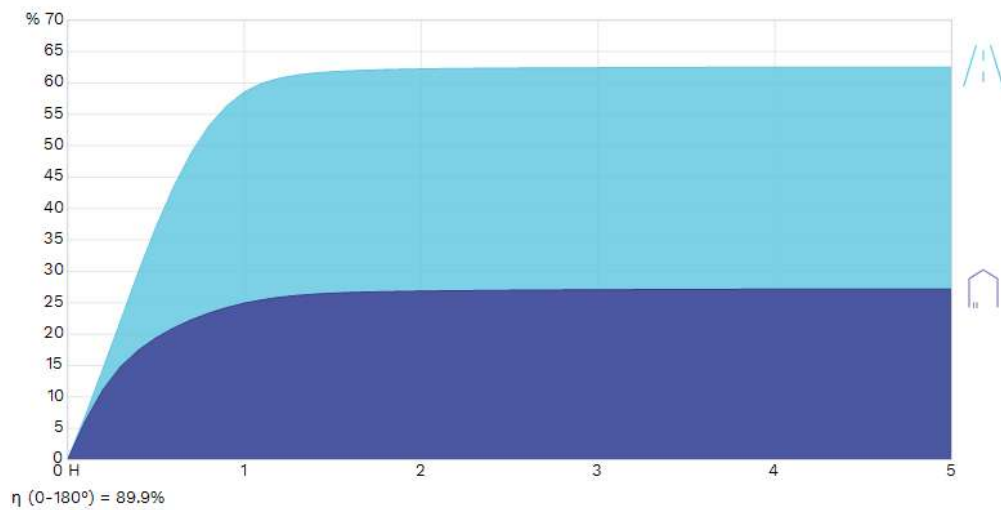

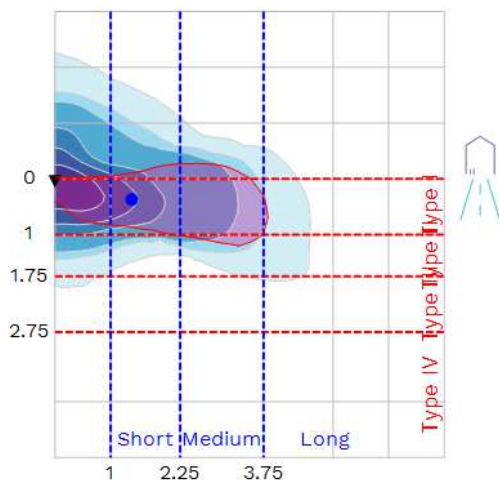


II - Short

Luminaire classification system (LCS)

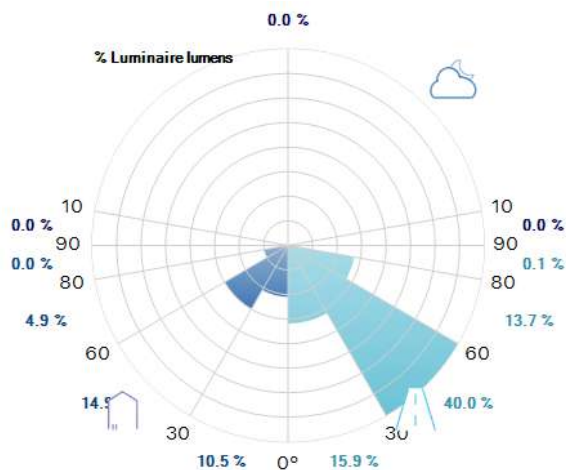

Intensity diagram in max Cone and in CPlane

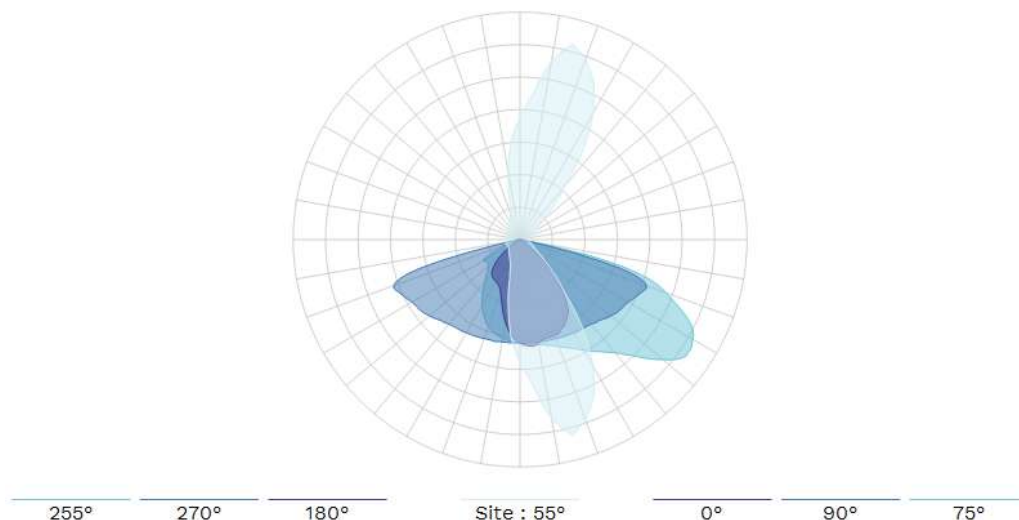

Copyright © 2020 Schröder SA. All rights reserved. Specifications are of an indicative nature and subject to change without notice.

<http://www.schreder.com>

# Voltana



Designer : Thomas Coulbeaut



## The ultimate, cost-effective, performing family of luminaires that pays for itself

Voltana delivers sustainable solutions that dramatically reduce energy consumption and improve lighting levels with the lowest investment. The Voltana family is available with multiple lumen packages thanks to the various sizes, driving currents and numerous light distributions - from very narrow to extra wide - to light all rural and urban landscapes. This luminaire is designed for side-entry and post-top mounting and can be adapted on-site thanks to an incorporated inclination system to optimise the photometry. Voltana can be managed by several control systems. It can operate in a closed independent network with sensors or in a global network of a city through wireless communication.

|       |       |  |
|-------|-------|--|
| IP 66 | IK 08 |  |
|       |       |  |
|       | CE    |  |



## Concept

Voltana is composed of a high-pressure die-cast aluminium body and a fixation piece in steel with one or two fixation clamps. Voltana is equipped with LensoFlex®2 photometric engines, offering optimised photometrical performance with a minimum total cost of ownership. This highly efficient luminaire is available in five sizes to provide towns and cities with the ideal tool to improve lighting levels, generate energy savings, reduce their ecological footprint and bring aesthetic coherence.

Depending on the size of the model, Voltana incorporates different numbers of LEDs, from 6 to 32, to provide a wide range of lumen packages. This family of luminaires can be mounted using a standard side-entry clamp fixation for Ø42-60mm spigots. Thanks to an incorporated inclination system, the angle can be adjusted on-site.

As an option, universal fixation pieces are available for spigots from Ø42 to Ø76mm for post-top and side-entry mounting.



Precise on-site adjustment thanks to an incorporated inclination system



Voltana provides easy access for maintenance

## Types of application

- URBAN & RESIDENTIAL STREETS
- BRIDGES
- BIKE & PEDESTRIAN PATHS
- RAILWAY STATIONS & METROS
- CAR PARKS
- LARGE AREAS
- SQUARES & PEDESTRIAN AREAS
- ROADS & MOTORWAYS

## Key advantages

- Cost-effective and efficient lighting solution for a fast return on investment
- High performance with safety and comfort
- 5 sizes for flexibility
- IP 66 tightness level
- ThermiX® to withstand high temperatures
- Designed to incorporate the Owlet range of control solutions



The Voltana range is available with a wide range of LensoFlex®2 photometries



Voltana is available with universal fixation pieces for spigots ranging from Ø42 to Ø76mm (optional)



LensoFlex<sup>®</sup>2

LensoFlex<sup>®</sup>2 is based upon the addition principle of photometric distribution. Each LED is associated with a specific PMMA lens that generates the complete photometric distribution of the luminaire. The number of LEDs in combination with the driving current determines the intensity level of the light distribution. The proven LensoFlex<sup>®</sup>2 concept includes a glass protector to seal the LEDs and lenses into the luminaire body.




ProFlex<sup>™</sup>

The ProFlex<sup>™</sup> photometric engine integrates the lenses into a polycarbonate protector. This integration increases the output and reduces the reflection inside the optical unit. The polycarbonate used for the ProFlex<sup>™</sup> photometric engine offers essential characteristics such as high optical clarity for a superior light transmission, better impact resistance compared to glass and a long life span with UV-stabilisation treatment. The ProFlex<sup>™</sup> concept enables a compact design with a thin optical compartment. It provides extensive light distributions so that the spacing between the luminaires can be increased.



Back Light control

As an option, the LensoFlex<sup>®</sup>2 modules can be equipped with a Back Light control system. This additional feature minimises light spill from the back of the luminaire to avoid intrusive light towards buildings.

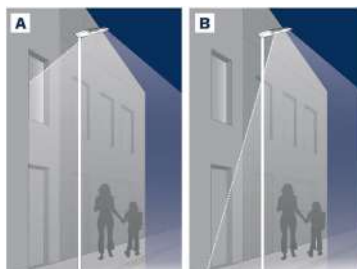


A. Without Back Light control | B. With Back Light control



### Constant Light Output (CLO)

This system compensates for the depreciation of luminous flux to avoid excess lighting at the beginning of the installation's service life. Luminous depreciation over time must be taken into account to ensure a predefined lighting level during the luminaire's useful life. Without a CLO feature, this simply means increasing the initial power upon installation in order to make up for luminous depreciation. By precisely controlling the luminous flux, the energy needed to reach the required level can be maintained throughout the luminaire's life.

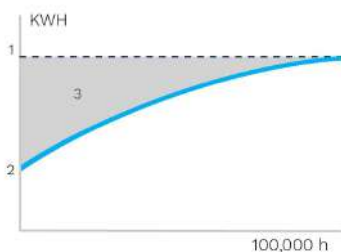


1. Standard lighting level | 2. LED lighting consumption with CLO | 3. Energy savings



### Custom dimming profile

Intelligent luminaire drivers can be programmed with complex dimming profiles. Up to five combinations of time intervals and light levels are possible. This feature does not require any extra wiring. The period between switching on and switching off is used to activate the preset dimming profile. The customised dimming system generates maximum energy savings while respecting the required lighting levels and uniformity throughout the night.

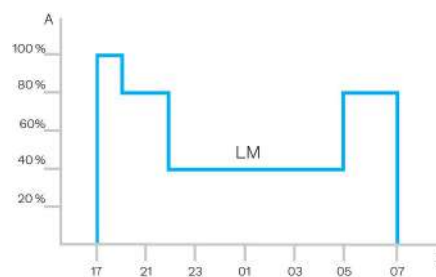

A. Performance | B. Time

# Owlet IoT

Owlet IoT remotely controls luminaires in a lighting network, creating opportunities for improved efficiency, accurate real-time data and energy savings of up to 85%.



## ALL-IN-ONE

The LUCO P7 CM controller includes the most advanced features for optimised asset management. It also provides an integrated photocell and operates with an astronomical clock for seasonal dimming profile adaptations.

## EASY TO DEPLOY

Thanks to wireless communication, no cabling is needed. The network is not subject to physical constraints or limitations. From a single control unit to an unlimited network, you can expand your lighting scheme at any time. With real-time geolocation and automatic detection of luminaire features, commissioning is quick and easy.

## USER-FRIENDLY

Once a controller is installed on a luminaire, the luminaire automatically appears with its GPS coordinates on a web-based map.

An easy-to-use dashboard enables each user to organise and customise screens, statistics and reports. Users can gain relevant, real-time insights.

The Owlet IoT web application can be accessed at all times from anywhere in the world with a device connected to the Internet. The application adapts to the device to offer an intuitive and user-friendly experience.

Real-time notifications can be pre-programmed to monitor the most important elements of the lighting scheme.



## SECURE

The Owlet IoT system uses a local wireless mesh communication networks to control the on-site luminaires combined with a remote control system utilising the cloud to ensure smooth data transfers to and from the central management system.

The system uses encrypted IP V6 communication to protect data transmission in both directions. Using a secure APN, Owlet IoT ensures a high level of protection.

In the exceptional case of a communication failure, the built-in astronomical clock and photocell will take over to switch the luminaires on and off, thus avoiding a complete blackout at night.

## EFFICIENT

Thanks to sensors and/or pre-programmed settings, lighting scenarios can be easily adapted to cope with live events, providing the right lighting levels at the right time and in the right place.

The integrated utility grade meter offers the highest accuracy available on the market today, enabling decisions based on real figures.

Accurate real-time feedback and clear reporting ensures that the network operates efficiently and maintenance is optimised.

When LED luminaires are switched on, the inrush current can create problems for the electricity grid. Owlet IoT incorporates an algorithm to preserve the grid at all times.

## OPEN

The LUCO P7 CM controller can be plugged onto the standard 7 pin NEMA socket and operates through either a DALI or 1-10V interface to control the luminaire.

Owlet IoT is based on the IPv6 protocol. This method for addressing devices can generate an almost unlimited number of unique combinations to connect non-traditional components to the Internet or computer network.

Through open APIs, Owlet IoT can be integrated into existing or future global management systems.

## GENERAL INFORMATION

|                                 |  |
|---------------------------------|--|
| Recommended installation height | 4m to 12m   13' to 39'   |
| FutureProof                     | Easy replacement of the photometric engine and electronic assembly on-site |
| Driver included                 | Yes  |
| CE Mark                         | Yes  |
| ENEC certified                  | Yes  |
| ENEC+ certified                 | Yes  |
| ROHS compliant                  | Yes  |
| Testing standard                | LM 79-08 (all measurements in ISO17025 accredited laboratory)              |

## HOUSING AND FINISH

|                        |   |
|------------------------|---|
| Housing                | Aluminium   |
| Optic                  | PMMA<br>Polycarbonate   |
| Protector              | Tempered glass<br>Polycarbonate   |
| Housing finish         | Polyester powder coating  |
| Standard colour(s)     | RAL 7038  |
| Tightness level        | IP 66   |
| Impact resistance      | IK 08   |
| Vibration test         | Compliant with ANSI C 136-31 standard, 3G load<br>Compliant with modified IEC 68-2-6 (0.5G) |
| Access for maintenance | By loosening screws on the bottom cover   |

· Any other RAL or AKZO colour upon request

· Polycarbonate (Proflex™) protector only for 6 LED version of Voltana 0

## OPERATING CONDITIONS

|                                  |  |
|----------------------------------|--|
| Operating temperature range (Ta) | -30 °C up to +50 °C / -22 °F up to 122 °F with wind effect |
|----------------------------------|--|

· Depending on the luminaire configuration. For more details, please contact us.

## ELECTRICAL INFORMATION

|                                     |   |
|-------------------------------------|---|
| Electrical class                    | Class I EU, Class II EU                             |
| Nominal voltage                     | 220-240V – 50-60Hz                                  |
| Power factor (at full load)         | 0.9   |
| Surge protection options (kV)       | 10  |
| Electromagnetic compatibility (EMC) | EN 61547 / EN 61000-4-2, -3, -4, -5, -6, -8, -11    |
| Control protocol(s)                 | 1-10V, DALI   |
| Control options                     | Bi-power, Custom dimming profile, Remote management |
| Socket option(s)                    | NEMA 7-pin (optional)                               |
| Associated control system(s)        | Owlet Nightshift<br>Owlet IoT                       |

· 7-pin Nema socket only available for Voltana 2-3-4

## OPTICAL INFORMATION

|                                  |   |
|----------------------------------|---|
| LED colour temperature           | 3000K (Warm White)<br>4000K (Neutral White)                 |
| Colour rendering index (CRI)     | >70 (Warm White)<br>>80 (Warm White)<br>>70 (Neutral White) |
| Upward Light Output Ratio (ULOR) | 0%  |


## LIFETIME OF THE LEDS @ TQ 25°C

|                    |                |
|--------------------|----------------|
| All configurations | 100,000h - L80 |
|--------------------|----------------|



## DIMENSIONS AND MOUNTING

|                              |  |
|------------------------------|--|
| AxBxC (mm   inch)            | VOLTANA 0 - 416x91x156   16.4x3.6x6.1<br>VOLTANA 1 - 501x87x181   19.7x3.4x7.1<br>VOLTANA 2 - 518x108.5x240   20.4x4.3x9.4<br>VOLTANA 3 - 641x111x240   25.2x4.4x9.4<br>VOLTANA 4 - 555x112x380   21.9x4.4x15.0<br>VOLTANA 5 - 705x109x480   27.8x4.3x18.9 |
| Weight (kg   lbs)            | VOLTANA 0 - 2.6   5.7<br>VOLTANA 1 - 3.5   7.7<br>VOLTANA 2 - 4.6   10.1<br>VOLTANA 3 - 5.6   12.3<br>VOLTANA 4 - 7.5   16.5<br>VOLTANA 5 - 12.2   26.8  |
| Aerodynamic resistance (CxS) | VOLTANA 0 - 0.01<br>VOLTANA 1 - 0.02<br>VOLTANA 2 - 0.02<br>VOLTANA 3 - 0.02<br>VOLTANA 4 - 0.03<br>VOLTANA 5 - 0.04   |
| Mounting possibilities       | Side-entry slip-over – Ø42mm<br>Side-entry slip-over – Ø48mm<br>Side-entry slip-over – Ø60mm<br>Post-top slip-over – Ø42mm<br>Post-top slip-over – Ø48mm<br>Post-top slip-over – Ø60mm<br>Post-top slip-over – Ø76mm                                       |

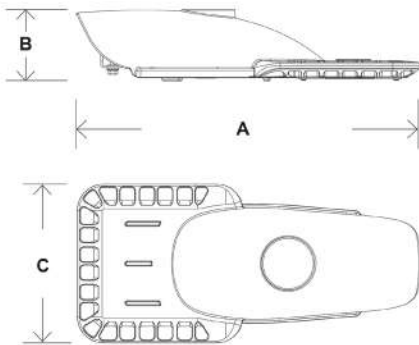



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |      | Luminaire output flux (lm)<br>Warm White 830 |      | Power consumption (W) |      | Luminaire efficacy (lm/W) |            |
|-----------|----------------|--------------|---|------|--|------|-----------------------|------|---------------------------|------------|
|           |                |              | Min   | Max  | Min  | Max  | Min                   | Max  | Up to                     | Photometry |
| VOLTANA 0 | 6              | 350          | 800   | 800  | 700  | 700  | 7.8                   | 8    | 103                       |            |
|           | 6              | 500          | 1100  | 1100 | 1000   | 1000 | 10.7                  | 11   | 103                       |            |
|           | 6              | 700          | 1400  | 1400 | 1300   | 1300 | 15                    | 15.6 | 93                        |            |
|           | 6              | 1000         | 1900  | 1900 | 1700   | 1700 | 21.9                  | 22.5 | 87                        |            |
|           | 8              | 350          | 800   | 1000 | 800  | 900  | 10                    | 10.1 | 100                       |            |
|           | 8              | 500          | 1100  | 1400 | 1000   | 1300 | 13.9                  | 14.1 | 101                       |            |
|           | 8              | 700          | 1500  | 1900 | 1400   | 1700 | 19.5                  | 20.1 | 97                        |            |
|           | 8              | 1000         | 2000  | 2400 | 1800   | 2200 | 29.4                  | 30.6 | 82                        |            |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |      | Luminaire output flux (lm)<br>Warm White 830 |      | Power consumption (W) |      | Luminaire efficacy (lm/W) |   |
|-----------|----------------|--------------|---|------|--|------|-----------------------|------|---------------------------|---|
|           |                |              | Min   | Max  | Min  | Max  | Min                   | Max  | Up to                     | Photometry  |
| VOLTANA 1 | 8              | 350          | 900   | 1100 | 800  | 1000 | 10.1                  | 10.6 | 109                       |  |
|           | 8              | 500          | 1200  | 1500 | 1100   | 1300 | 14.1                  | 14.5 | 106                       |  |
|           | 8              | 700          | 1600  | 1900 | 1400   | 1800 | 20.1                  | 20.2 | 95                        |  |
|           | 8              | 1000         | 2100  | 2500 | 1900   | 2300 | 29.4                  | 30.6 | 85                        |  |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |      | Luminaire output flux (lm)<br>Warm White 830 |      | Power consumption (W) |      | Luminaire efficacy (lm/W) |            |
|-----------|----------------|--------------|---|------|--|------|-----------------------|------|---------------------------|------------|
|           |                |              | Min   | Max  | Min  | Max  | Min                   | Max  | Up to                     | Photometry |
| VOLTANA 2 | 16             | 350          | 2300  | 2400 | 2000   | 2100 | 18.9                  | 21.7 | 127                       |            |
|           | 16             | 350          | 1800  | 2200 | 1600   | 2000 | 18.9                  | 19.4 | 116                       |            |
|           | 16             | 500          | 3200  | 3300 | 2800   | 2900 | 26.7                  | 28.8 | 124                       |            |
|           | 16             | 500          | 2400  | 3000 | 2200   | 2700 | 27.1                  | 28.8 | 111                       |            |
|           | 16             | 700          | 4400  | 4500 | 3800   | 4000 | 37.4                  | 40   | 120                       |            |
|           | 16             | 700          | 3200  | 3900 | 2900   | 3500 | 38.3                  | 40.5 | 102                       |            |
|           | 16             | 1000         | 5900  | 6100 | 5200   | 5400 | 52                    | 54   | 117                       |            |
|           | 16             | 1000         | 4200  | 5100 | 3800   | 4700 | 58                    | 58   | 88                        |            |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |      | Luminaire output flux (lm)<br>Warm White 830 |      | Power consumption (W) |      | Luminaire efficacy (lm/W) |            |
|-----------|----------------|--------------|---|------|--|------|-----------------------|------|---------------------------|------------|
|           |                |              | Min   | Max  | Min  | Max  | Min                   | Max  | Up to                     | Photometry |
| VOLTANA 3 | 24             | 350          | 3500  | 3600 | 3100   | 3200 | 27.5                  | 27.5 | 131                       |            |
|           | 24             | 350          | 2700  | 3300 | 2500   | 3000 | 27.1                  | 27.4 | 122                       |            |
|           | 24             | 500          | 4900  | 5000 | 4300   | 4400 | 39.3                  | 39.3 | 127                       |            |
|           | 24             | 500          | 3600  | 4500 | 3300   | 4100 | 39.1                  | 39.4 | 115                       |            |
|           | 24             | 700          | 6600  | 6800 | 5800   | 6000 | 55.5                  | 55.5 | 123                       |            |
|           | 24             | 700          | 4800  | 5900 | 4300   | 5300 | 56                    | 56.5 | 105                       |            |
|           | 24             | 1000         | 9000  | 9200 | 7900   | 8100 | 79                    | 79   | 116                       |            |
|           | 24             | 1000         | 6100  | 7500 | 5600   | 6800 | 82                    | 85   | 91                        |            |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |       | Luminaire output flux (lm)<br>Warm White 830 |       | Power consumption (W) |      | Luminaire efficacy (lm/W) |            |
|-----------|----------------|--------------|---|-------|--|-------|-----------------------|------|---------------------------|------------|
|           |                |              | Min   | Max   | Min  | Max   | Min                   | Max  | Up to                     | Photometry |
| VOLTANA 4 | 32             | 350          | 4800  | 5000  | 4200   | 4300  | 35.7                  | 36.6 | 140                       |            |
|           | 32             | 350          | 3700  | 4500  | 3400   | 4100  | 35.7                  | 36.5 | 126                       |            |
|           | 32             | 500          | 6800  | 6900  | 5900   | 6100  | 51.5                  | 52   | 134                       |            |
|           | 32             | 500          | 5100  | 6100  | 4600   | 5500  | 51.5                  | 52   | 118                       |            |
|           | 32             | 700          | 9100  | 9300  | 8000   | 8200  | 73                    | 73   | 127                       |            |
|           | 32             | 700          | 6600  | 7900  | 6000   | 7200  | 74                    | 74   | 107                       |            |
|           | 32             | 1000         | 12400   | 12700 | 10900  | 11100 | 99                    | 103  | 128                       |            |
|           | 32             | 1000         | 8600  | 10300 | 7800   | 9400  | 106                   | 111  | 97                        |            |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$



| Luminaire | Number of LEDs | Current (mA) | Luminaire output flux (lm)<br>Neutral White 740 |       | Luminaire output flux (lm)<br>Warm White 830 |       | Power consumption (W) |     | Luminaire efficacy (lm/W) |            |
|-----------|----------------|--------------|---|-------|--|-------|-----------------------|-----|---------------------------|------------|
|           |                |              | Min   | Max   | Min  | Max   | Min                   | Max | Up to                     | Photometry |
| VOLTANA 5 | 64             | 350          | 9700  | 9900  | 8500   | 8700  | 70                    | 70  | 141                       |            |
|           | 64             | 350          | 7500  | 9000  | 6800   | 8300  | 70                    | 70  | 129                       |            |
|           | 64             | 500          | 13500   | 13800 | 11800  | 12100 | 101                   | 101 | 137                       |            |
|           | 64             | 500          | 10100   | 12200 | 9200   | 11200 | 101                   | 101 | 121                       |            |
|           | 64             | 700          | 18100   | 18600 | 15900  | 16300 | 143                   | 143 | 130                       |            |
|           | 64             | 700          | 13100   | 15900 | 12000  | 14500 | 145                   | 145 | 110                       |            |
|           | 64             | 1000         | 24500   | 25200 | 21500  | 22100 | 206                   | 206 | 122                       |            |
|           | 64             | 1000         | 16900   | 20500 | 15400  | 18700 | 222                   | 222 | 92                        |            |

Tolerance on LED flux is  $\pm 7\%$  and on total luminaire power  $\pm 5\%$

